
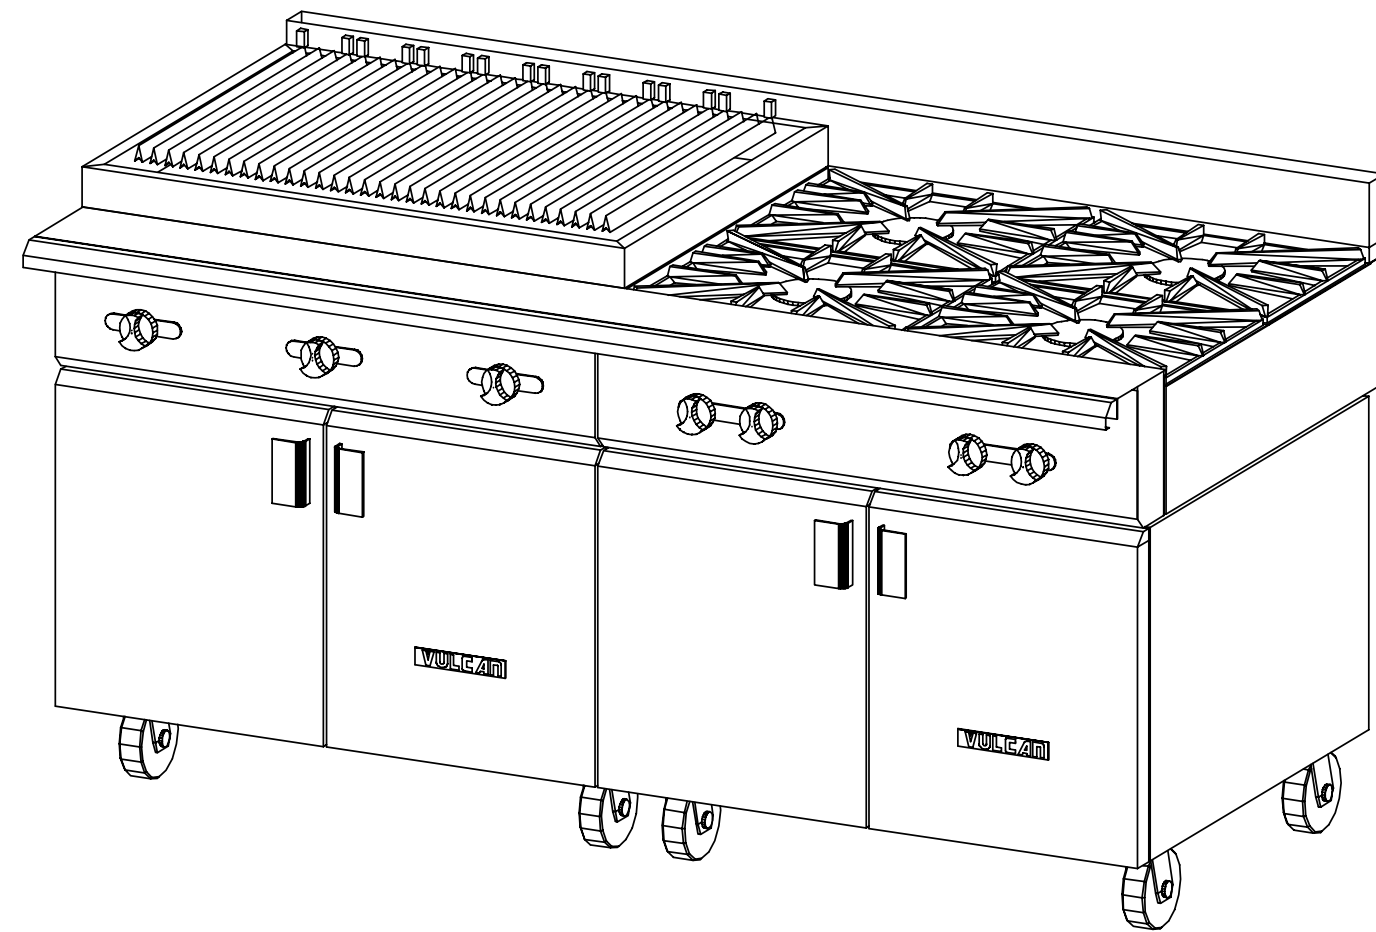


GAS CONNECTION #1  
LOCATED IN ITEM# 25  
PIPE SIZE: 1" NPT  
OP HEIGHT: 32" AFF  
TOTAL GAS LOAD: 239 MBTU  
INCLUDES ITEMS: 25 18  
NOTE:

18	1 EA	V4B36B	RANGE
140	MBTU	1.25	MANIFOLD
25	1 EA	VCBB36B	CHAR BROILER
99	MBTU	1.00	32 AFF

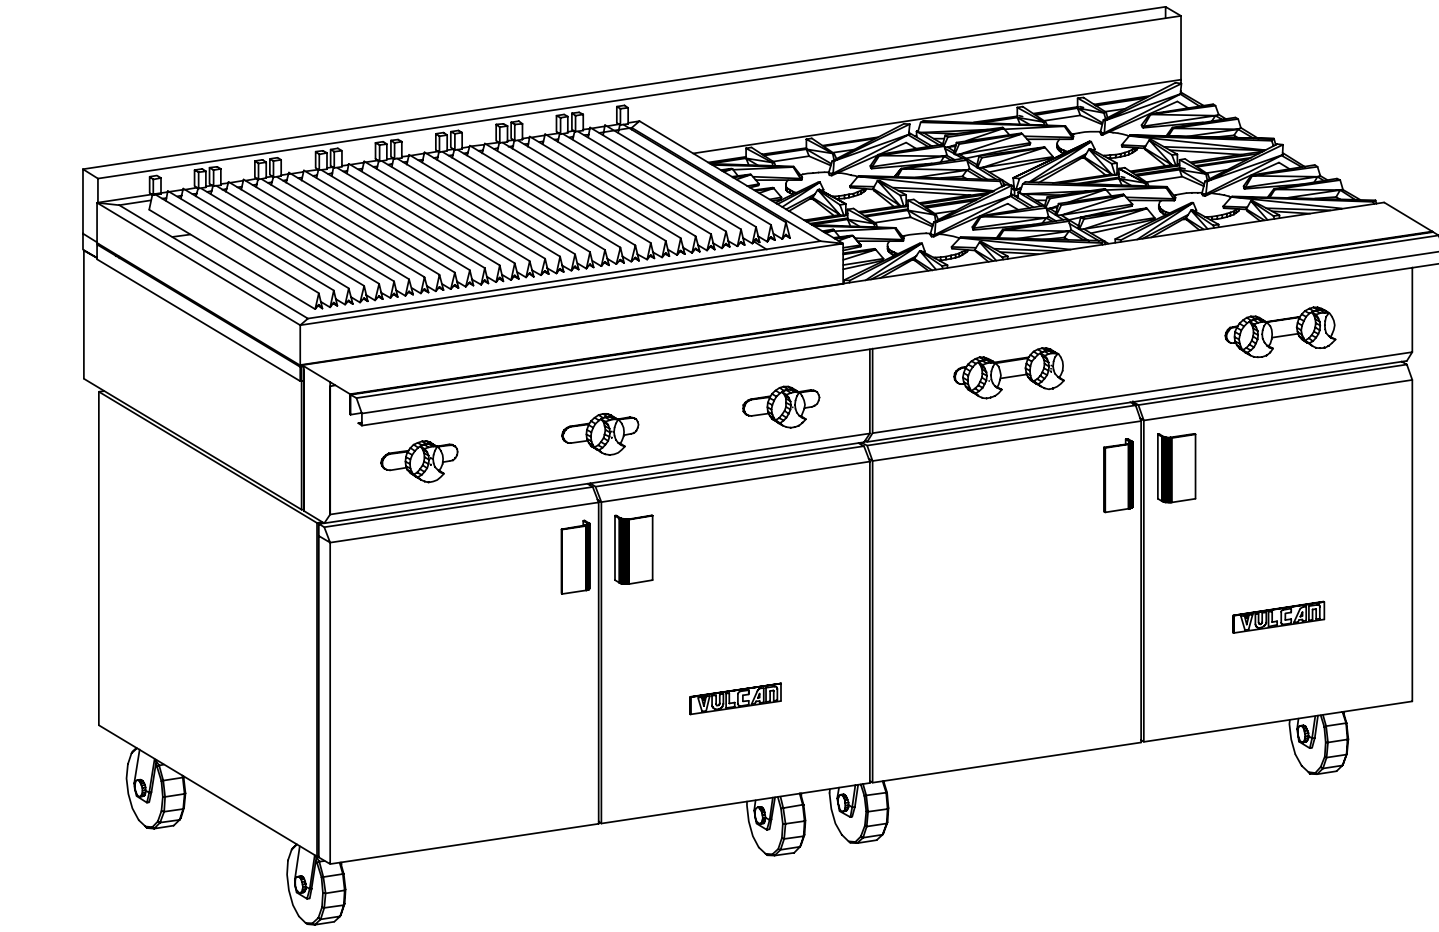

#### GENERAL NOTES - PLEASE READ

VENTILATION:  
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:  
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:  
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:  
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:  
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:  
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURER RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

CONNECTION POINT
COLD WATER
HOT WATER
HOT + COLD WATER
DRAIN
POWER
SWITCH
CORD SET
CONV. OUTLET RECP
DUPLEX RECP/TALE
SINGLE RECP/TALE
GAS
STEAM SUPPLY
STEAM RETURN
STEAM TAKE OFF
EXHAUST VENT
SUPPLY VENT
REFRIGERATION

07-21-2021

PROJECT CODE  
AUTO2

**VULCAN**  
THE VULCAN HART COMPANY  
BALTIMORE, MARYLAND  
410-284-0660

AUTOGRAPH  
SAN ANTONIO, TX

REVISIONS	By	Date	Revision
	dcb	07/20/2021	LARGE FORMAT

**NEXT STEP DESIGN**  
**913 WEST ST.**  
**ANNAPOLIS, MD 21401**

SCALE:  
AS NOTED  
DATE: 07/20/2021  
DRAWN BY: DDB  
VH-AUTO2

1  
OF 1