


49	1 EA	VWT12B	SPREADER
50	1 EA	VCBB36	CHRBROILER
51	1 EA	VSC48	REFRIGERATED BASE
55	1 EA	V6B36S	RANGE
56	1 EA	VWT12B	SPREADER
57	1 EA	V36RR	SALAMANDER
58	1 EA	VGMT36S	RANGE
62	1 EA	V4B36S	RANGE

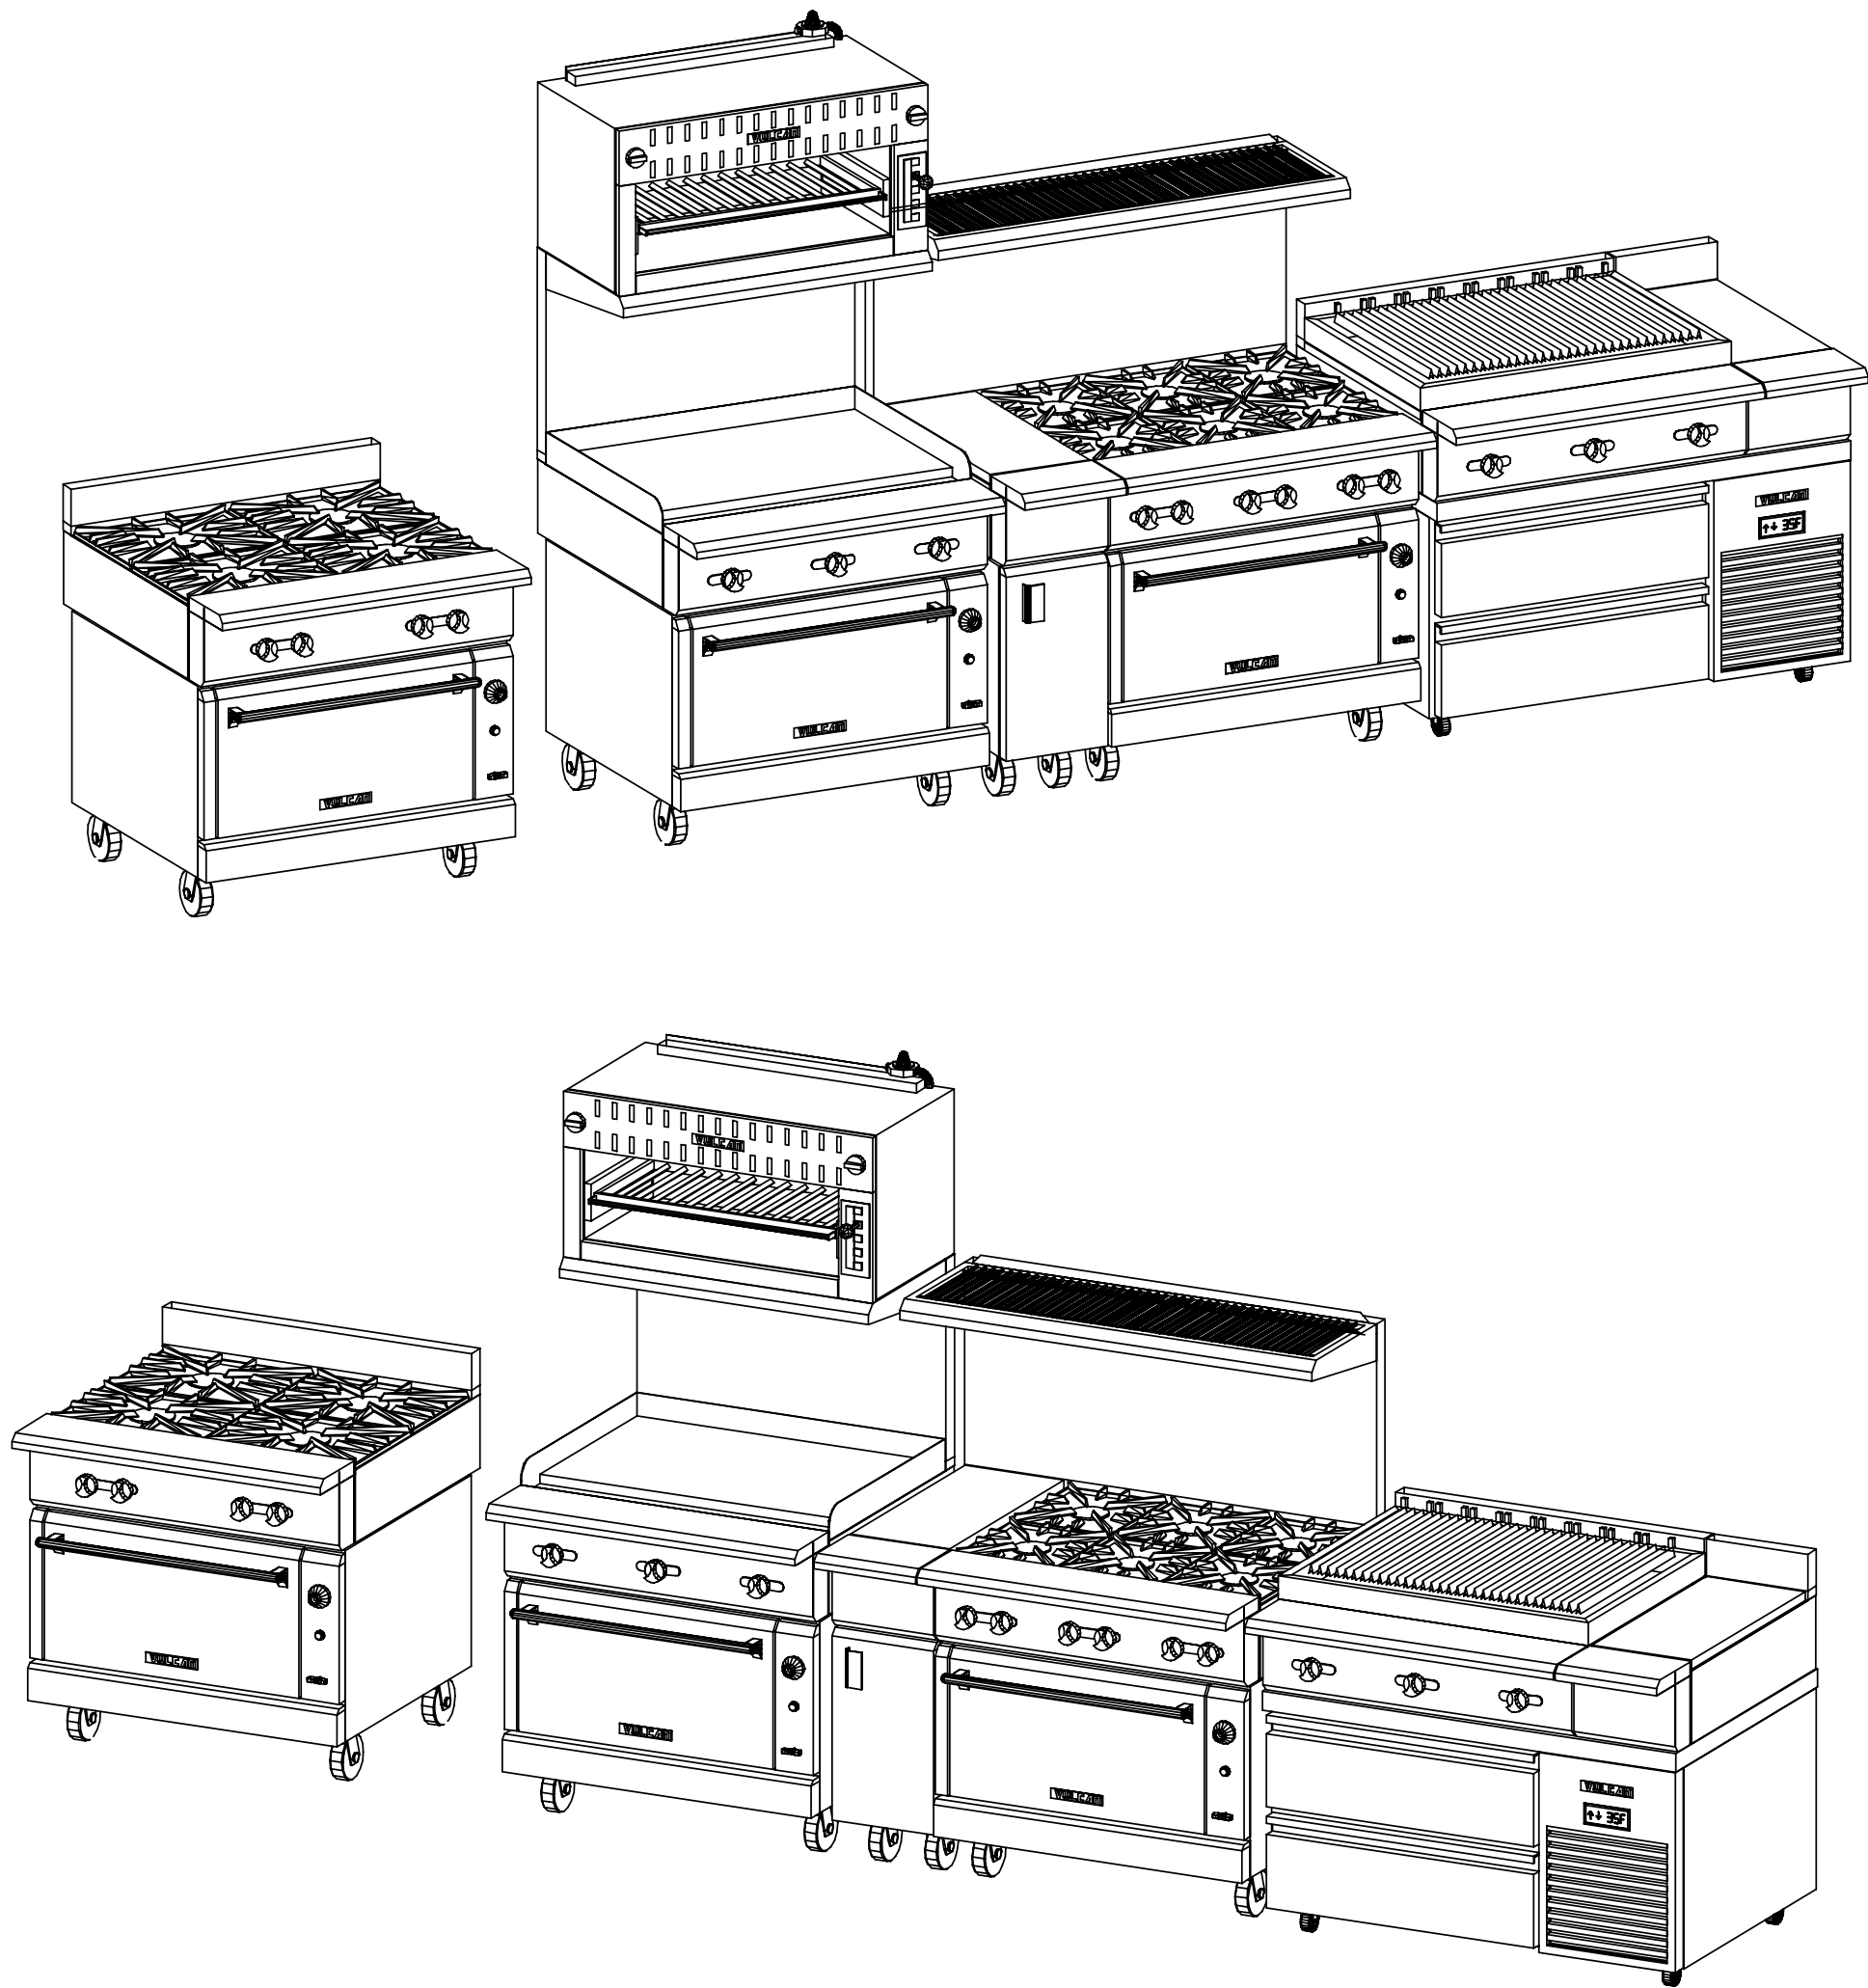

#### GENERAL NOTES - PLEASE READ

VENTILATION:  
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:  
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:  
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:  
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:  
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:  
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURERS RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

●	CONNECTION POINT
○	COLD WATER
○	HOT WATER
○	HOT + COLD WATER
○	DRAIN
○	POWER
○	SWITCH
○	CORD SET
○	CONV. OUTLET RECP
○	DUPLEX RECP/TACLE
○	SINGLE RECP/TACLE
○	GAS
○	STEAM SUPPLY
○	STEAM RETURN
○	STEAM TAKE OFF
○	EXHAUST VENT
○	SUPPLY VENT
○	REFRIGERATION

10-17-2021

PROJECT CODE  
BAYCK

BAY CREEK COACH HOUSE  
1 CLUBHOUSE WAY  
CAPE CHARLES, VA

REVISIONS	By	Date	Revision
	ddb	10/17/2021	LARGE FORMAT

NEXT STEP DESIGN  
913 WEST ST.  
ANNAPOLIS, MD 21401

SCALE:  
AS NOTED  
DATE: 10-17-2021  
DRAWN BY: DDB  
VH-BAYCK

1  
OF 1

VULCAN  
THE VULCAN HART COMPANY  
BALTIMORE, MARYLAND  
410-284-0660