
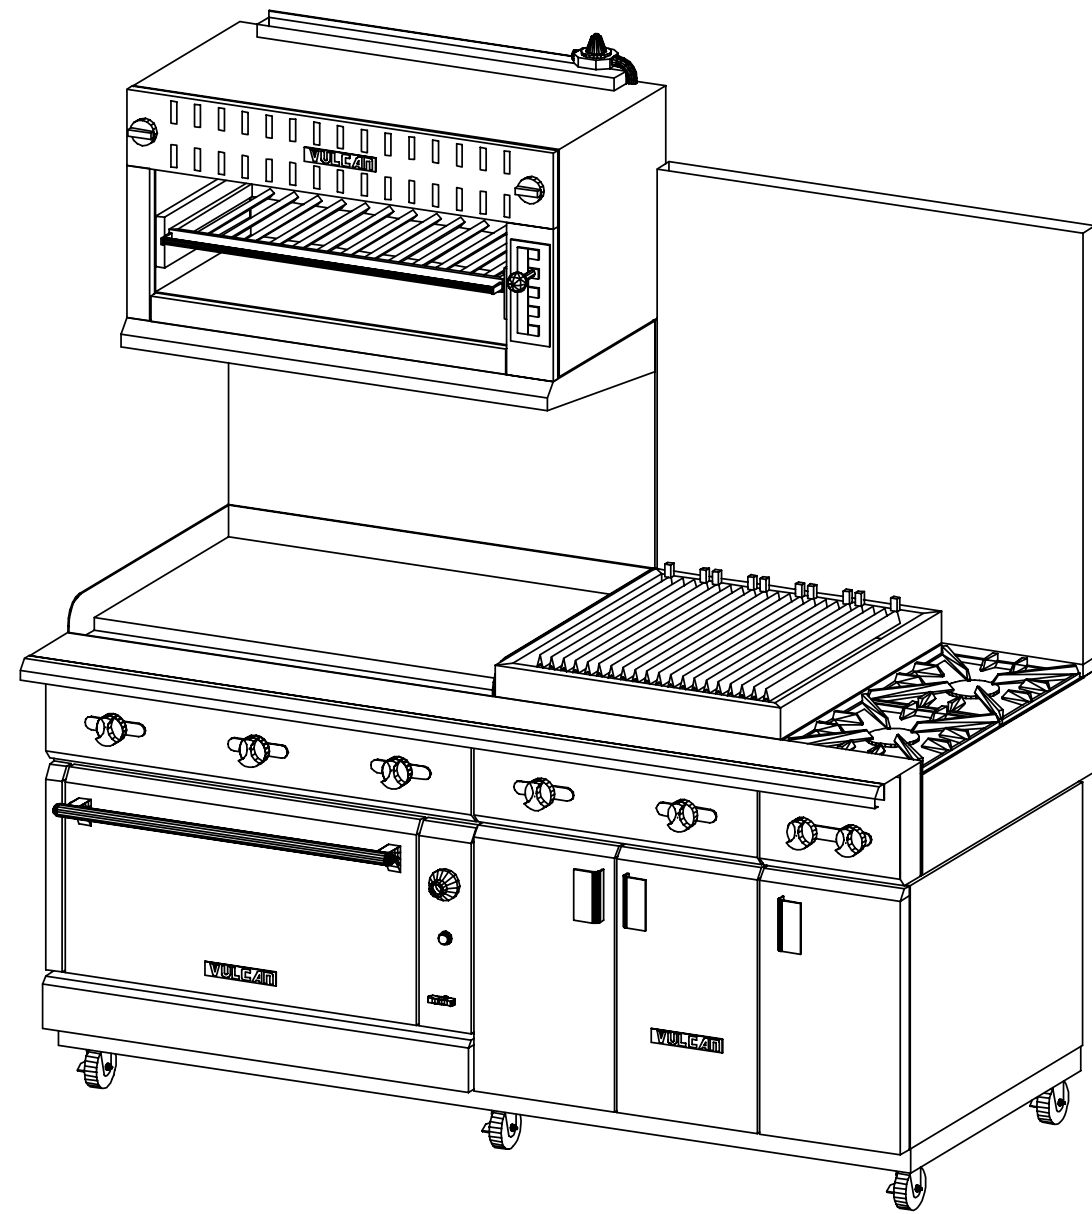


67	1 EA	VGMT36S	RANGE	
140 MBTU	1.25	32 AFF		
68	1 EA	361RB	SALAMANDER	
30 MBTU	0.75	INTERPLUMB		
70	1 EA	VCBB24B	CHARBROILER	
65 MBTU	1.25	MANIFOLD		
71	1 EA	V2B12B	RANGE	
70 MBTU	1.25	MANIFOLD		

GAS CONNECTION #1  
LOCATED IN ITEM# 67  
PIPE SIZE: 1.25 NPT  
CP HEIGHT: 32" AFF  
TOTAL GAS LOAD: 305 MBTU  
INCLUDES ITEMS: 71 70 68 67  
NOTE:

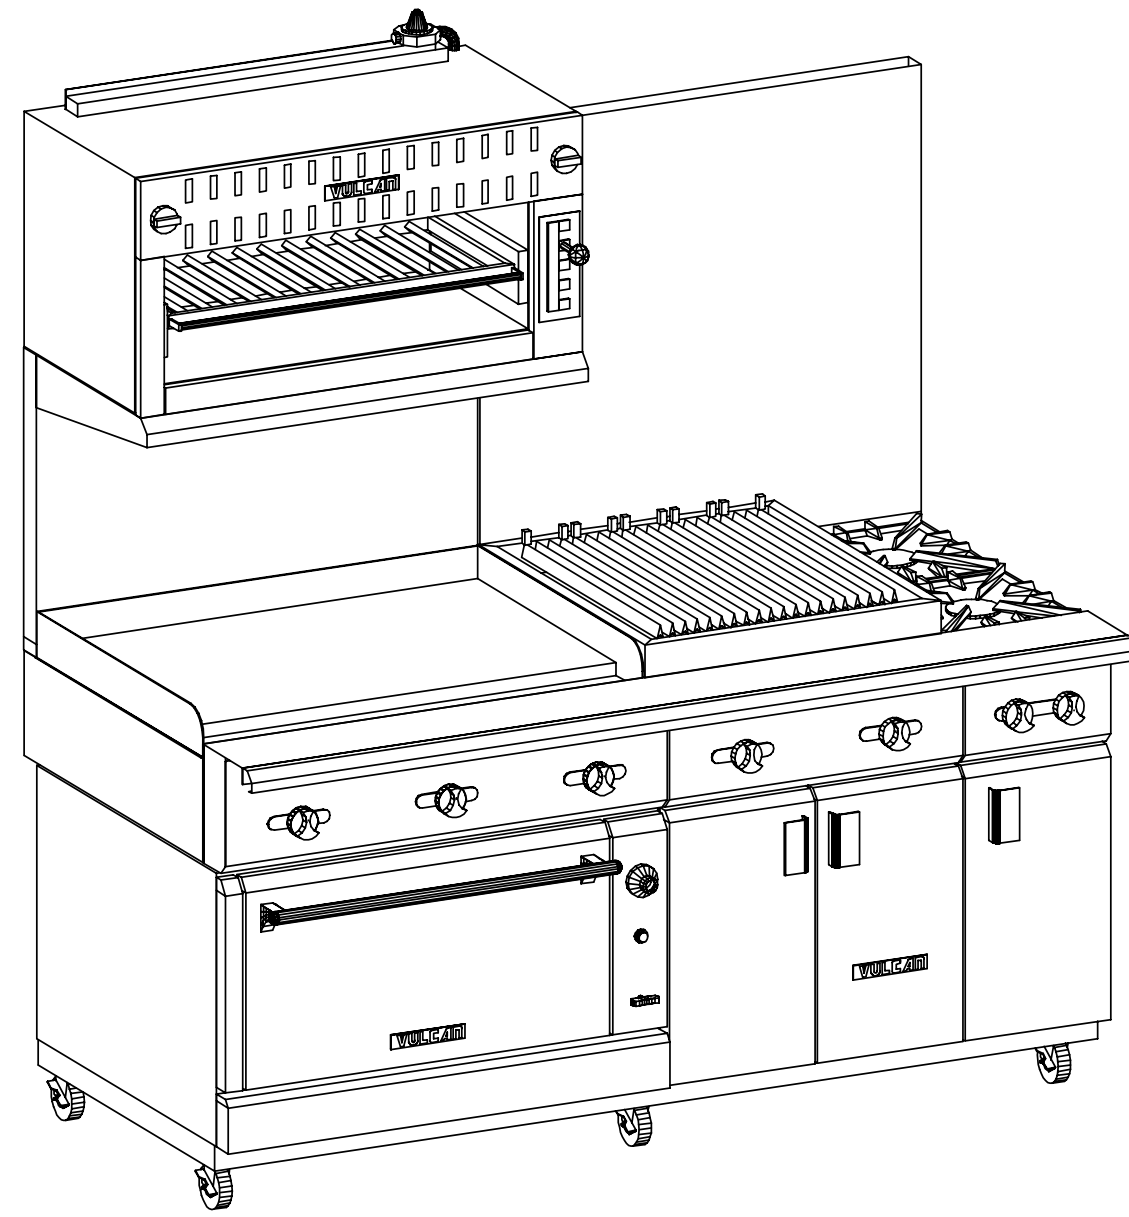

#### GENERAL NOTES - PLEASE READ

VENTILATION:  
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:  
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:  
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:  
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:  
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:  
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURES RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

CONNECTION POINT
COLD WATER
HOT WATER
HOT + COLD WATER
DRAIN
POWER
SWITCH
CORD SET
CONV. OUTLET RECP
DUPLEX RECP/TABLE
SINGLE RECP/TABLE
GAS
STEAM SUPPLY
STEAM RETURN
STEAM TAKE OFF
EXHAUST VENT
SUPPLY VENT
REFRIGERATION

01-21-2022

PROJECT CODE  
**BLUEL**

**VULCAN**  
THE VULCAN HART COMPANY  
BALTIMORE, MARYLAND  
410-284-0660

PROJECT **BLUE**  
DAY **CLUB**  
Las Vegas

REVISIONS		Revision
No.	Date	By
2	01/21/2022	ddb

**NEXT STEP DESIGN**  
**913 WEST ST.**  
**ANNAPOLIS, MD 21401**

SCALE:  
AS NOTED  
DATE: 01/21/2022  
DRAWN BY: DDB  
VH-BLUEL