


141	1 EA	36IRB	SALAMANDER
30 MBTU	0.75		INTERPLUMB
142	1 EA	VSC36	REFRIG BASE
120 (1)	6.7A		5-15
145	1 EA	VGMT36	GRIDDLE
90 MBTU	1.25		32 AFF

GAS CONNECTION #1:
LOCATED IN ITEM: 145
PIPE SIZE: 1.25 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 120 MBTU
INCLUDES ITEMS: 141 145
NOTE:

166	1 EA	VICM48	CHEESE MELTER	WALL MOUNT
40 MBTU	0.75			78 AFF
167	1 EA	VGMT36B	RANGE	
90 MBTU	1.25			32 AFF
167.1	1 EA	VGT24B	GRIDDLE	
60 MBTU	1.25			MANIFOLD

GAS CONNECTION #2:
LOCATED IN ITEM: 167
PIPE SIZE: 1.25 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 120 MBTU
INCLUDES ITEMS: 167.1 167
NOTE:

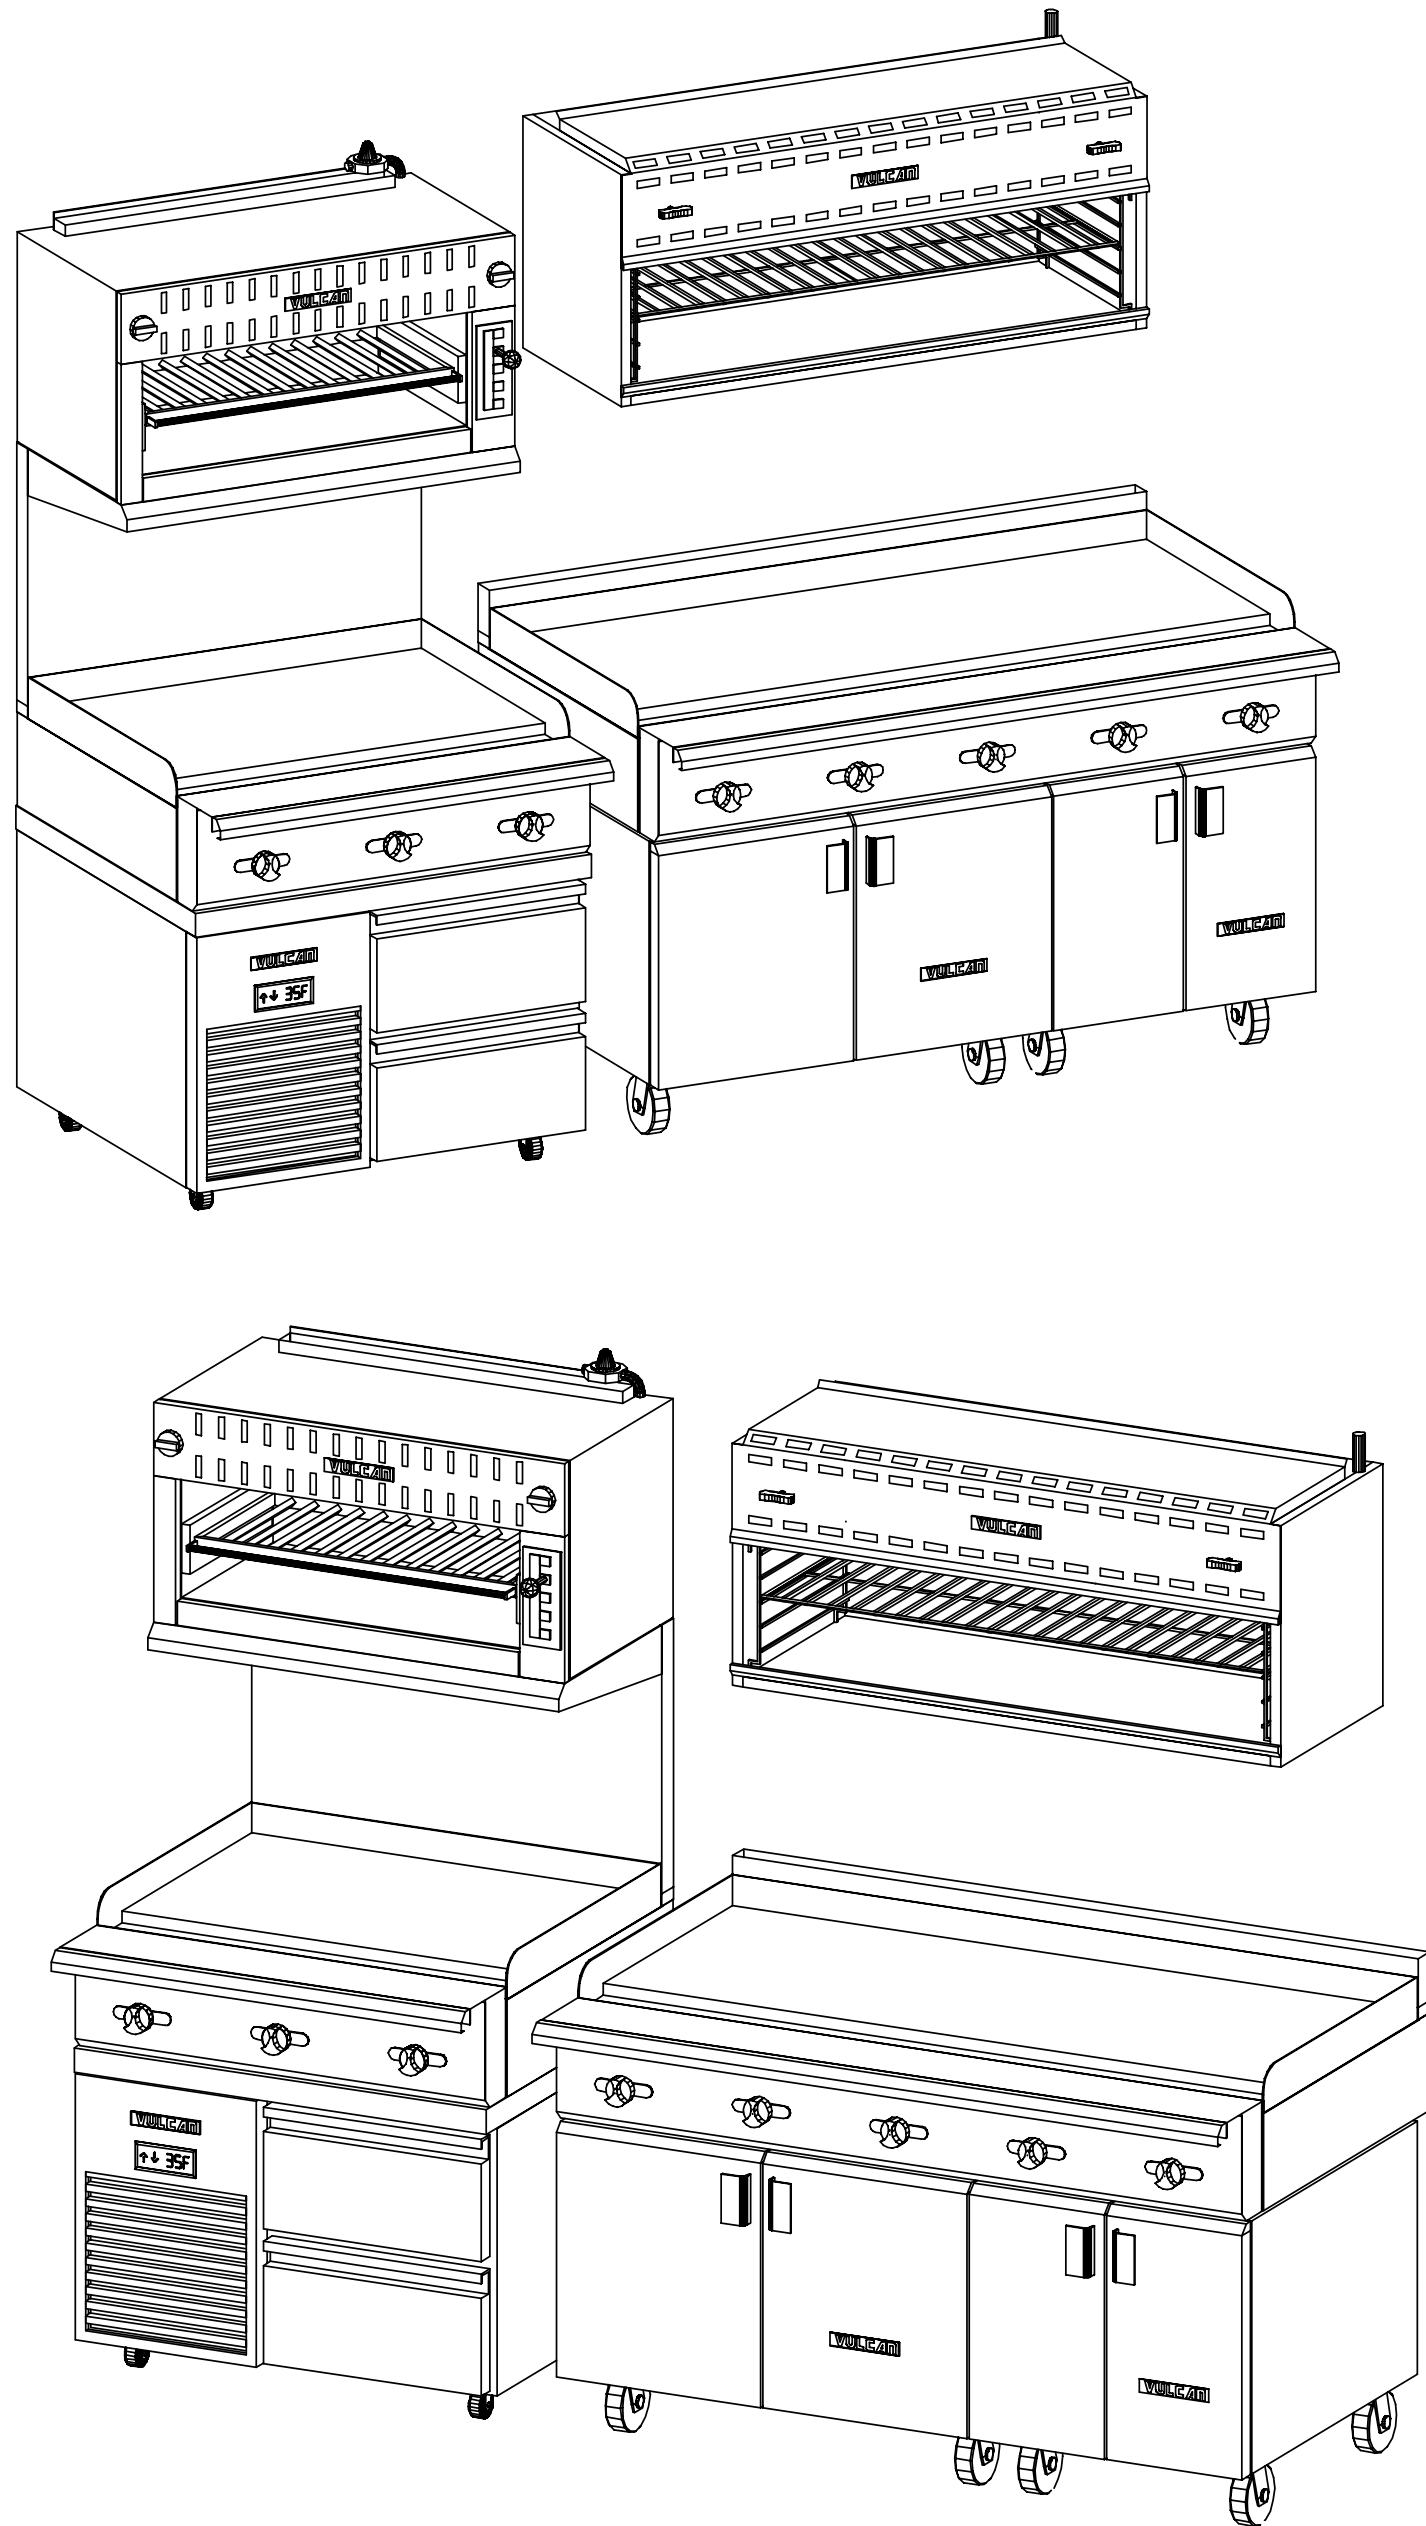

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURERS RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

●	CONNECTION POINT
○	COLD WATER
○	HOT WATER
○	HOT + COLD WATER
○	DRAIN
○	POWER
○	SWITCH
○	CORD SET
○	CONV. OUTLET RECP
○	DUPLEX RECP/TABLE
○	SINGLE RECP/TABLE
○	GAS
○	STEAM SUPPLY
○	STEAM RETURN
○	STEAM TAKE OFF
○	EXHAUST VENT
○	SUPPLY VENT
○	REFRIGERATION

09-02-2021

PROJECT CODE
CCASN

VULCAN
THE VULCAN HART COMPANY
BALTIMORE, MARYLAND
410-284-0660

CHEROKEE CASINO
WEST SILOAM

REVISIONS		Revision
No.	Date	By
02	05/02/2021	ddb

NEXT STEP DESIGN
913 WEST ST.
ANNAPOLIS, MD 21401

SCALE:
AS NOTED
DATE: 09/02/2021
DRAWN BY: DDB
VH-CCASN