


PLAN VIEW

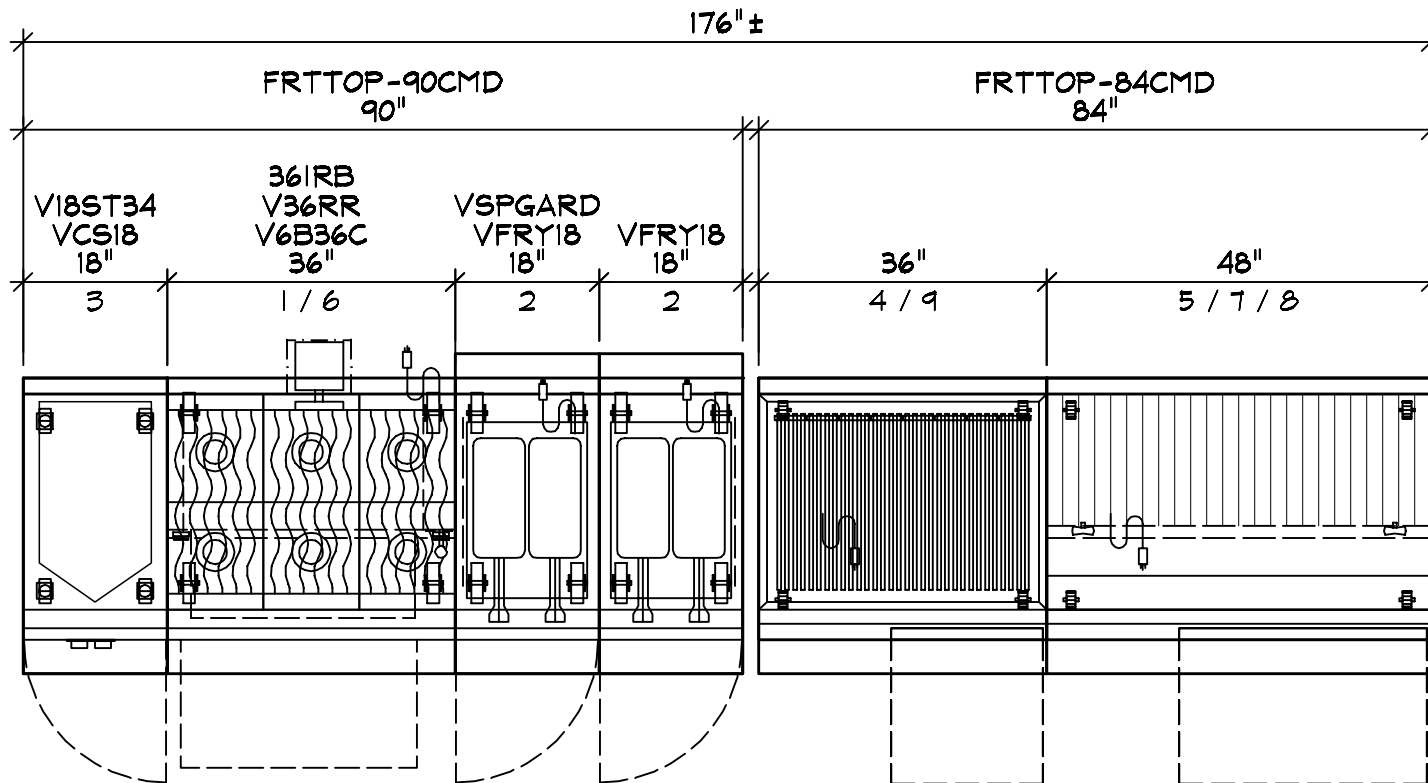

VH-CHRKE
COPYRIGHT (C) 2021


VULCAN

CHRIS BREWER
CHRKE

CHEROKEE TOWN CLUB

01-16-21

CONNECTIONS

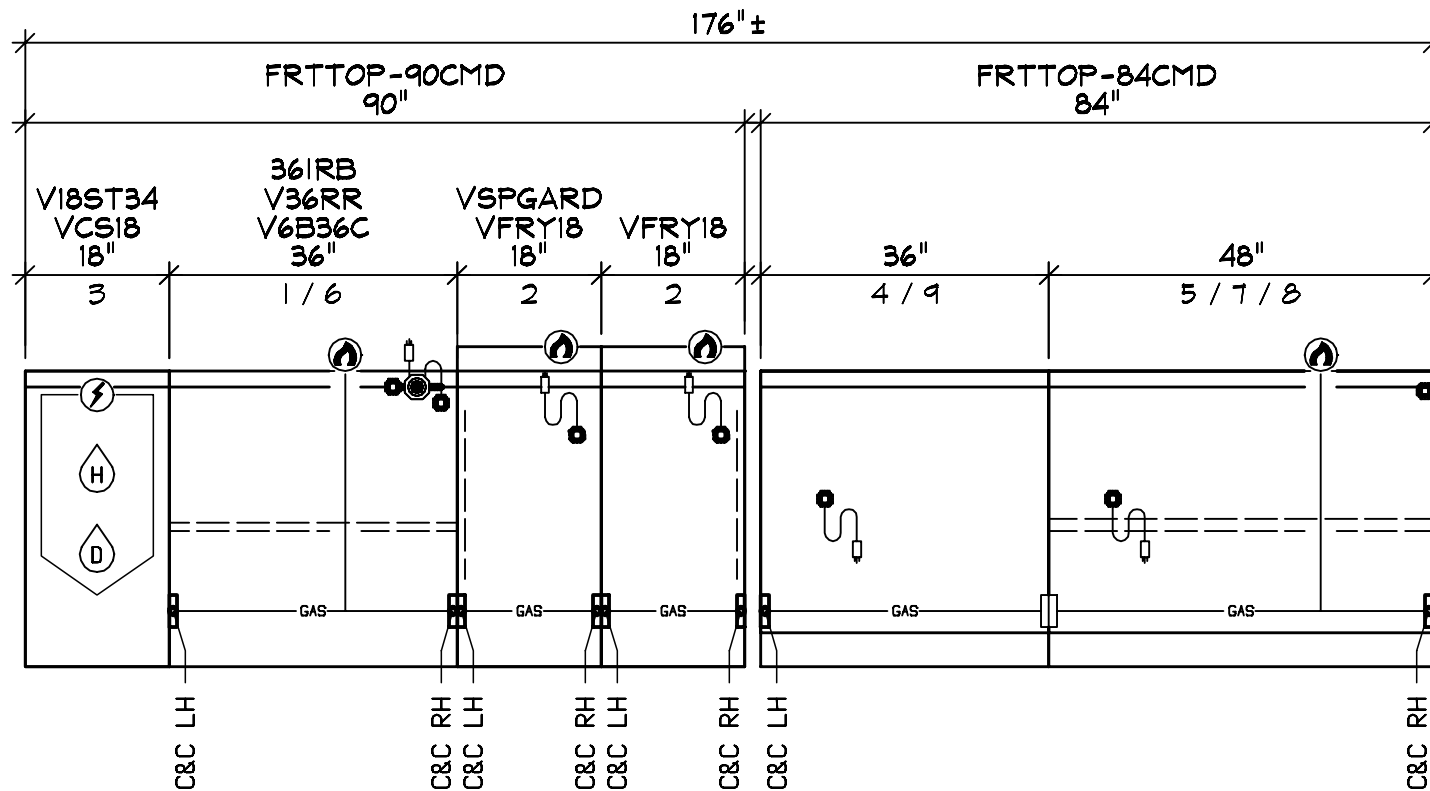

GAS CONNECTION #: 1
 LOCATED IN ITEM: 1
 PIPE SIZE: 1.25 NPT
 CP HEIGHT: 32" AFF
 TOTAL GAS LOAD: 272 MBTU
 INCLUDES ITEMS: 1 6
 NOTE:

GAS CONNECTION #: 2
 LOCATED IN ITEM: 2
 PIPE SIZE: 0.75 NPT
 CP HEIGHT: 12" AFF
 TOTAL GAS LOAD: 70 MBTU
 INCLUDES ITEMS: 2
 NOTE: QTY (2)

GAS CONNECTION #: 3
 LOCATED IN ITEM: 5
 PIPE SIZE: 1.25 NPT
 CP HEIGHT: 32" AFF
 TOTAL GAS LOAD: 259 MBTU
 INCLUDES ITEMS: 8 5 4
 NOTE:

VH-CHRKE
 COPYRIGHT (C) 2021


VULCAN

CHRIS BREWER
 CHRKE

CHEROKEE TOWN CLUB

01-16-21

ELEVATION

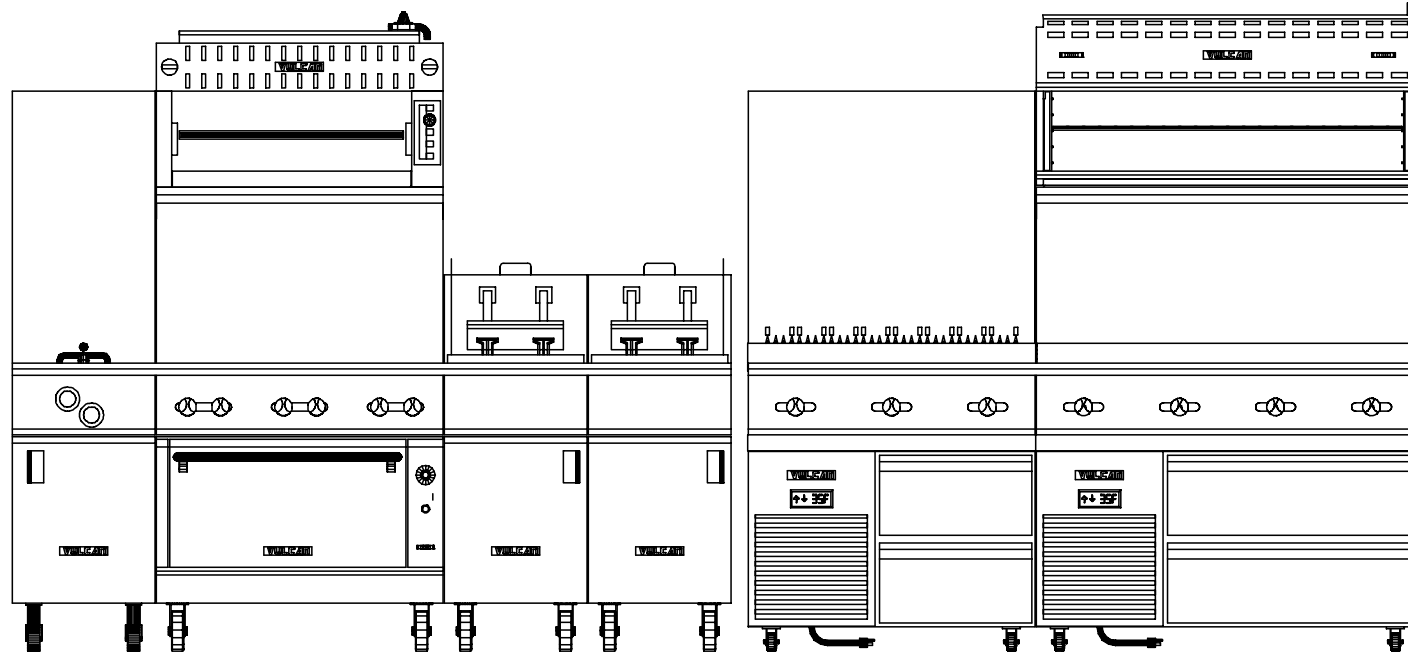

VH-CHRKE
COPYRIGHT (C) 2021


VULCAN

CHRIS BREWER
CHRKE

CHEROKEE TOWN CLUB

01-16-21

SSS VIEW

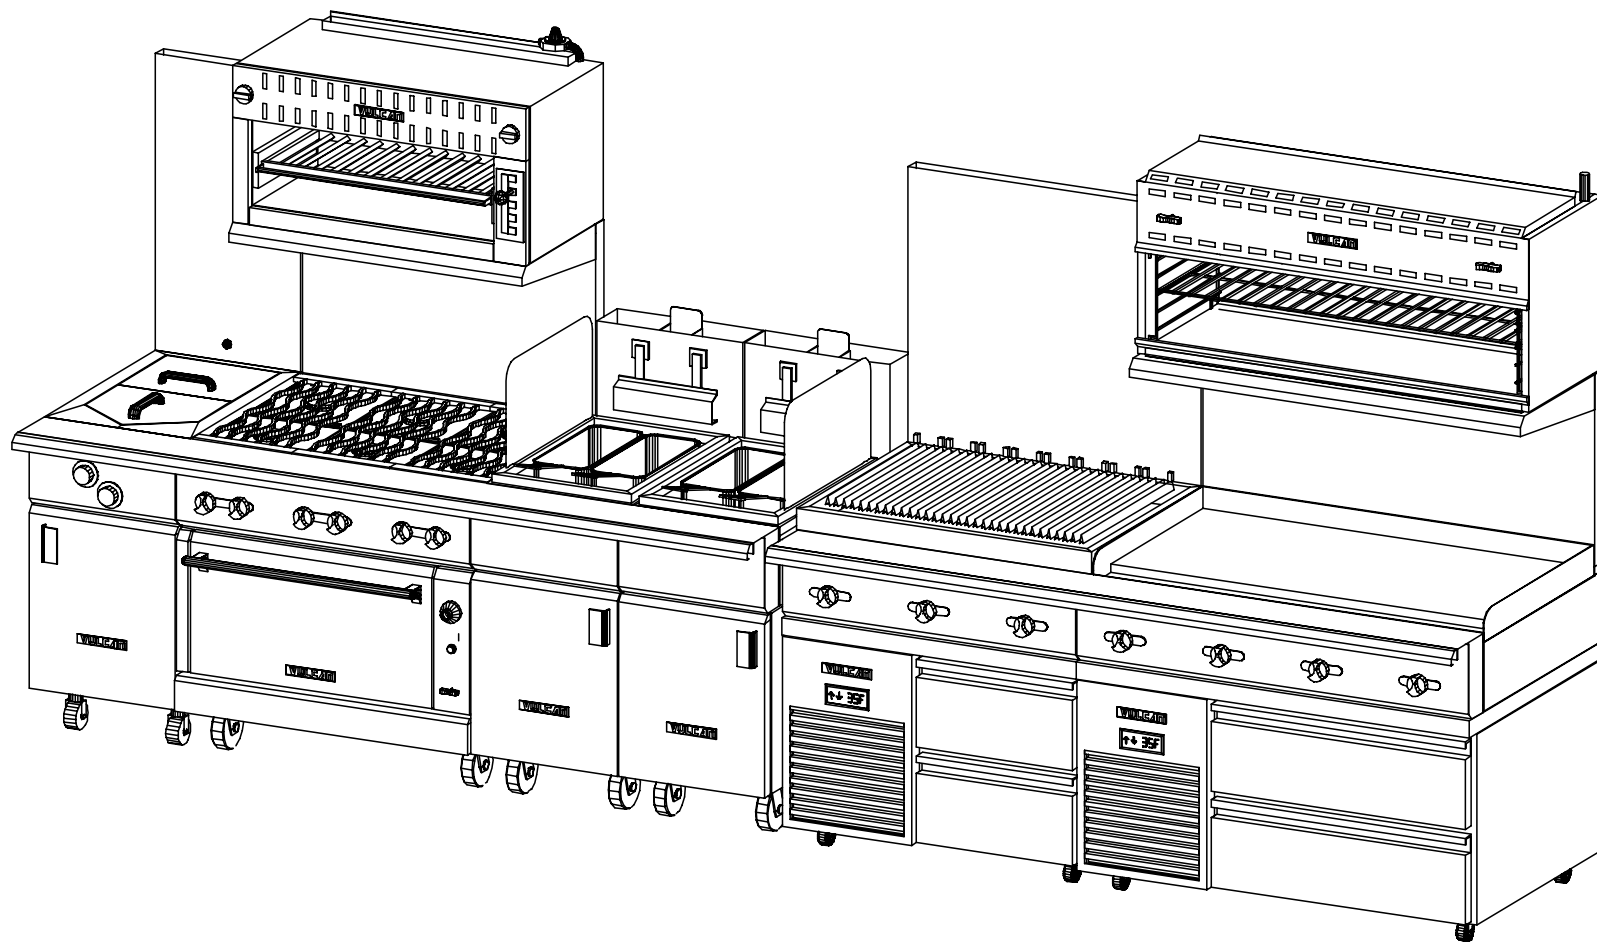

VH-CHRKE
COPYRIGHT (C) 2021


 **VULCAN**

CHRIS BREWER
CHRKE

CHEROKEE TOWN CLUB

01-16-21

SSW VIEW

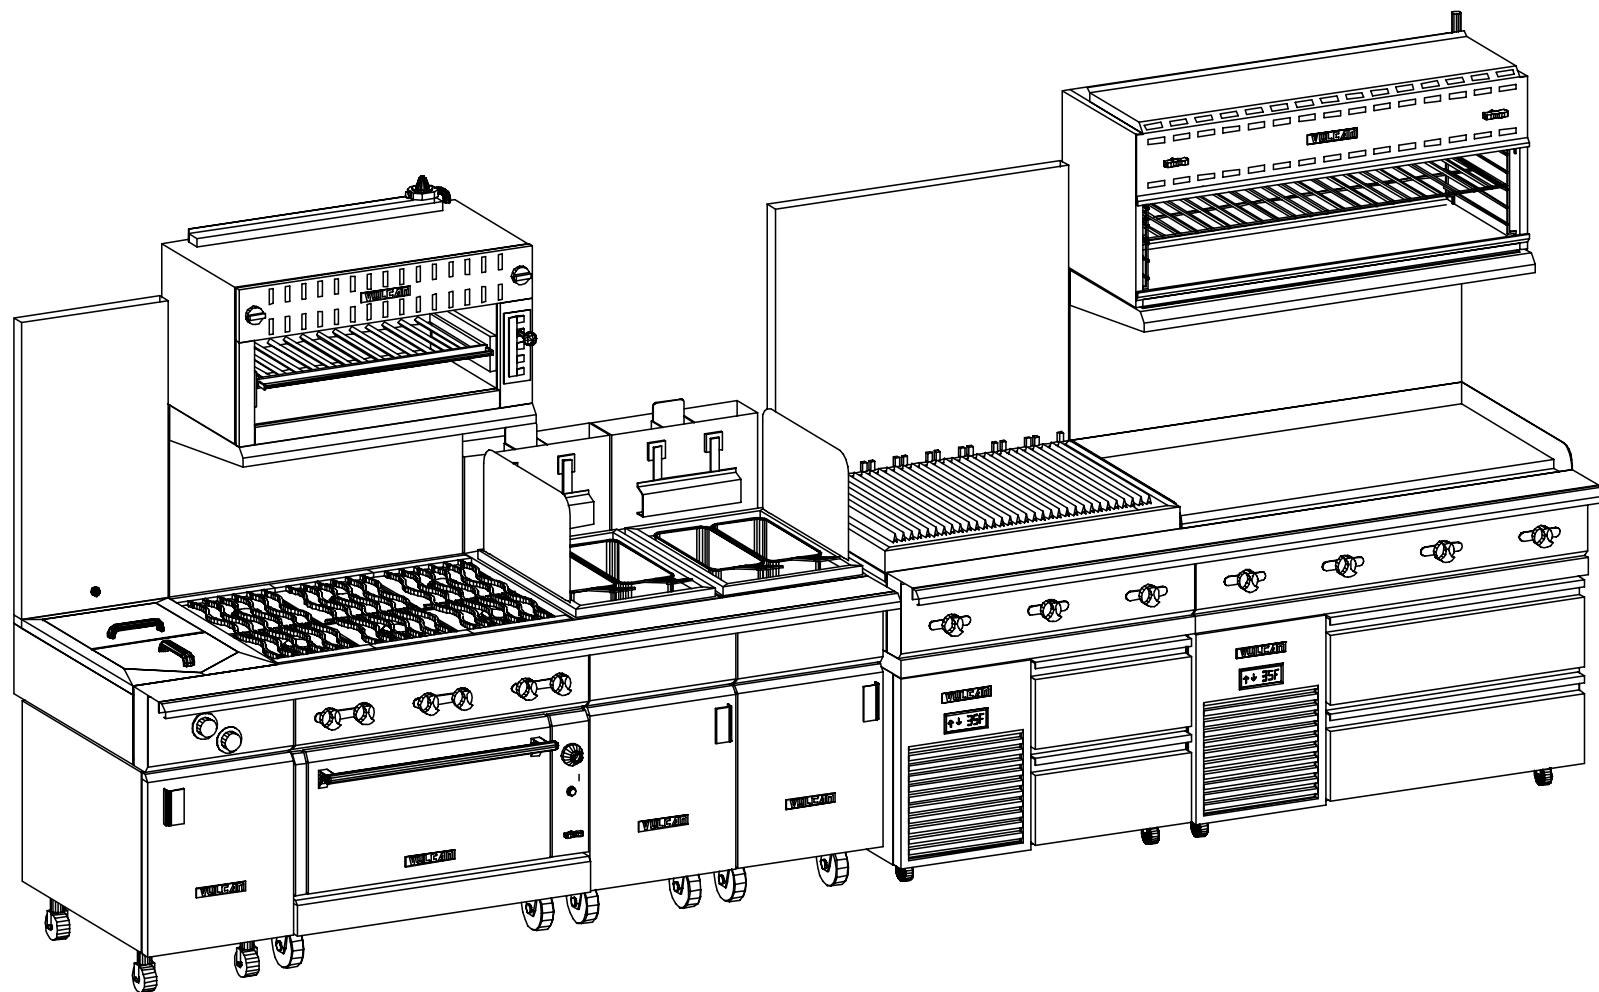












VH-CHRKE
COPYRIGHT (C) 2021

 **VULCAN**

CHRIS BREWER
CHRKE

CHEROKEE TOWN CLUB

01-16-21

1	1 EA	V6B36C	RANGE	
	242 MBTU	1.25	32 AFF	
	120 (1)	4.0A	5-15	
2	2 EA	VFRY18	FRYER	
	70 MBTU	1.25	12 AFF	
	120 (1)	3.0A	5-15	
3	1 EA	VCS18	CHEF STATION	
	208 (3)	25.0A	12 AFF	
CW	0.50	12 AFF		
IW	1.00	12 AFF		
4	1 EA	VCBB36	CHRA BROILER	
	99 MBTU	1.25	MANIFOLD	
5	1 EA	TGRD48	GRIDDLE	
	120 MBTU	1.25	32 AFF	
6	1 EA	36IRB	SALAMANDER	
	30 MBTU	0.75	INTERPLUMB	
7	1 EA	VSC48	FREZZER BASE	
	120 (1)	6.7A	5-15	
8	1 EA	VICM48	CHEESE MELTER	
	40 MBTU	0.75	78 AFF	INTERPLUMB
9	1 EA	VSC36	REFRIG BASE	
	120 (1)	6.7A	5-15	

VH-CHRKE

COPYRIGHT (C) 2021

 VULCAN

CHRIS BREWER
CHRKE

CHEROKEE TOWN CLUB

01-16-21

GENERAL NOTES - PLEASE READ**VENTILATION:**

ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:

ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:

ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:



















EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (14" W.C.)

BY OTHERS:

VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:

IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURER RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

	CONNECTION POINT
	COLD WATER
	HOT WATER
	HOT + COLD WATER
	DRAIN
	POWER
	SWITCH
	CORD SET
	CONV OUTLET RECP
	DUPLEX RECPTACLE
	SINGLE RECPTACLE
	GAS
	STEAM SUPPLY
	STEAM RETURN
	STEAM TAKE OFF
	EXHAUST VENT
	SUPPLY VENT
	REFRIGERATION

01-16-2021

01-16-2021 : 10:35:50a

PROJECT CODE

CHRKE