
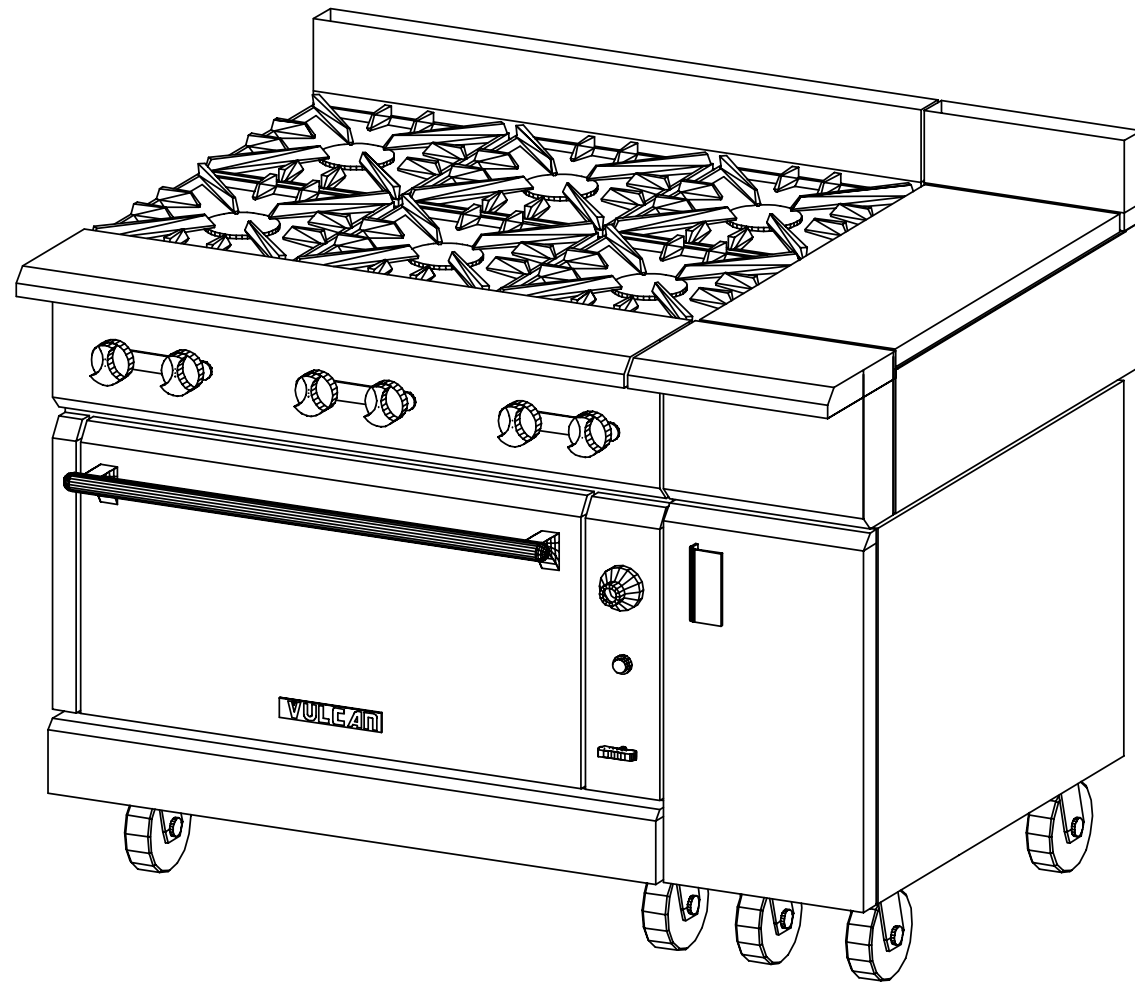


127	1 EA	VWT12B	SPREADER
128	1 EA	V4B36S	RANGE
190	MBTU	1.25	32 AFF

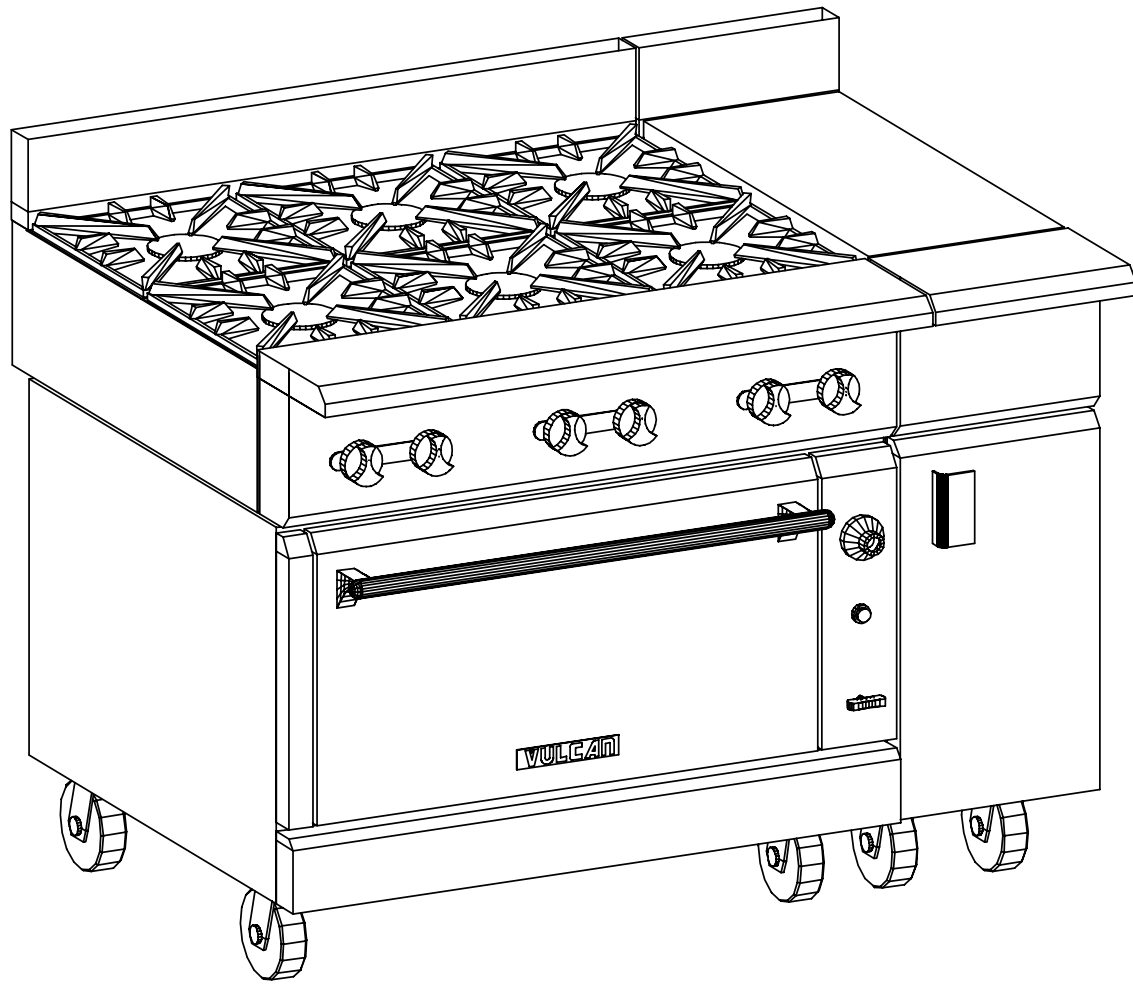

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURERS RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

●	CONNECTION POINT
○	COLD WATER
△	HOT WATER
⬆	HOT + COLD WATER
○	DRAIN
⚡	POWER
⚡	SWITCH
⚡	CORD SET
⚡	CORD SET
⚡	CONV. OUTLET RECP
⚡	DUPLEX RECP/TACLE
⚡	SINGLE RECP/TACLE
⚡	GAS
⚡	STEAM SUPPLY
⚡	STEAM RETURN
⚡	STEAM TAKE OFF
⚡	EXHAUST VENT
⚡	SUPPLY VENT
⚡	REFRIGERATION

01-08-2022

PROJECT CODE
DSNYC

VULCAN
THE VULCAN HART COMPANY
BALTIMORE, MARYLAND
410-284-0660

DELTA
SKY CKUB NYC

REVISIONS		Revision
No.	Date	By
2	0108-2022	ddb
		LARGE FORMAT

NEXT STEP DESIGN
913 WEST ST.
ANNAPOLIS, MD 21401

SCALE:
AS NOTED
DATE: 01/08/2022
DRAWN BY: DDB
VH-DSNYC