










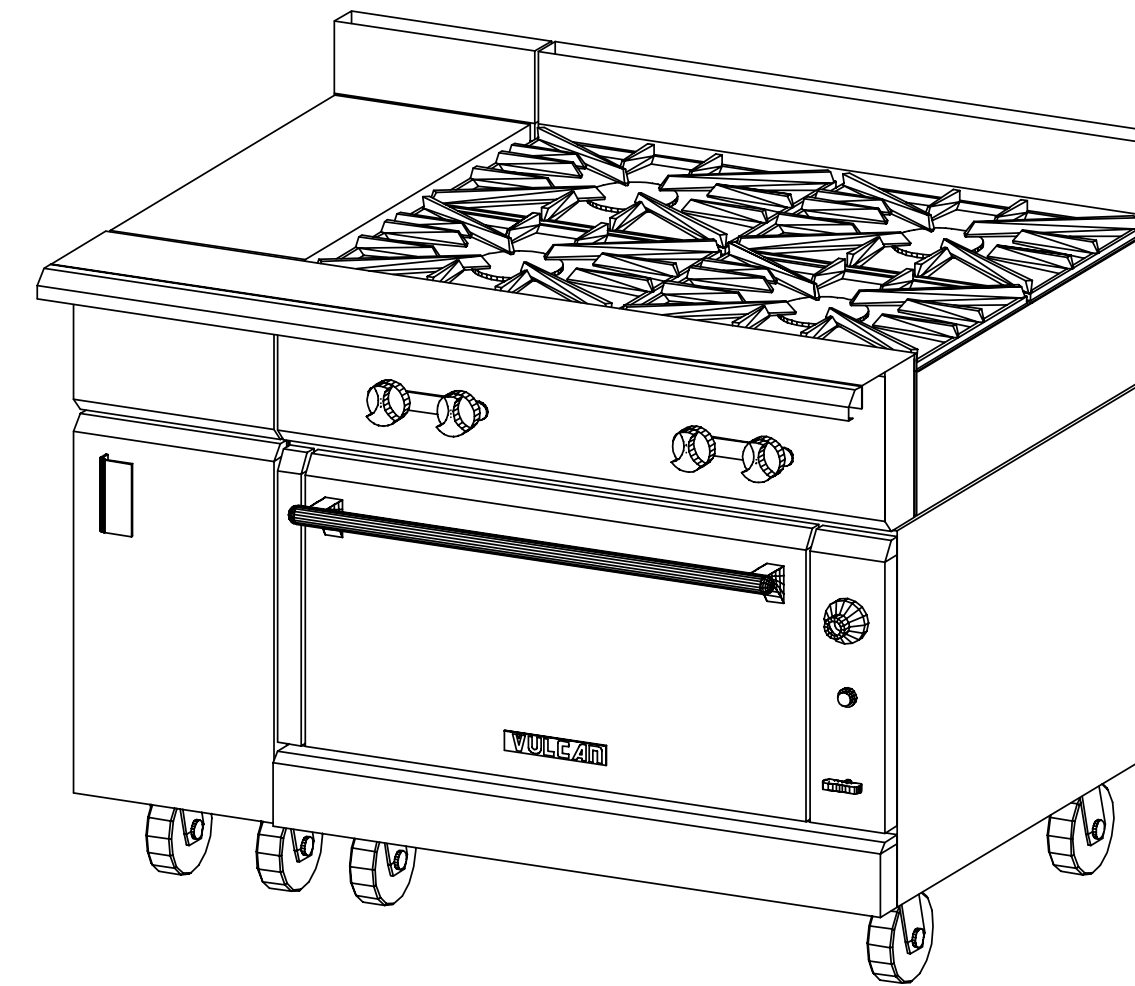









| | | | | |
|----|------|--------|----------|----------------------|
| 51 | 1 EA | VWT12B | SPREADER | |
| 🔥 | 0 | MBTU | | |
| 52 | 1 EA | V4B36S | RANGE | |
| 🔥 | 190 | MBTU | 1.25 | 32" AFF SINGLE POINT |



-  CONNECTION POINT
-  C COLD WATER
-  H HOT WATER
-  HC HOT + COLD WATER
-  D DRAIN
-  P POWER
-  S SWITCH
-  CS CORD SET
-  CO CONV OUTLET RECP
-  D DUPLEX RECEPTACLE
-  S SINGLE RECEPTACLE
-  G GAS
-  SS STEAM SUPPLY
-  SR STEAM RETURN
-  ST STEAM TAKE OFF
-  VE EXHAUST VENT
-  VS SUPPLY VENT
-  RF REFRIGERATION

PROJECT CODE
DSORD

Delta Sky Club
O'Hara ORD

| No. | Date | By | Revision |
|-----|------------|-----|-------------------------|
| 02 | 02/18/2021 | ddb | FORMAT |
| 04 | 07/18/2021 | ddb | RELOCATE GAS CONNECTION |
| | | | |
| | | | |
| | | | |

NEXT STEP DESIGN
913 WEST ST.
ANNAPOLIS, MD 21401

SCALE: AS NOTED
DATE: 03-18-2021
DRAWN BY: DDB
VH-DSORD