


PLAN VIEW

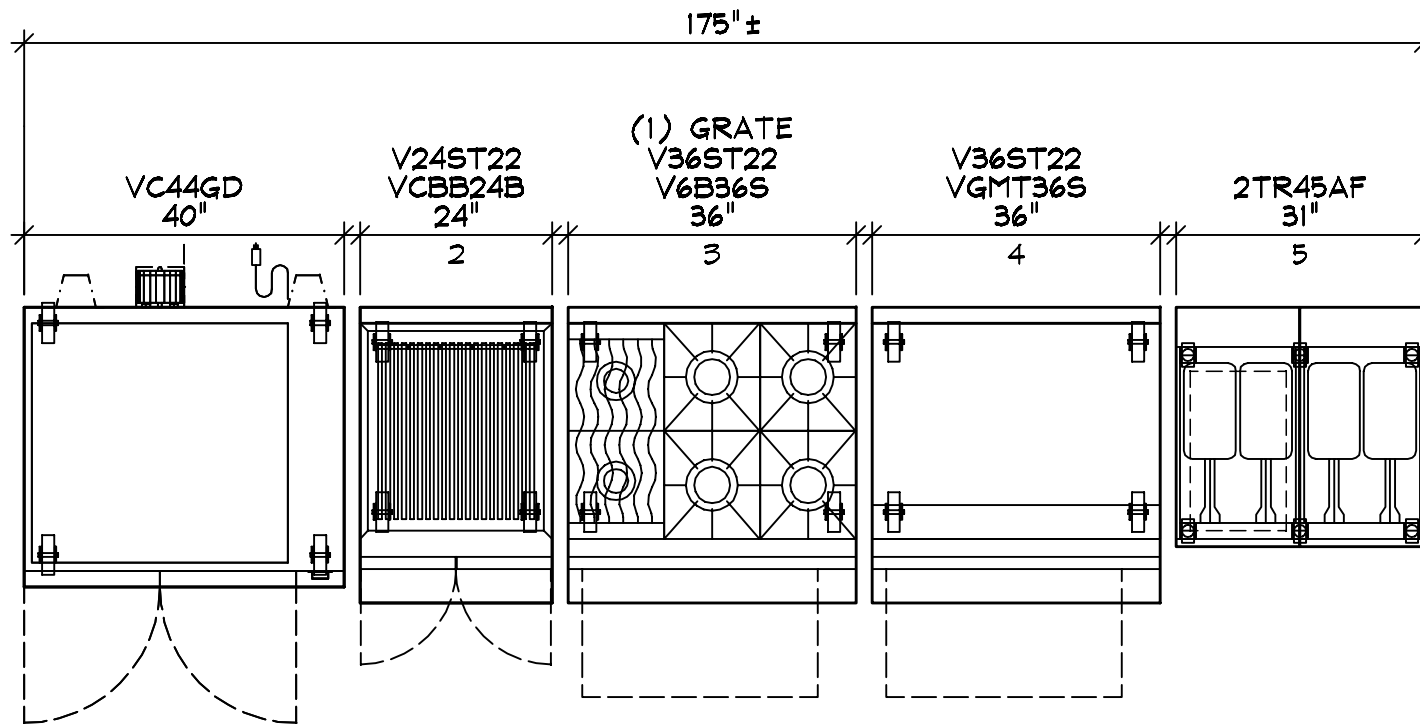

VH-EHSPT
COPYRIGHT (C) 2021


VULCAN

NILS AHLIN
EHSPT

EMERSON HOSPITAL - CONCORD

02-16-21

ELEVATION

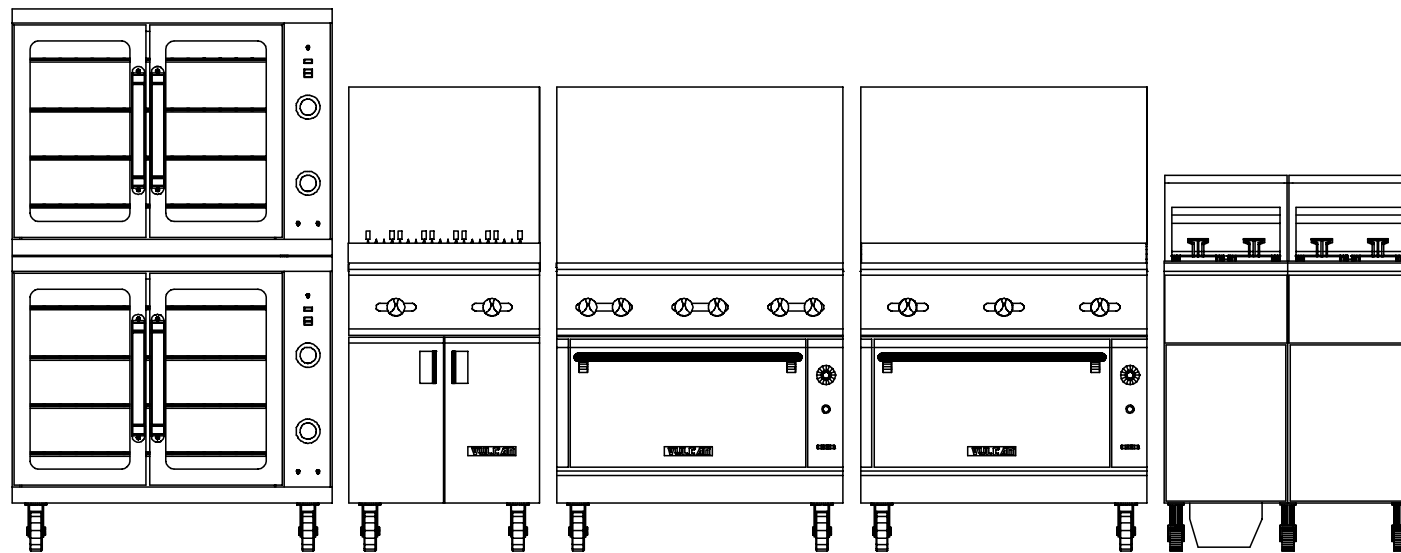

VH-EHSPT
COPYRIGHT (C) 2021


VULCAN

NILS AHLIN
EHSPT

EMERSON HOSPITAL - CONCORD

02-16-21

SEE VIEW

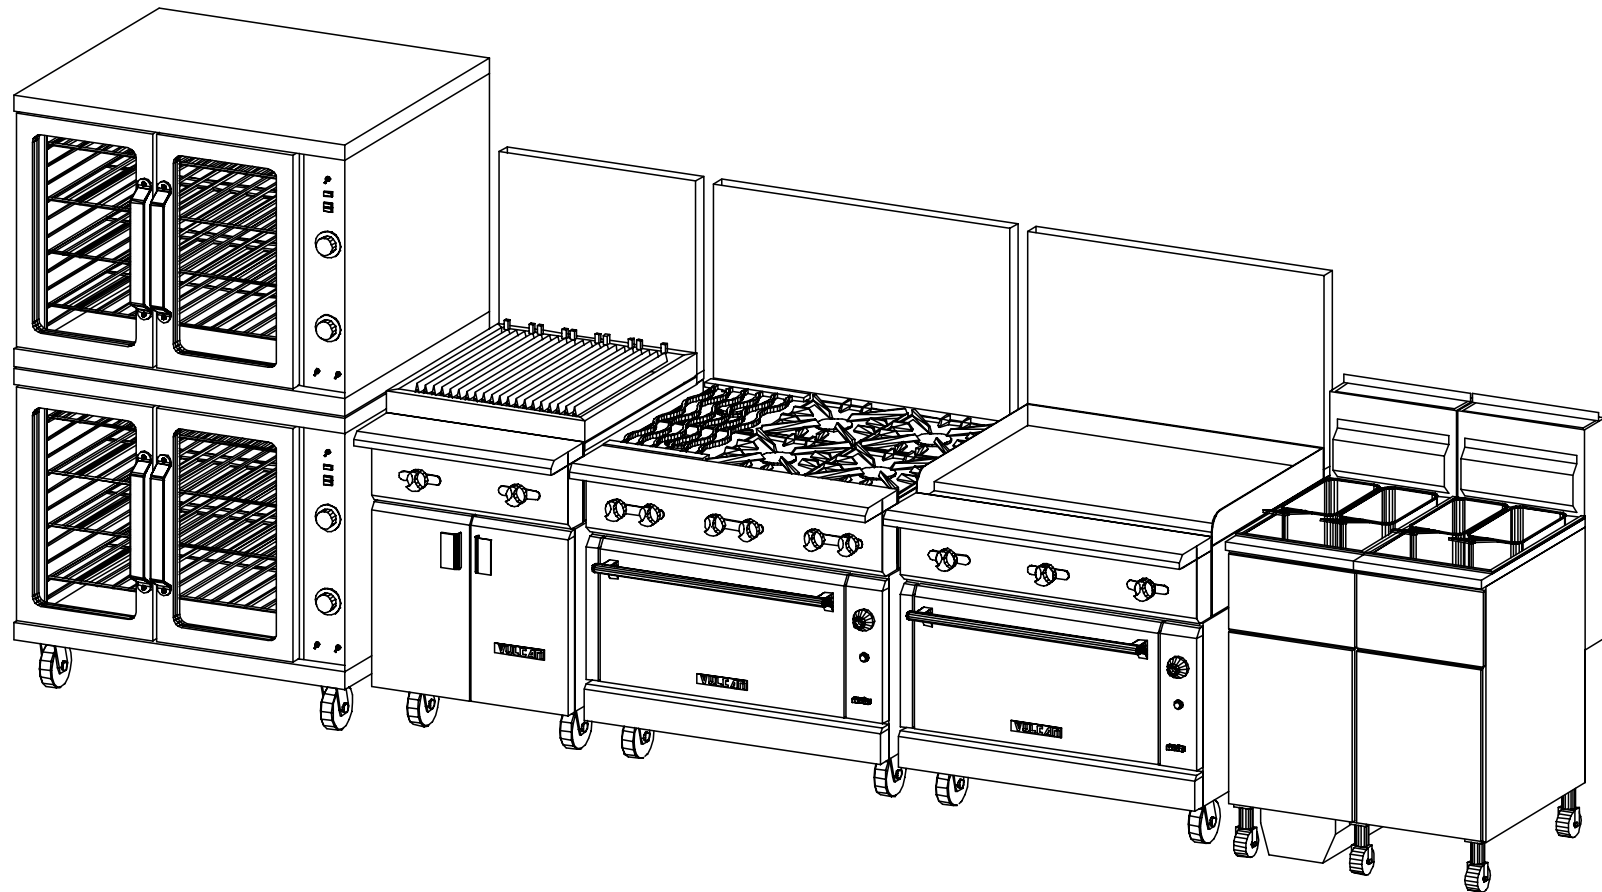

VH-EHSPT

COPYRIGHT (C) 2021


 **VULCAN**

NILS AHLIN
EHSPT

EMERSON HOSPITAL - CONCORD

02-16-21

SSW VIEW

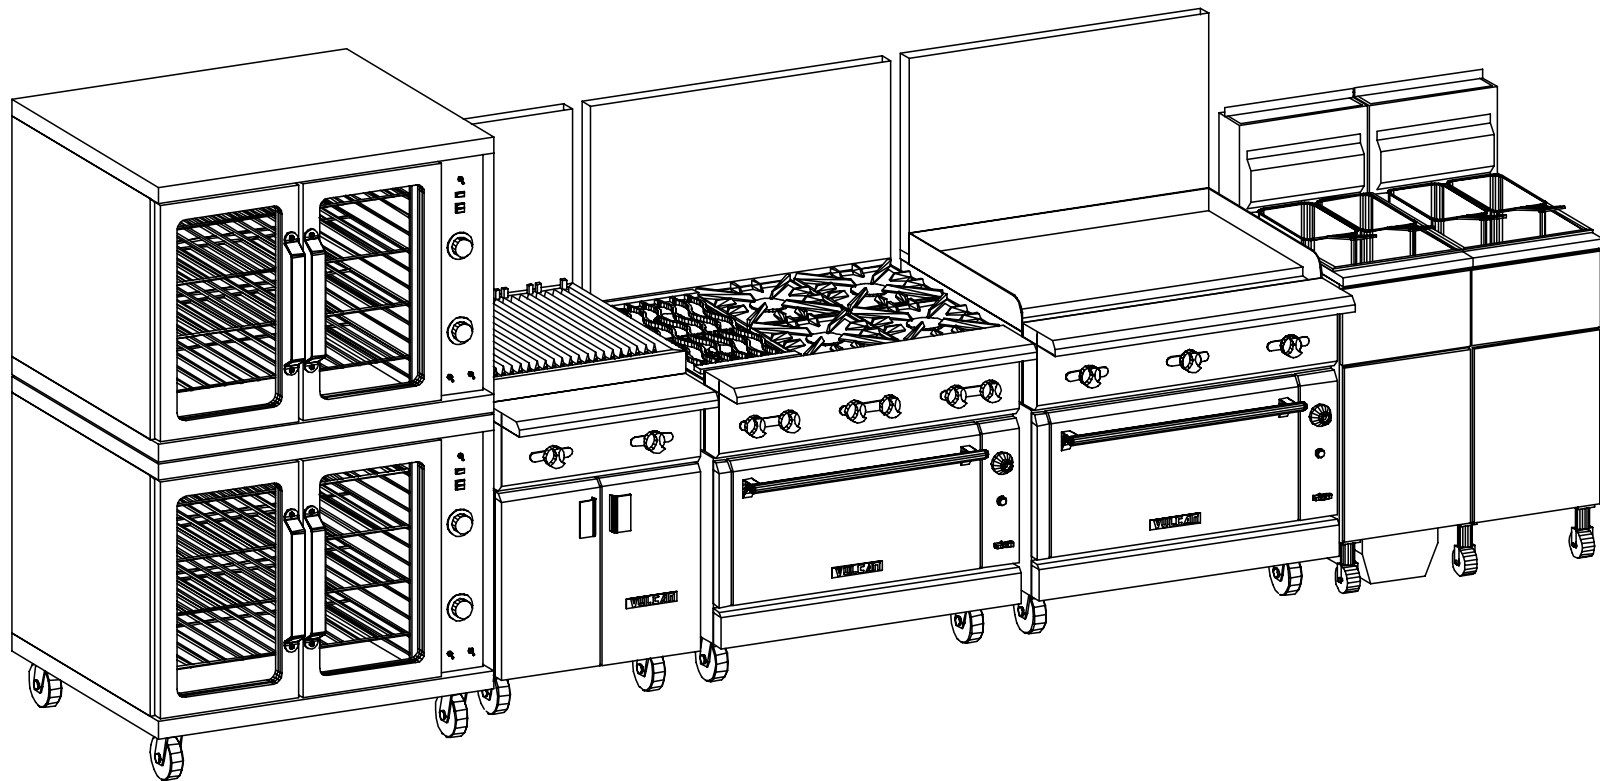

VH-EHSPT

COPYRIGHT (C) 2021

 **VULCAN**

NILS AHLIN
EHSPT

EMERSON HOSPITAL - CONCORD

02-16-21

GENERAL NOTES - PLEASE READ**VENTILATION:**

ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:

ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:

ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:



















EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (14" W.C.)

BY OTHERS:

VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:

IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURER RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

| | |
|---|------------------|
|  | CONNECTION POINT |
|  | COLD WATER |
|  | HOT WATER |
|  | HOT + COLD WATER |
|  | DRAIN |
|  | POWER |
|  | SWITCH |
|  | CORD SET |
|  | CONV OUTLET RECP |
|  | DUPLEX RECPTACLE |
|  | SINGLE RECPTACLE |
|  | GAS |
|  | STEAM SUPPLY |
|  | STEAM RETURN |
|  | STEAM TAKE OFF |
|  | EXHAUST VENT |
|  | SUPPLY VENT |
|  | REFRIGERATION |

02-16-2021

02-16-2021 : 06:47:54a

Nils Ahlin
DAVE SWAIN ASSOCIATES, INC.
6 Lyberty Way
Westford, MA 01866
v. 800-222-5628 x 304

Email: nils@swainrep.com

PROJECT CODE

EHSPT