


VH-FISH5 COPYRIGHT (C) 2021



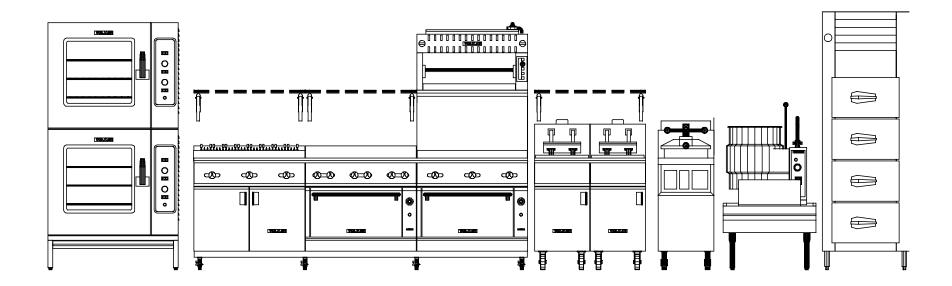


VH-FISH5

COPYRIGHT (C) 2021



SSE VIEW

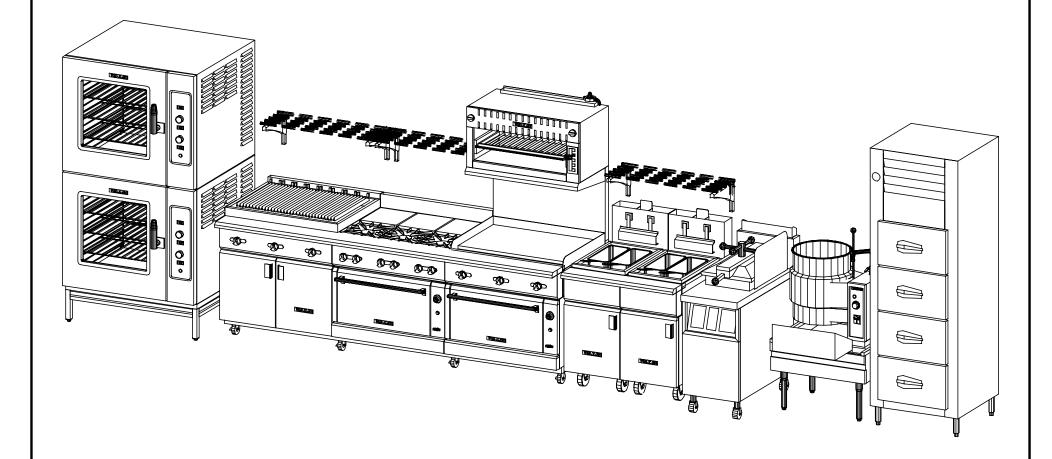

VH-FISH5

COPYRIGHT (C) 2021



ROXANNE HOLT FISH5 SSW VIEW

VH-FISH5 COPYRIGHT (C) 2021

VULCAN

ROXANNE HOLT FISH5

GENERAL NOTES - PLEASE READ

VENTILATION:

ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRIESSION:

ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:

ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:

EXTERNAL GAS REGULATORS. FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (I4" W.C.)

BY OTHERS:

VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE

IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURES RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

(SS) STEAM SUPPLY

(A) GAS

(CR) STEAM RETURN

CONNECTION POINT

(C) COLD WATER

(H) HOT WATER

WATER

(D) DRAIN

(f) POWER

<\$> SWITCH

d CORD SET

(C≠ CONV OUTLET RECP

□ DUPLEX RECPTACLE

SINGLE RECPTACLE

HOT + COLD

(ST) STEAM TAKE OFF

VE EXHAUST VENT

VS SUPPLY VENT

(RF) REFRIGERATION

0|-|4-202|

01-14-2021 : 01:49:32p

0|-15-202| : ||:03:5|a

0|-15-202| : ||:05:36a

01-16-2021 : 01:13:53p

01-20-2021 : 12:32:20p

01-20-2021 : 12:35:14p

Roxanne Holt VULCAN HART COMPANY 3600 North Point Blyd Baltimore, MD 21222 v. 410-282-4322

PROJECT CODE

FISHB

Email:roxanne.holt@vulcanhart.com

VH-FISH5

COPYRIGHT (C) 2021



ROXANNE HOLT FISH5

HOT POT - 5 01-20-21