

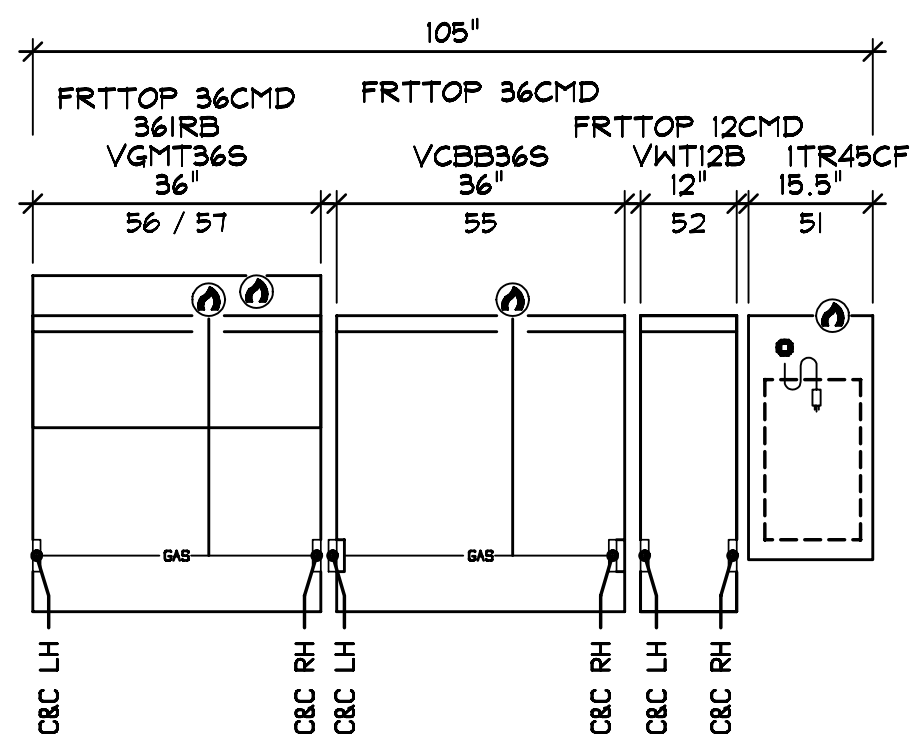
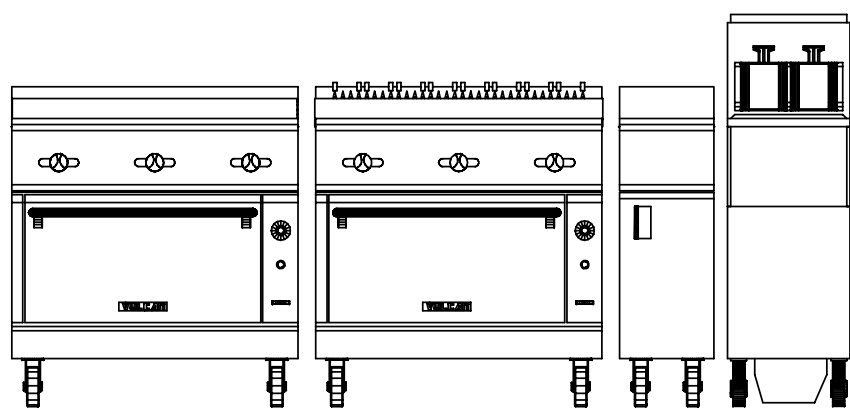

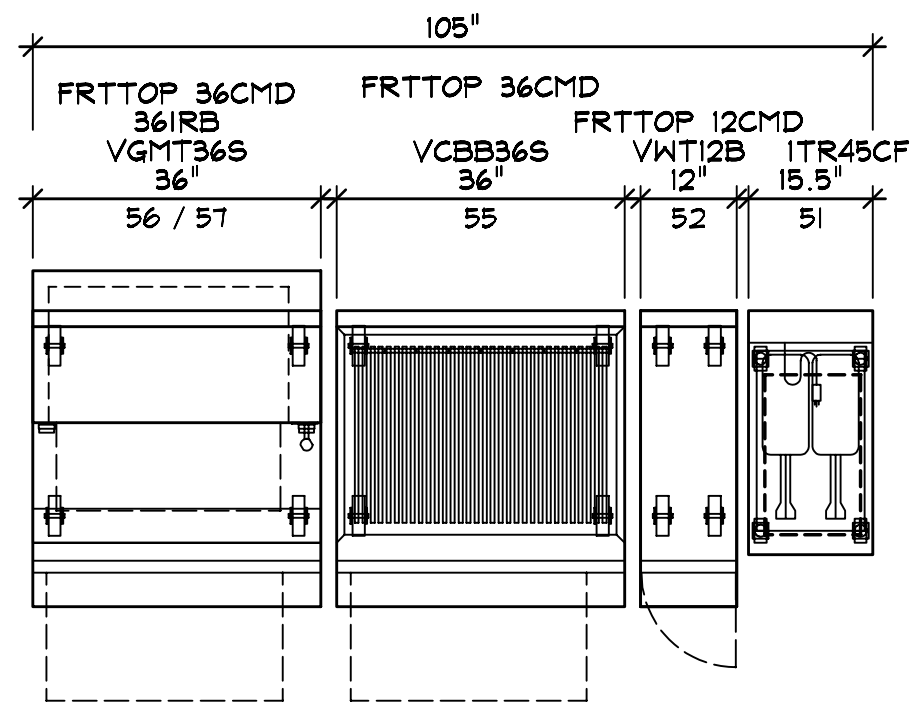
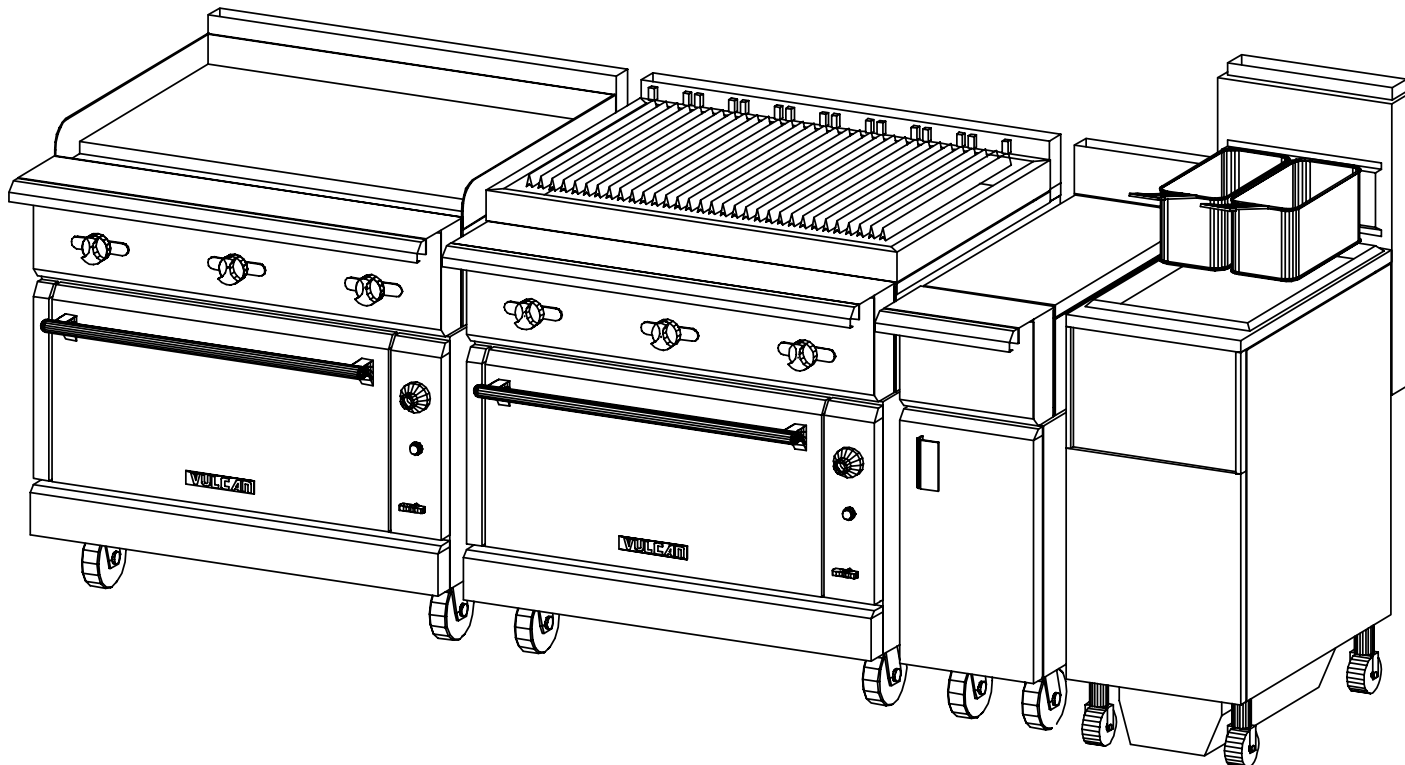
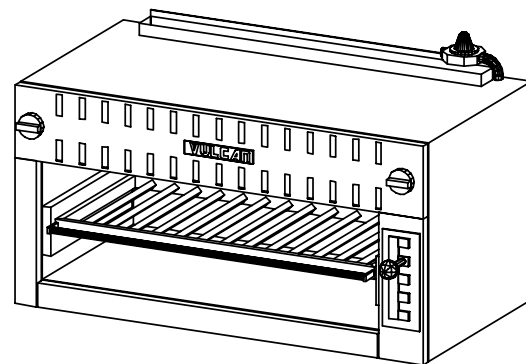


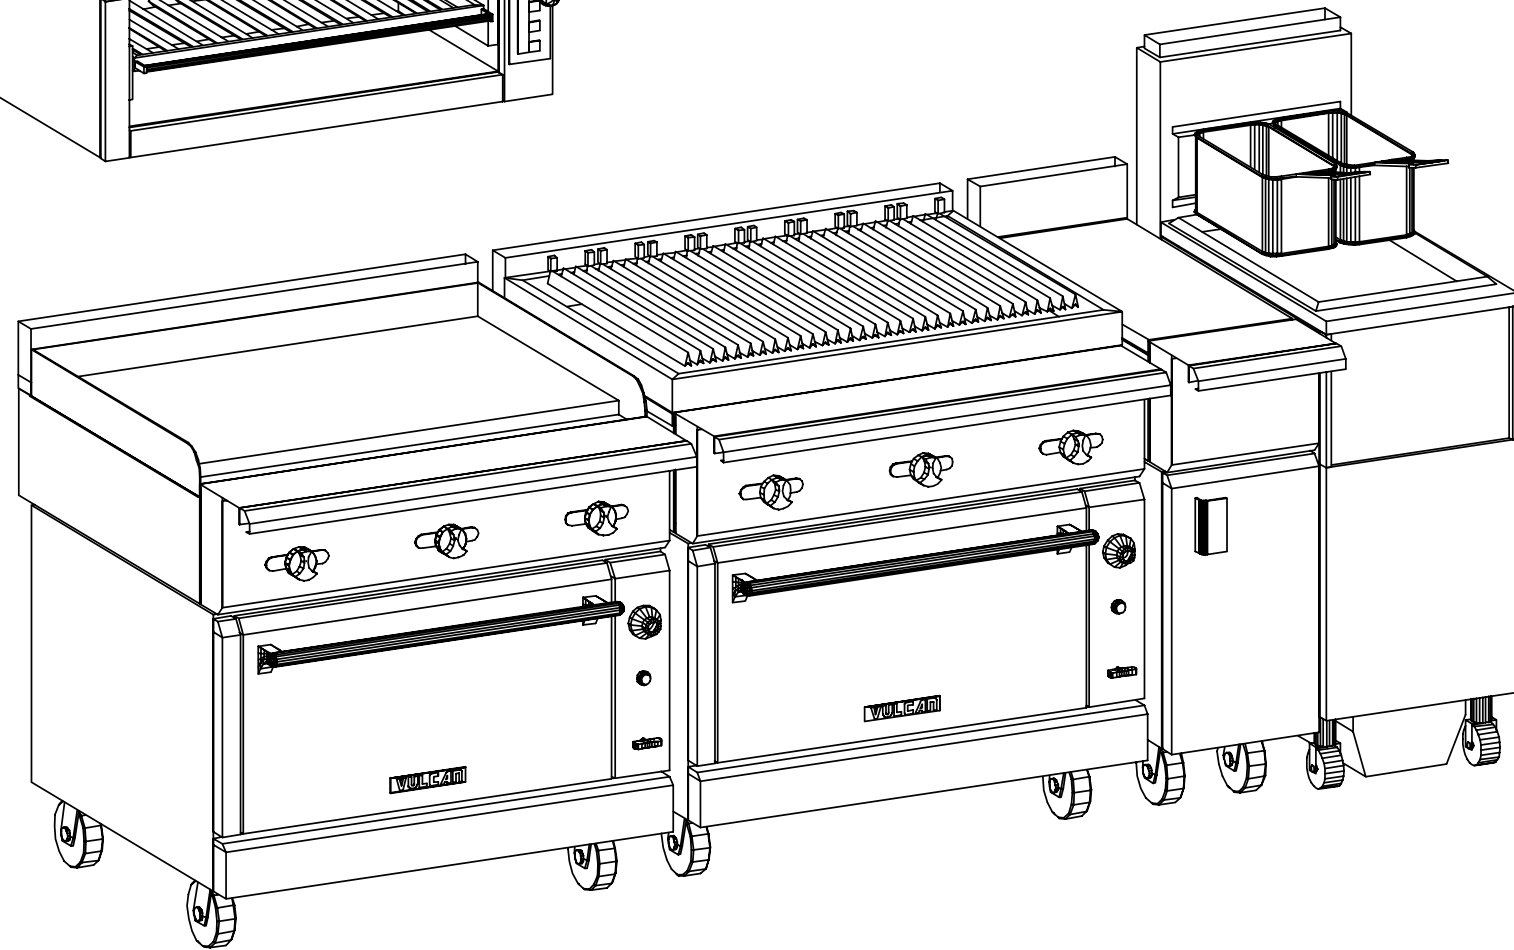

51	1 EA	1TR45CF	FRYER
⌚	120 (1)	6.0A	5-15
⌚	70 MBTU	0.75	12 AFF
52	1 EA	VWT12B	SPREADER
55	1 EA	VCB36S	CHARBROILER
⌚	149 MBTU	1.25	32 AFF
56	1 EA	VGMT36S	RANGE
⌚	140 MBTU	1.25	32 AFF
57	1 EA	36IRB	SALAMANDER
⌚	30 MBTU	0.75	78 AFF

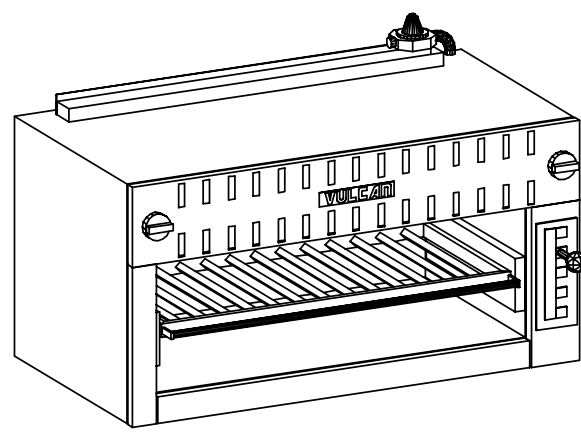

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURERS RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

⬮	CONNECTION POINT
⬮	COLD WATER
⬮	HOT WATER
⬮	HOT + COLD WATER
⬮	DRAIN
⬮	POWER
⬮	SWITCH
⬮	CORD SET
⬮	CONV. OUTLET RECP
⬮	DUPLEX RECP/TACLE
⬮	SINGLE RECP/TACLE
⬮	GAS
⬮	STEAM SUPPLY
⬮	STEAM RETURN
⬮	STEAM TAKE OFF
⬮	EXHAUST VENT
⬮	SUPPLY VENT
⬮	REFRIGERATION

08-19-2021

PROJECT CODE
GAMM7

NEXT STEP DESIGN

913 WEST ST.
ANNAPOLIS, MD 21401

SCALE:
VH-GAMM7
DATE: AS NOTED
DRAWN BY: DDB

1

OF

VULCAN

THE VULCAN HART COMPANY
BALTIMORE, MARYLAND
410-284-0660

GAMMA

LINE #7

08/19/2021

REVISIONS

Revision

REPLACE GAMMS

By

ddb

Date

8/19/2021

No.

1