
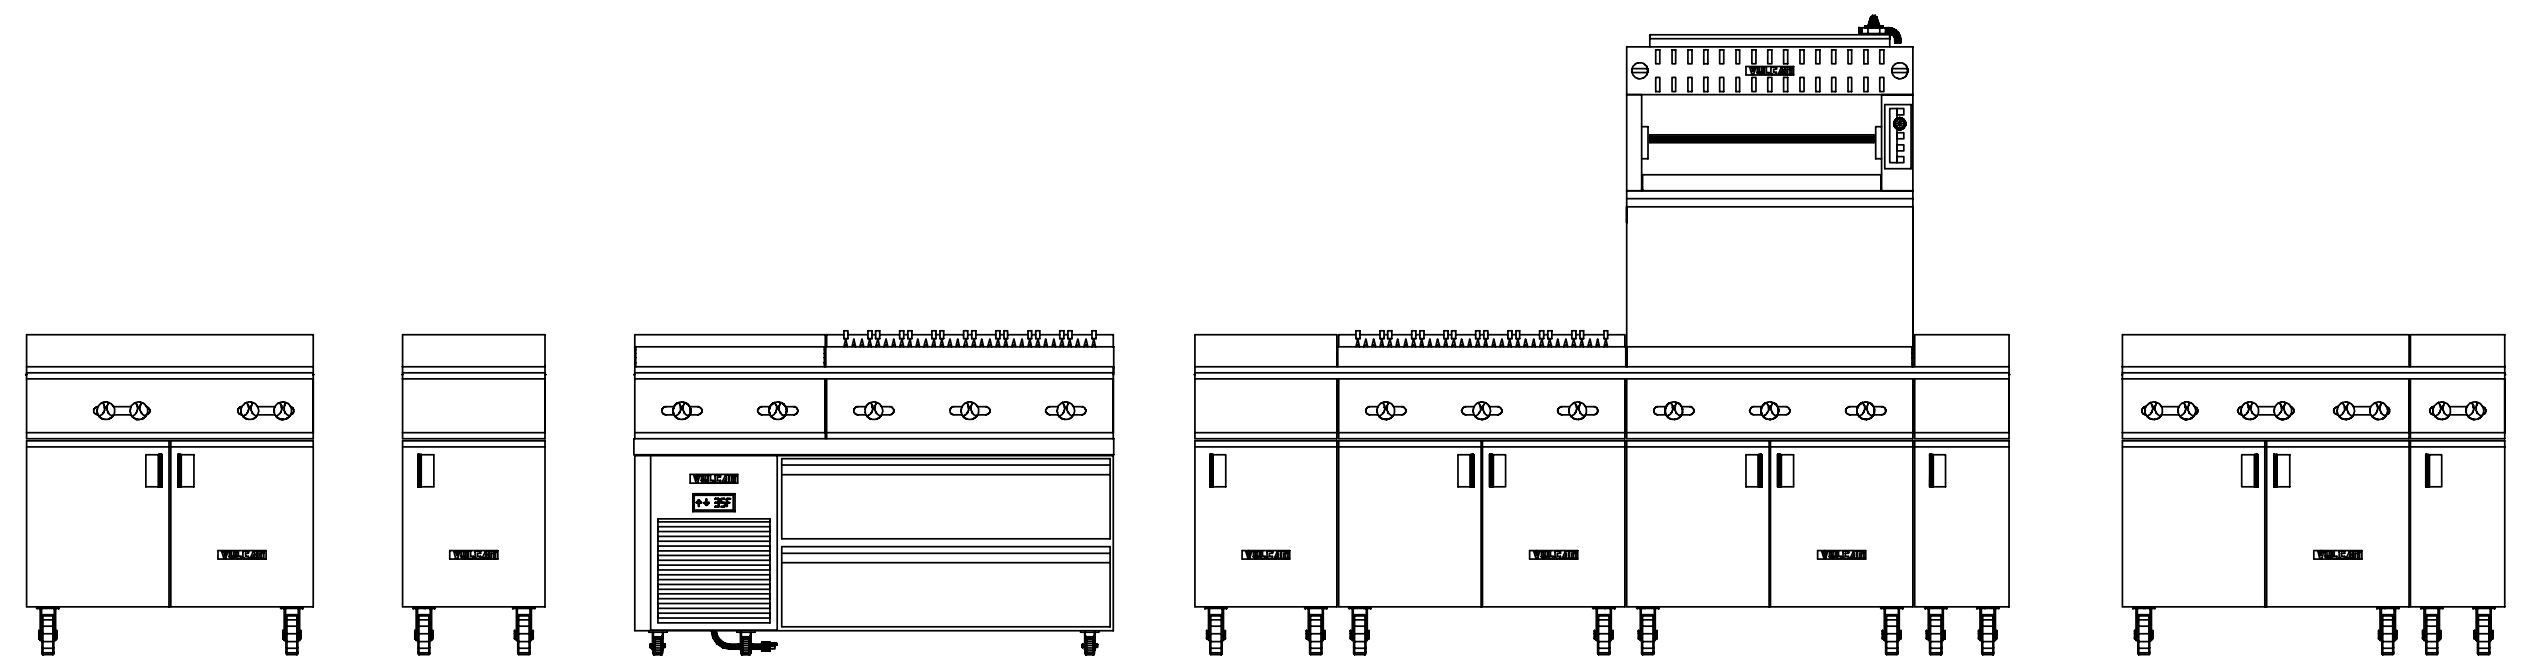


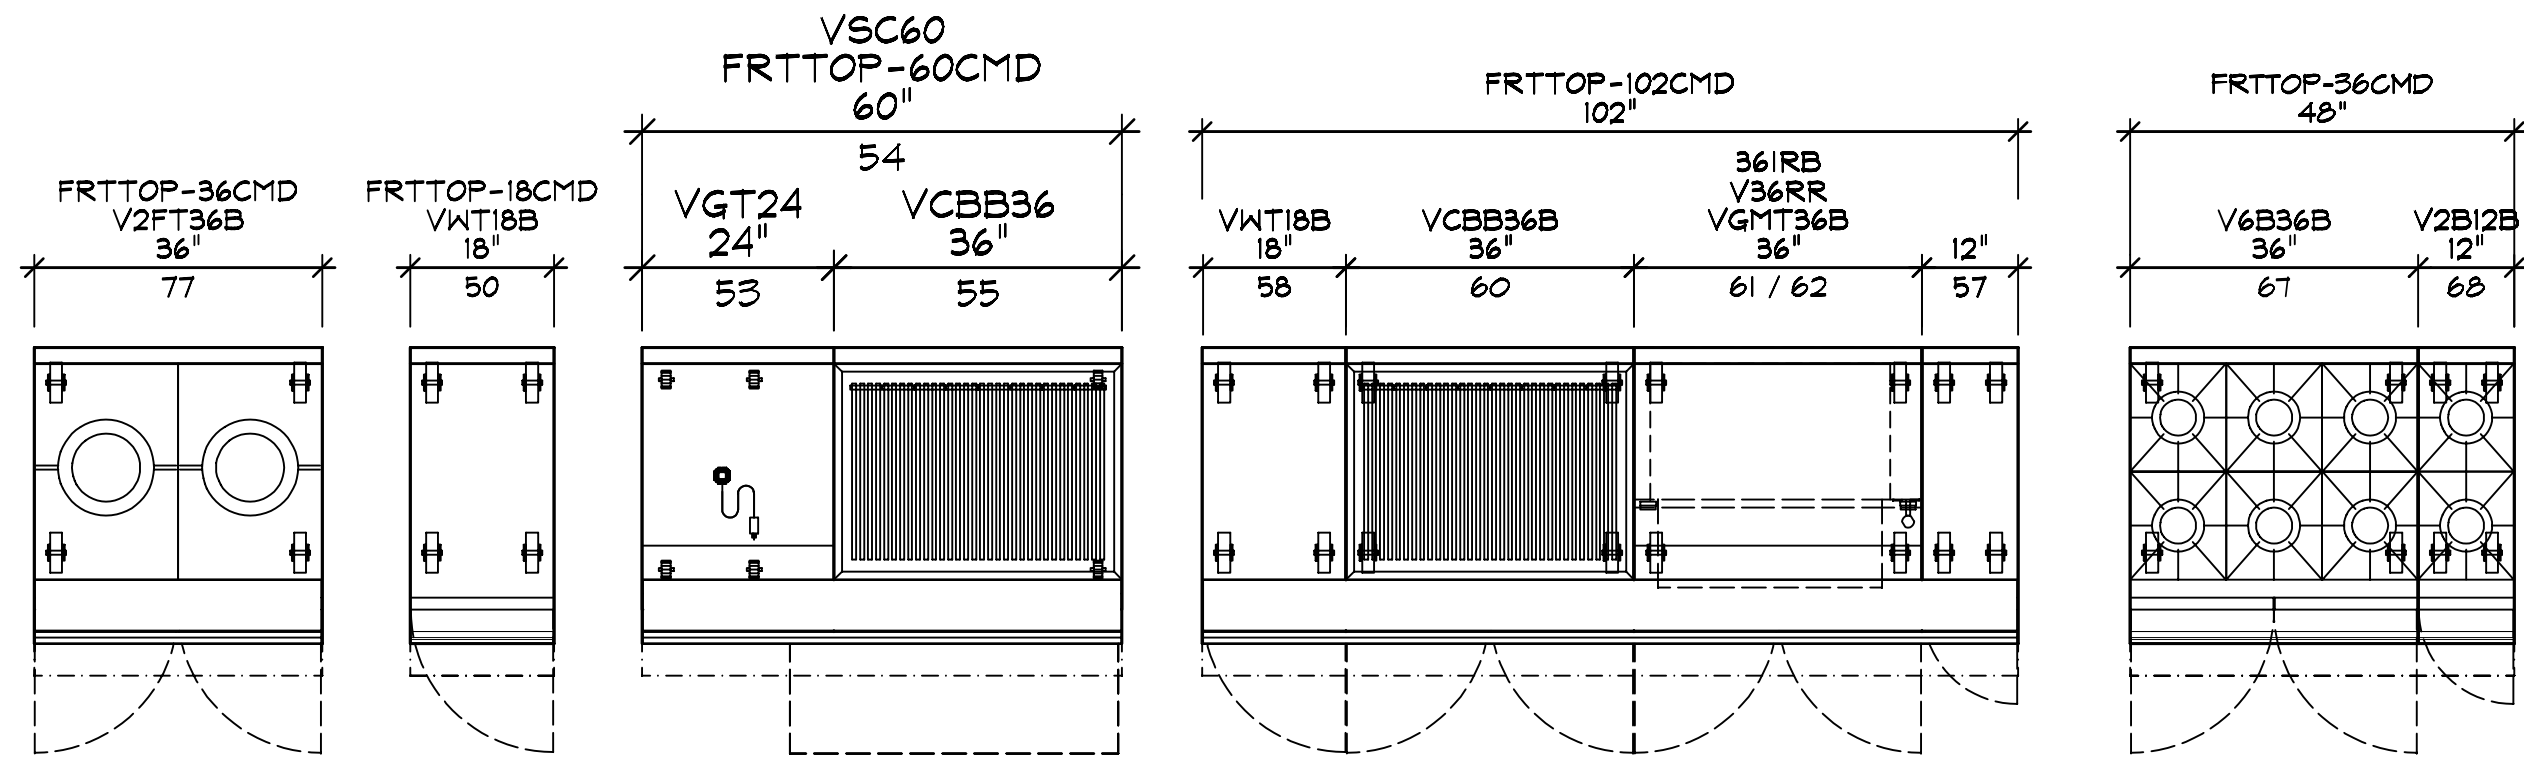


GAS CONNECTION #1
LOCATED IN ITEM: 77
PIPE SIZE: 1.25 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 50 MBTU
INCLUDES ITEMS: 77
NOTE:



GAS CONNECTION #2
LOCATED IN ITEM: 53
PIPE SIZE: 1.25 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 159 MBTU
INCLUDES ITEMS: 53 53
NOTE:

GAS CONNECTION #3
LOCATED IN ITEM: 62
PIPE SIZE: 1.25 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 170 MBTU
INCLUDES ITEMS: 62 61 60
NOTE:

GAS CONNECTION #4
LOCATED IN ITEM: 67
PIPE SIZE: 1.25 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 330 MBTU
INCLUDES ITEMS: 68 67
NOTE:

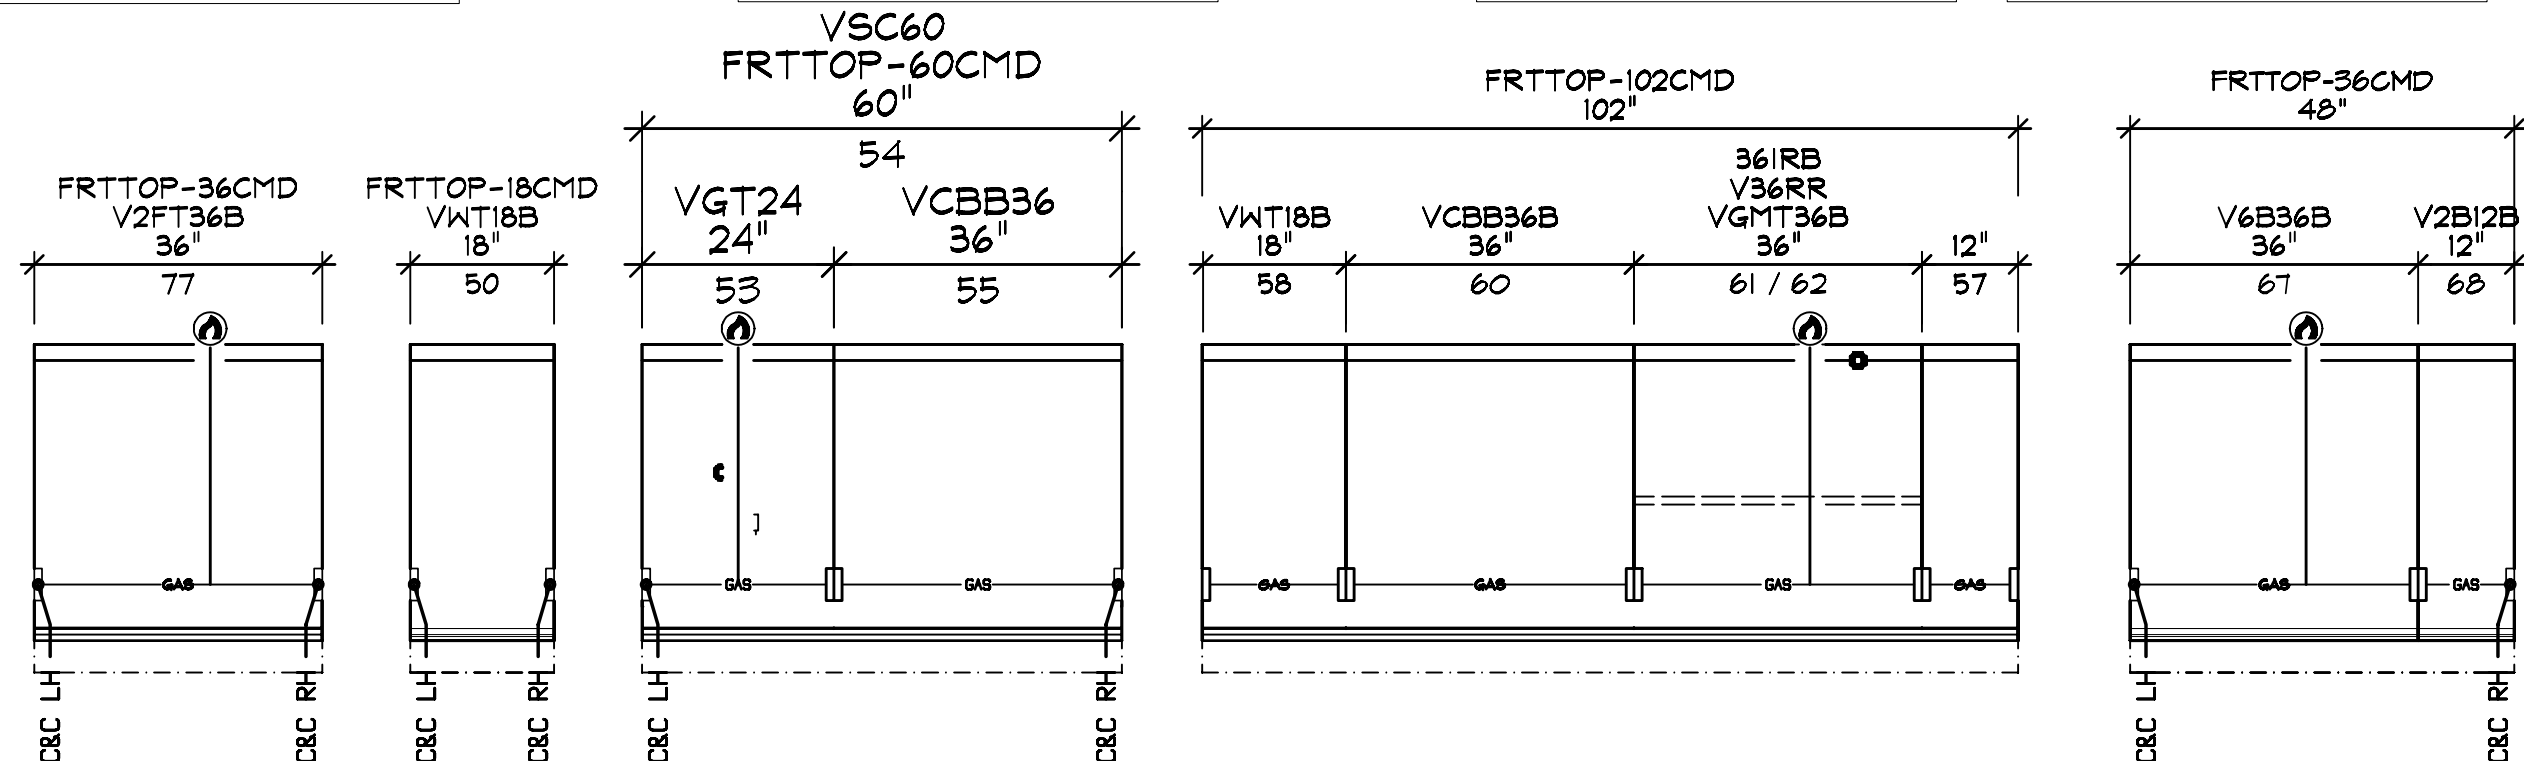

748 MBTU
TOTAL LOAD

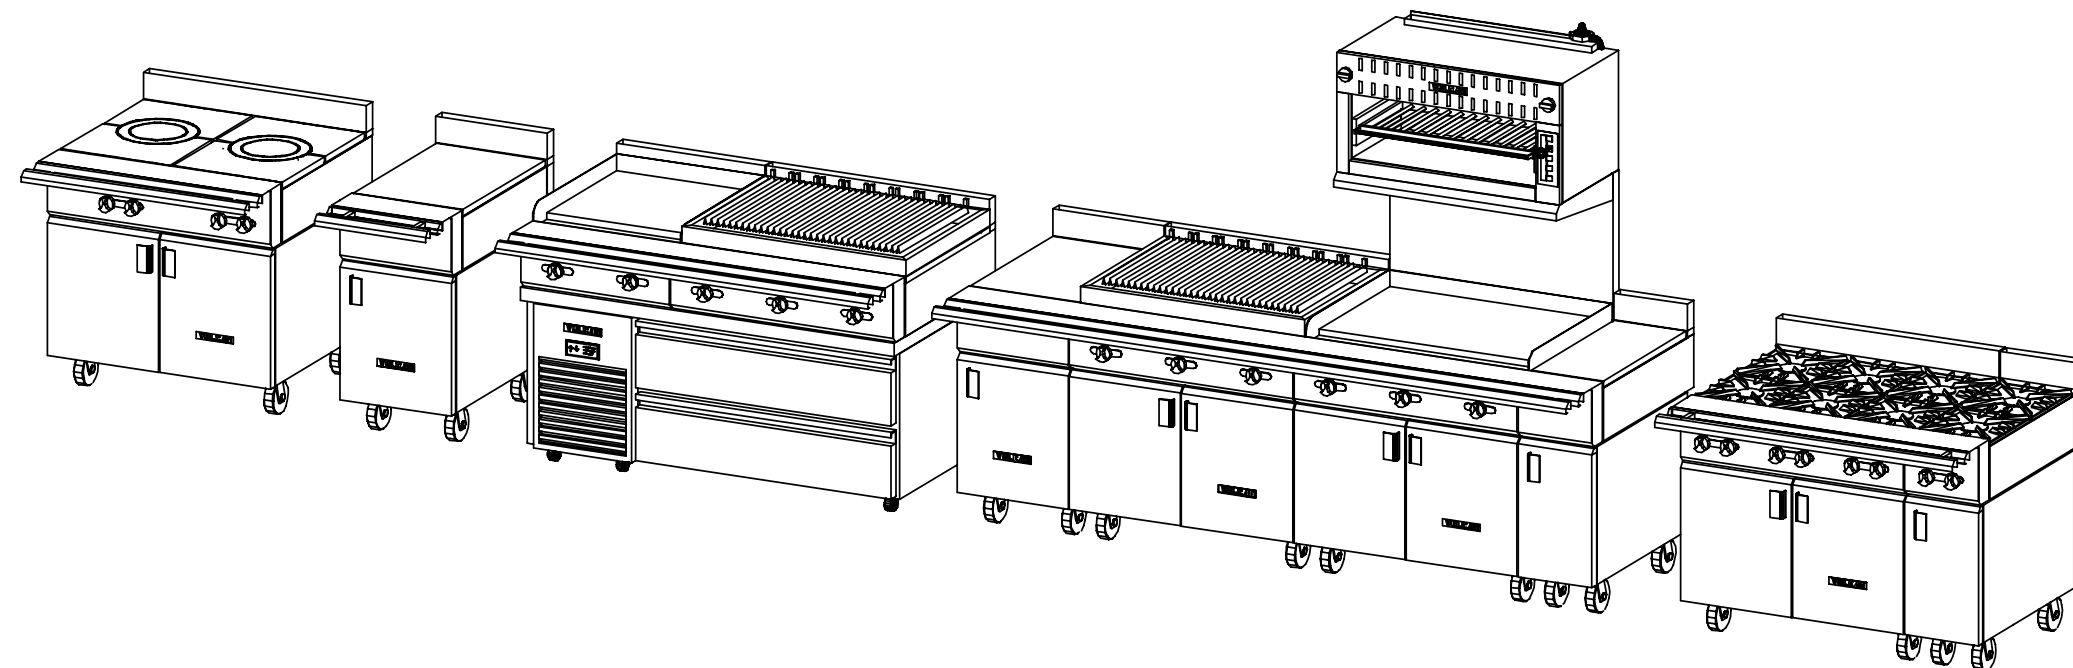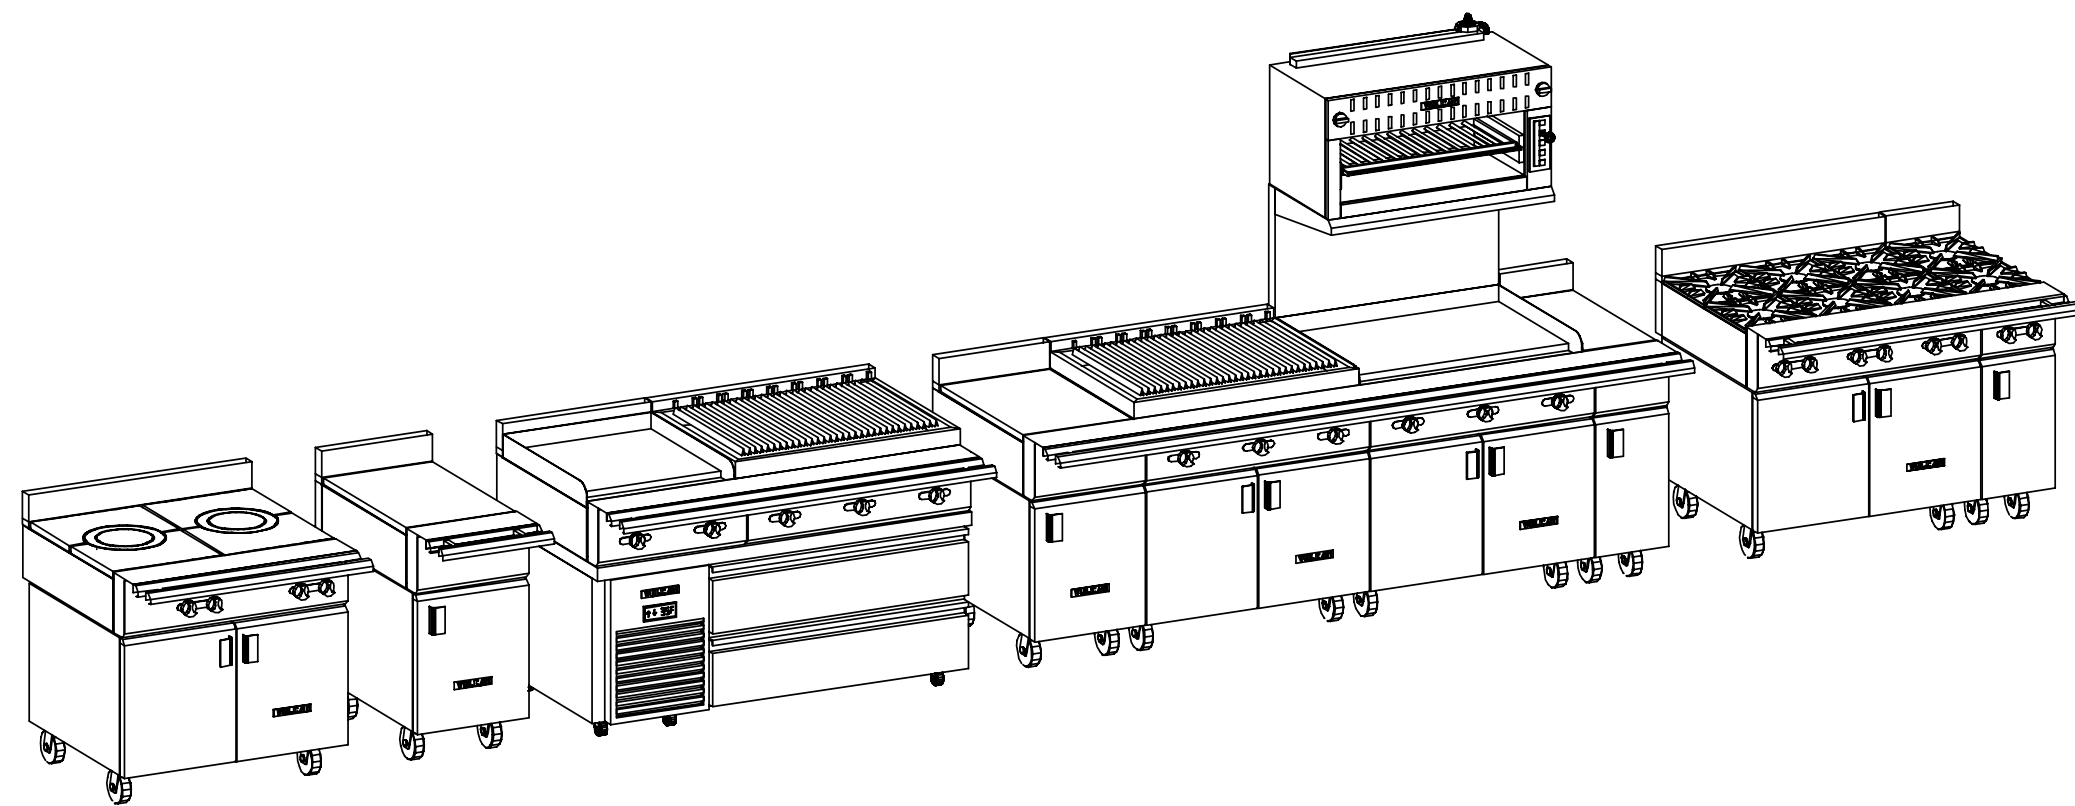

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURER RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

Symbol	Description
●	CONNECTION POINT
○	COLD WATER
△	HOT WATER
⬆	HOT + COLD WATER
⬇	DRAIN
⚡	POWER
⚡	SWITCH
⚡	CORD SET
Ⓢ	CONV OUTLET RECP
Ⓢ	DUPLEX RECP
Ⓢ	SINGLE RECP
Ⓢ	GAS
Ⓢ	STEAM SUPPLY
Ⓢ	STEAM RETURN
Ⓢ	STEAM TAKE OFF
Ⓢ	EXHAUST VENT
Ⓢ	SUPPLY VENT
Ⓢ	REFRIGERATION

06-10-2020
09-01-2020 : 12:59:49p
09-02-2020 : 12:11:50p

PROJECT CODE
GBORO

53	1 EA	VGT24	RANGE
30	MBTU	1.25	32 AFF
54	1 EA	VSC60	REFRIGERATED BASE
120	(1)	6.7	5-15
55	1 EA	VCB36	CHARBROILER
99	MBTU	1.25	MANIFOLD
57	1 EA	VWT12B	SPREADER
58	1 EA	VWT18B	SPREADER
60	1 EA	VCB36B	CHAR BROILER
99	MBTU	1.25	32 AFF
61	1 EA	36RB	SALAMANDER WALL MOUNT
50	MBTU	0.75	78 AFF INTERPLUMB
62	1 EA	VGMT36B	RANGE
90	MBTU	1.25	32 AFF
67	1 EA	V6B36S	RANGE
260	MBTU	1.25	32 AFF
68	1 EA	V2B12B	RANGE
70	MBTU	1.25	MANIFOLD
77	1 EA	V2FT36B	RANGE
50	MBTU	0.75	32 AFF

VULCAN
THE VULCAN HART COMPANY
BALTIMORE, MARYLAND
410-284-0660

GREENSBORO COUNTRY CLUB
JAKE RITCHIE
06-10-20
VH-GBORO

Revisions	By	Date	Revision
MULTIPLE REVISIONS			
ITEM 50		04 6/16/20	ddb
SHOW ALL EXTENDED FRONT RAILS		05 9/1/20	ddb
PER NEW QUOTE		08 9/2/20	ddb
		09 9/23/21	ddb

NEXT STEP DESIGN
913 WEST ST.
ANNAPOLIS, MD 21401

SCALE: 1:24
DATE: 06-10-2020
DRAWN BY: DDB
VH-GBORO