


GAS CONNECTION #1  
LOCATED IN ITEM: 591  
PIPE SIZE: 1.25 NPT  
CP HEIGHT: 32" AFF  
TOTAL GAS LOAD: 117 MBTU  
INCLUDES ITEMS: 595 592 591  
NOTE:

587	1 EA	VWT12B	SPREADER	
589	1 EA	VICM24	SALAMANDER	78 AFF
590	1 EA	VSC72	REFRIGERATED BASE	
591	1 EA	VGT24	RANGE	
592	1 EA	VCBB24	CHARBOILER	
595	1 EA	VGT24	RANGE	
596	1 EA	VWT12B	SPREADER	

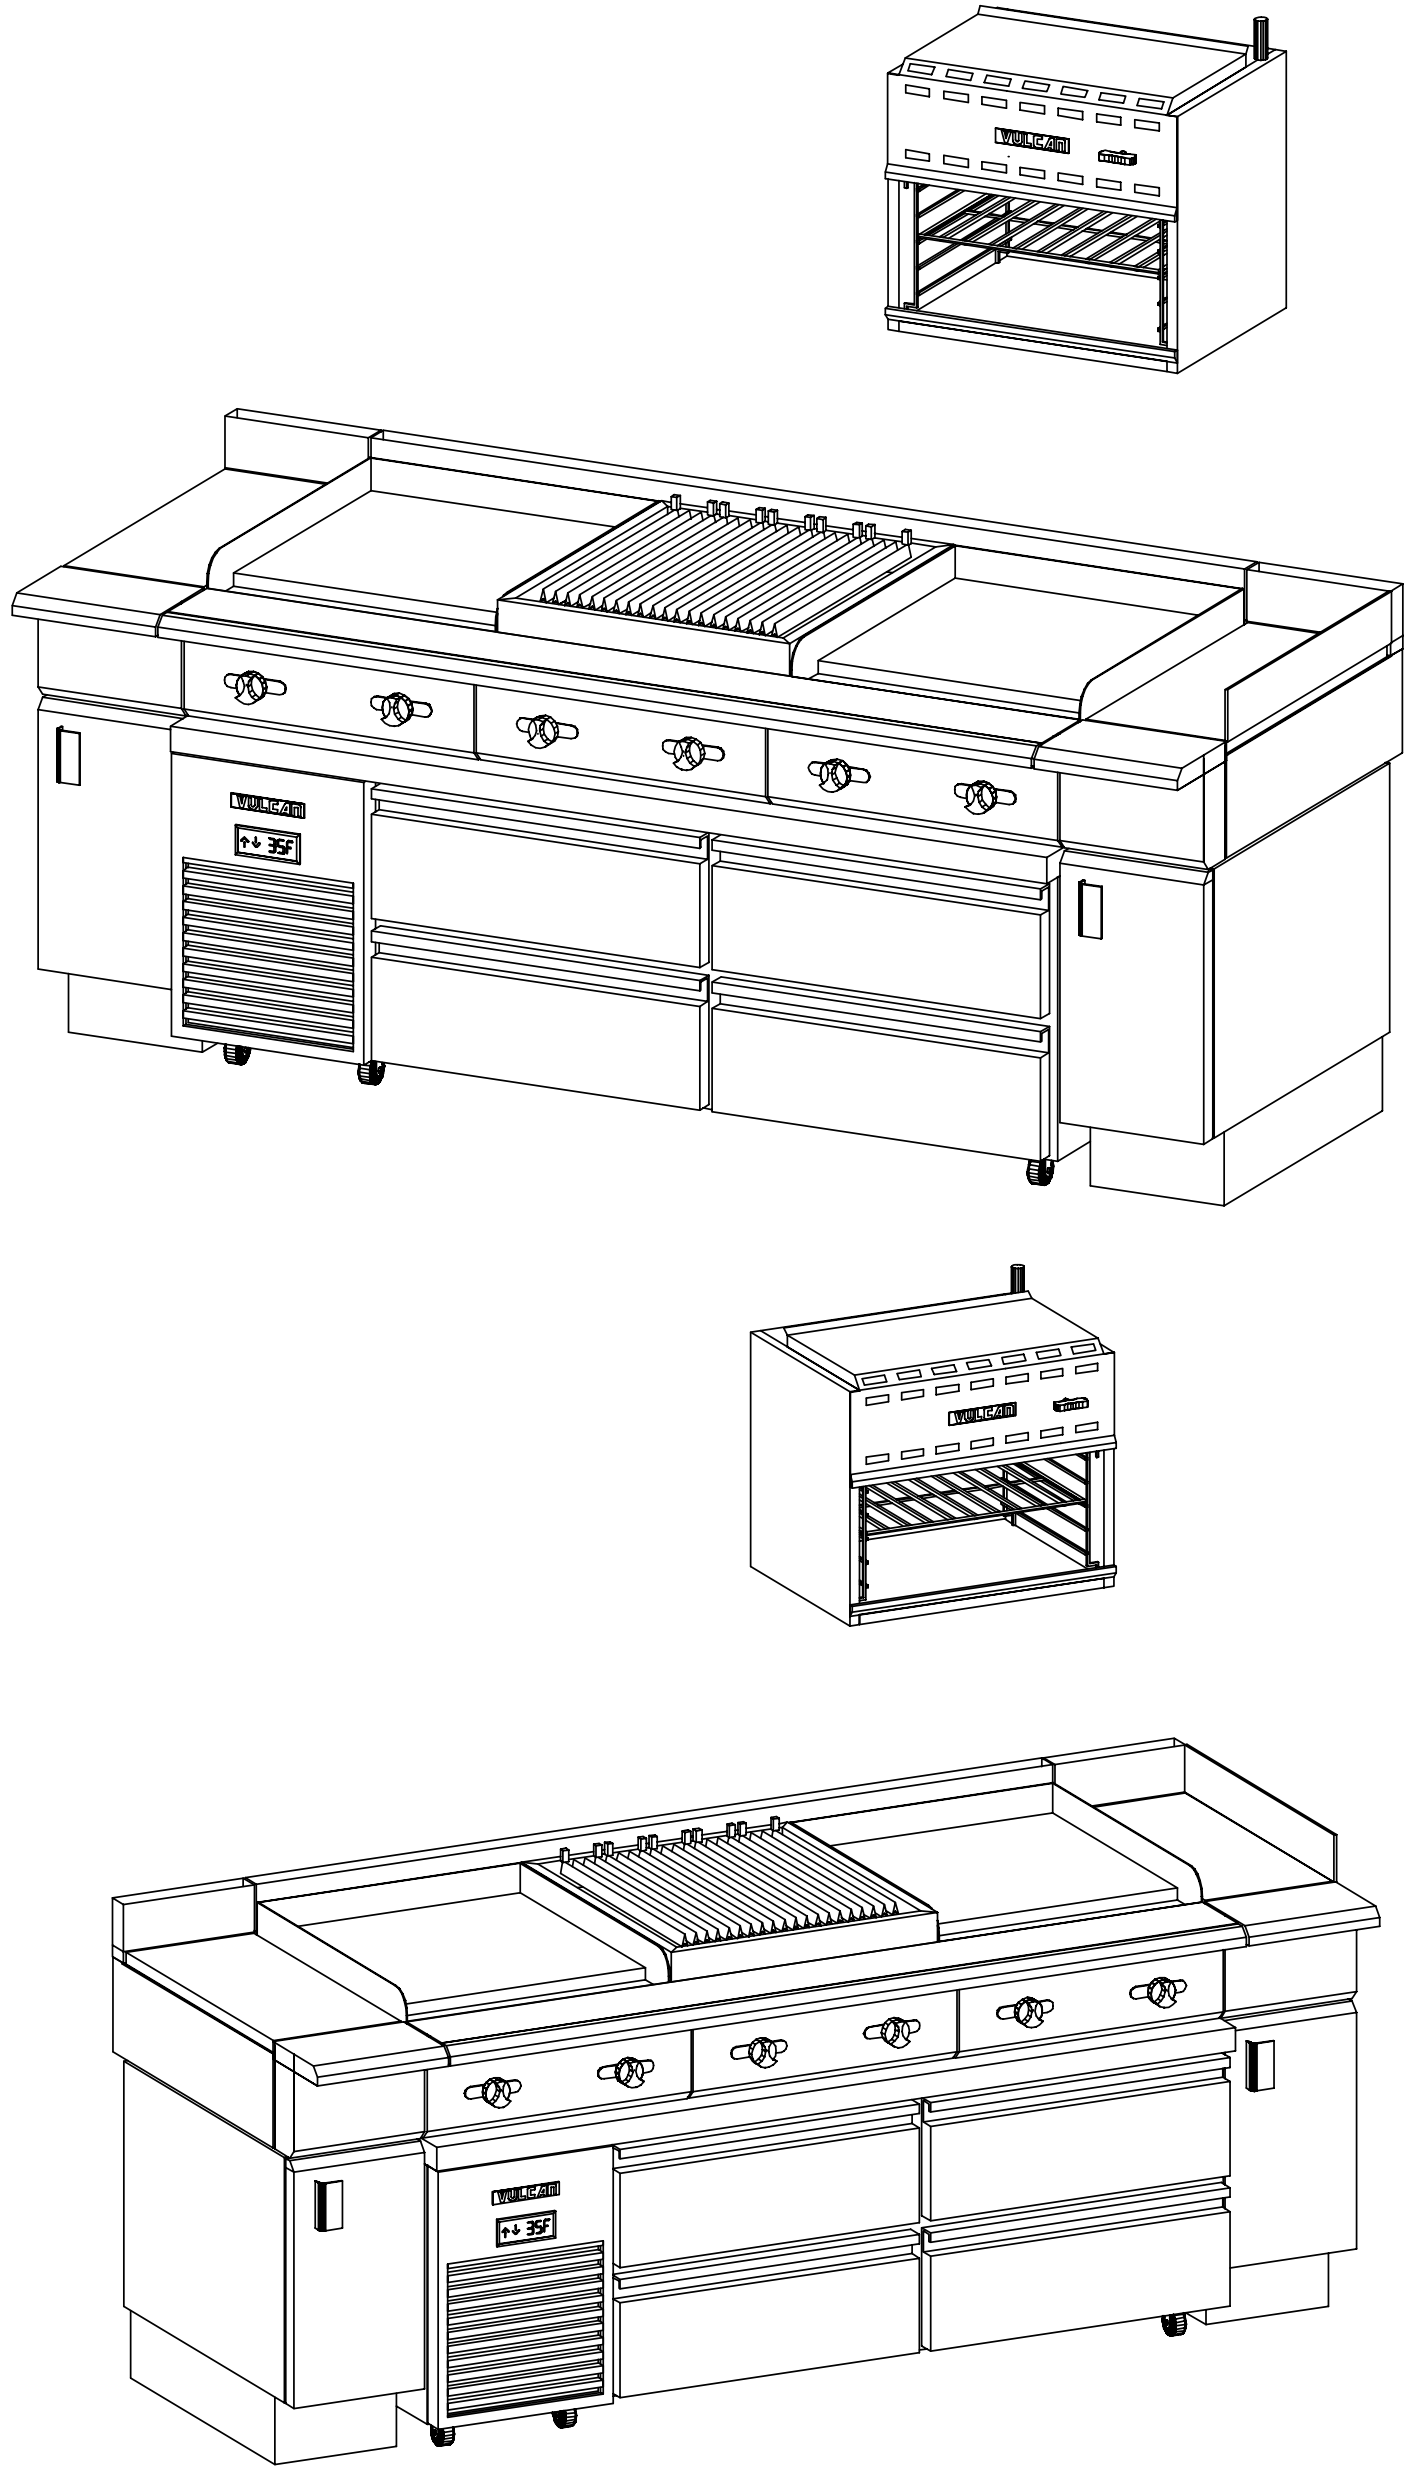

#### GENERAL NOTES - PLEASE READ

VENTILATION:  
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:  
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:  
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:  
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:  
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:  
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURERS RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

CONNECTION POINT
COLD WATER
HOT WATER
HOT + COLD WATER
DRAIN
POWER
SWITCH
CORD SET
CONV. OUTLET RECP
DUPLEX RECP/TABLE
SINGLE RECP/TABLE
GAS
STEAM SUPPLY
STEAM RETURN
STEAM TAKE OFF
EXHAUST VENT
SUPPLY VENT
REFRIGERATION

12-07-2020  
01-20-2021 : 06:44:35a

PROJECT CODE  
HBLV3

**VULCAN**  
THE VULCAN HART COMPANY  
BALTIMORE, MARYLAND  
410-284-0660

Hudson Blvd  
Line 587-596

No.	Date	By	Revision
02	12/07/20	ddb	NEW LAYOUT
03	1/5/21	ddb	STUB BACKS
04	1/20/21	ddb	ITEMS 587, 596
05	10/05/2021	ddb	SUBMITTAL

**NEXT STEP DESIGN**  
**913 WEST ST.**  
**ANNAPOLIS, MD 21401**

SCALE:  
AS NOTED  
DATE: 12-07-2020  
DRAWN BY: DDB  
VH-HBL3