

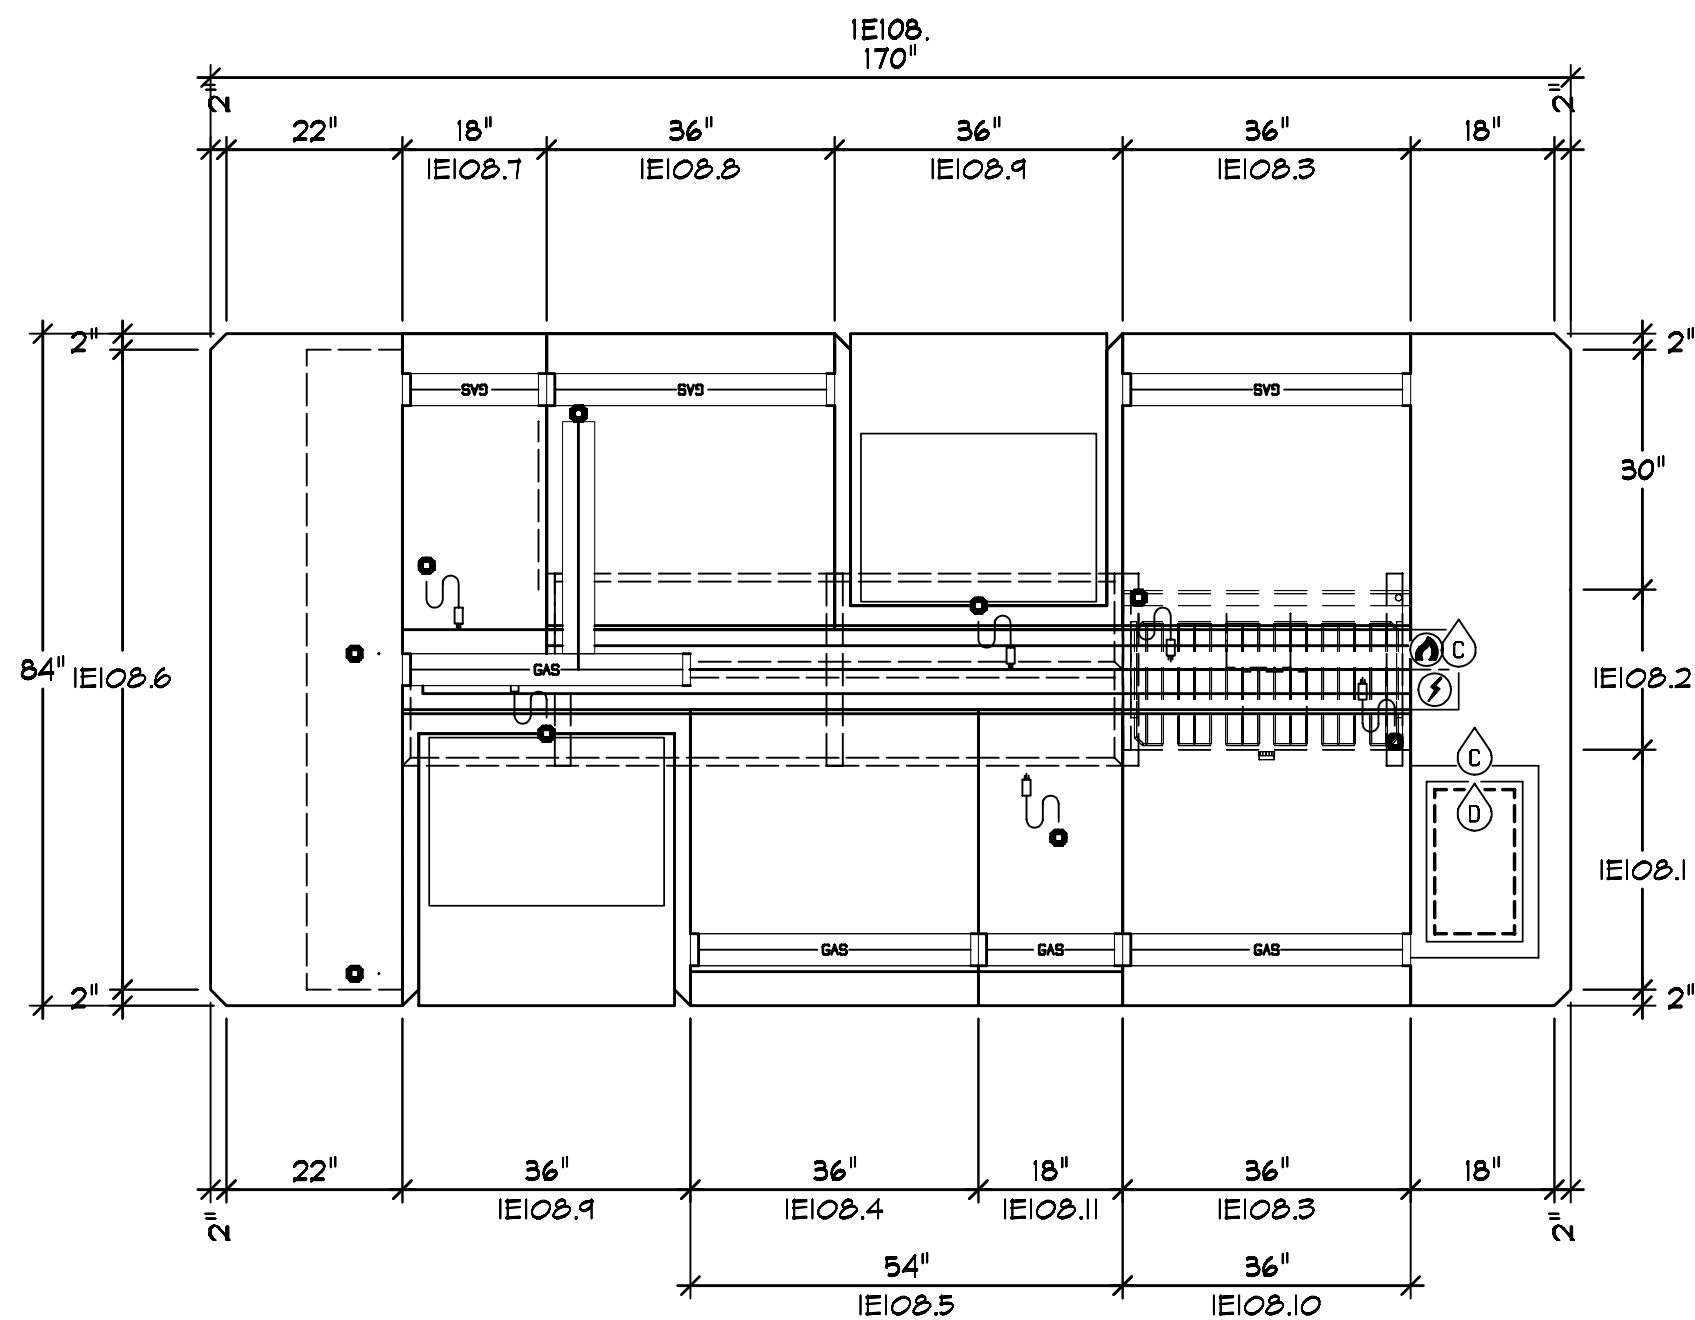
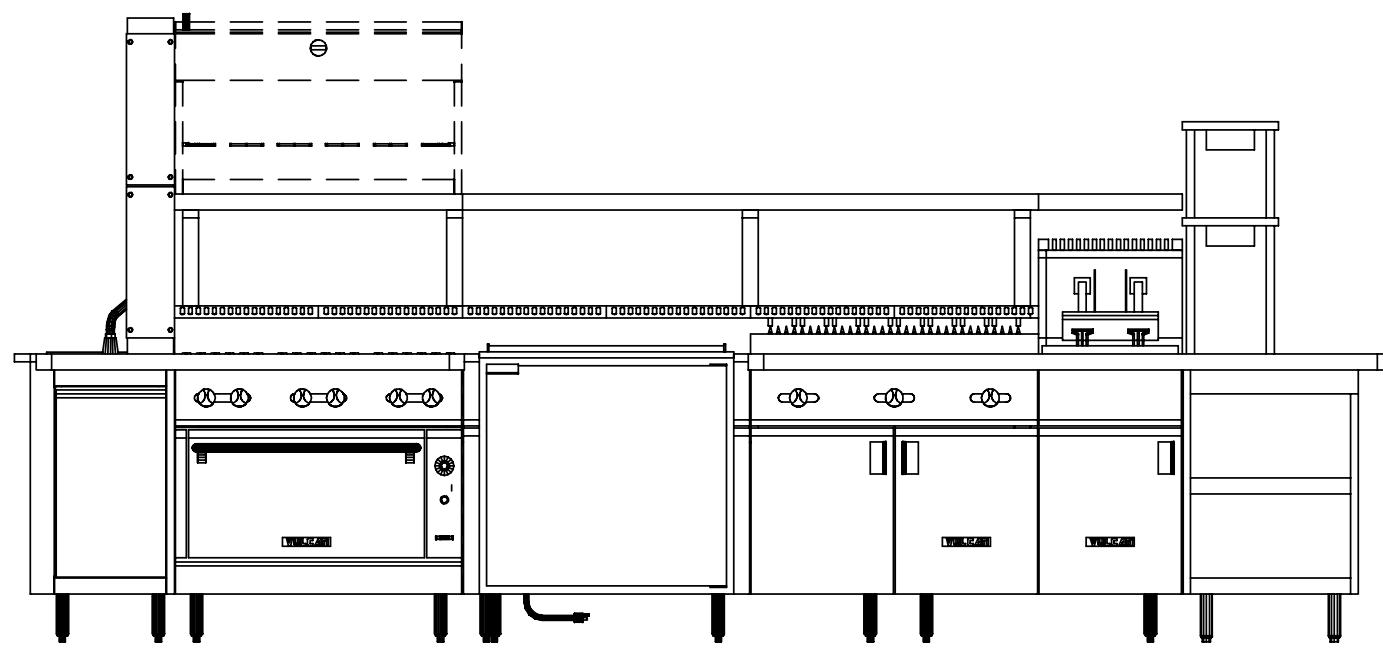
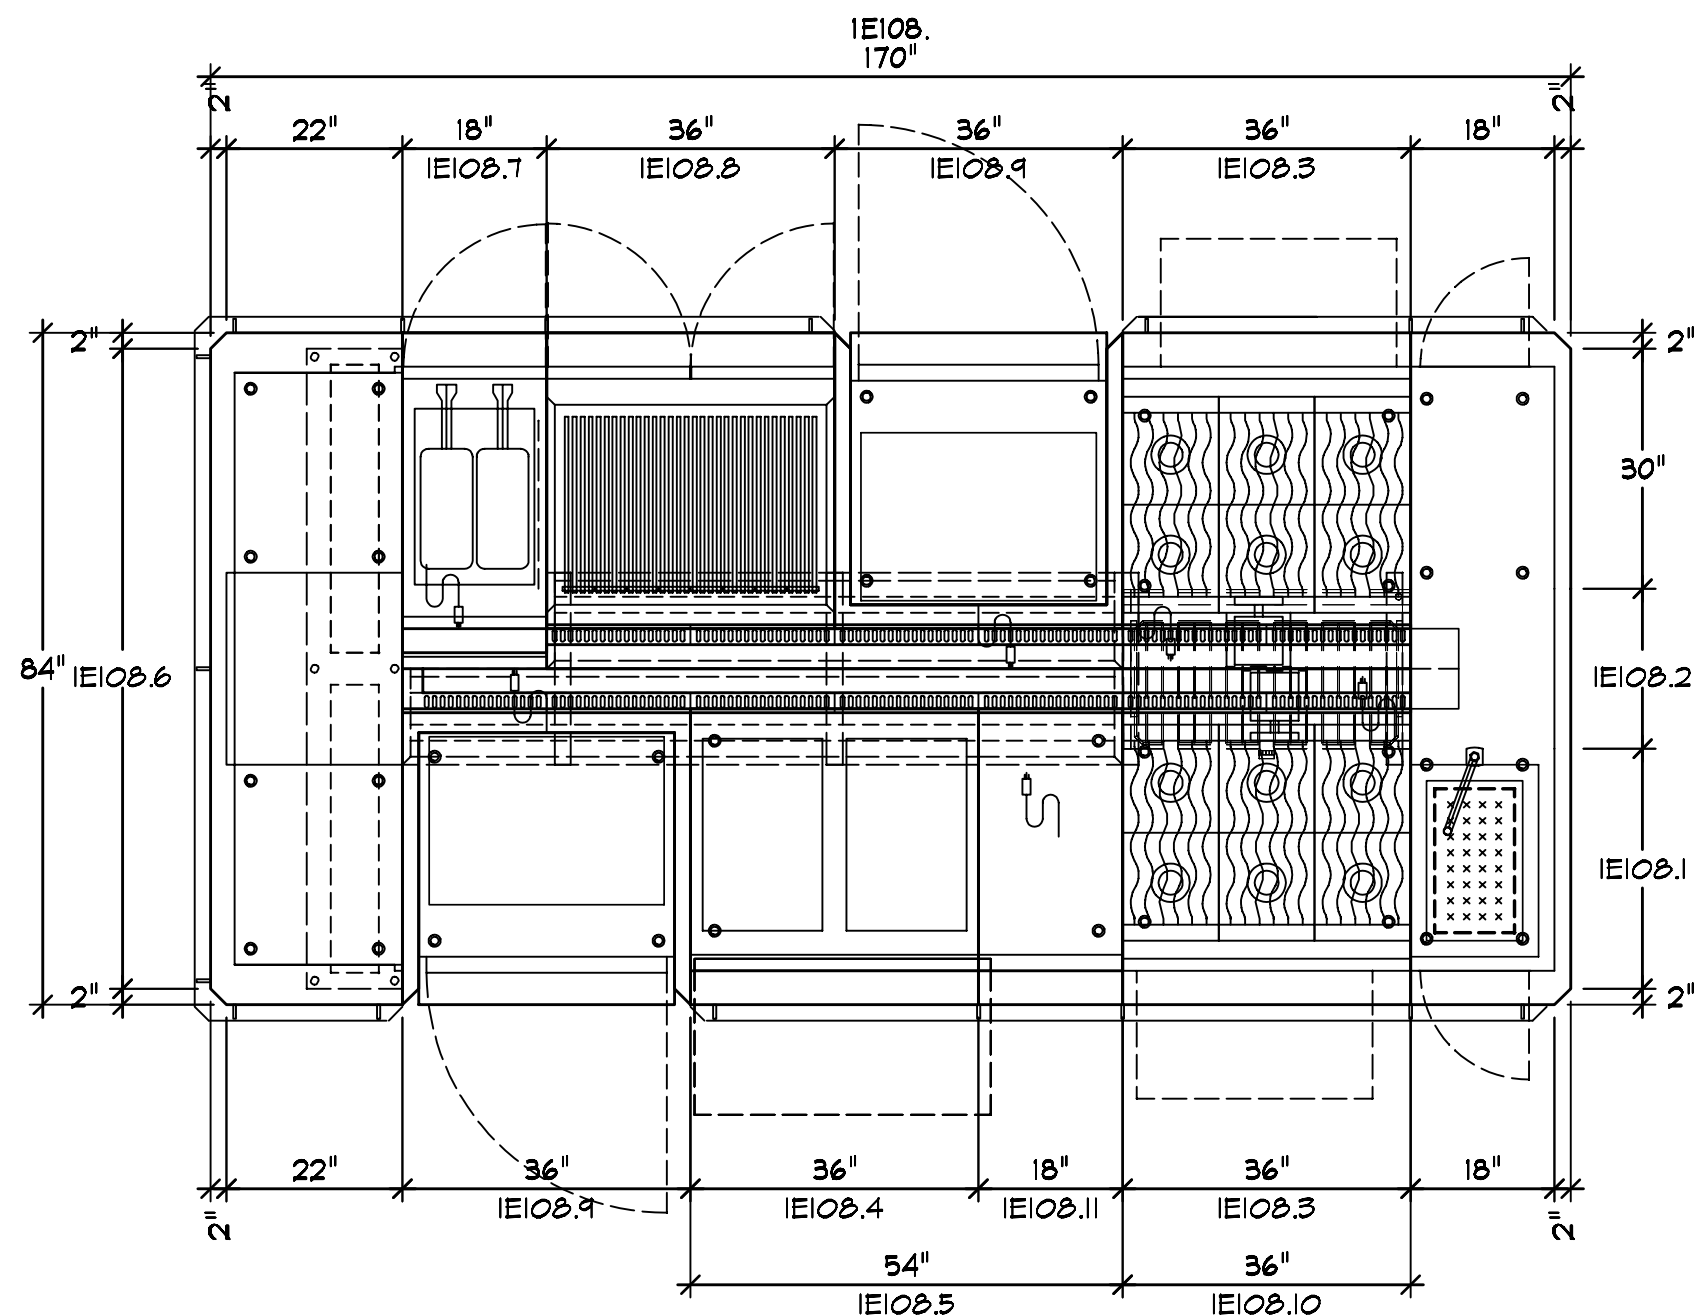
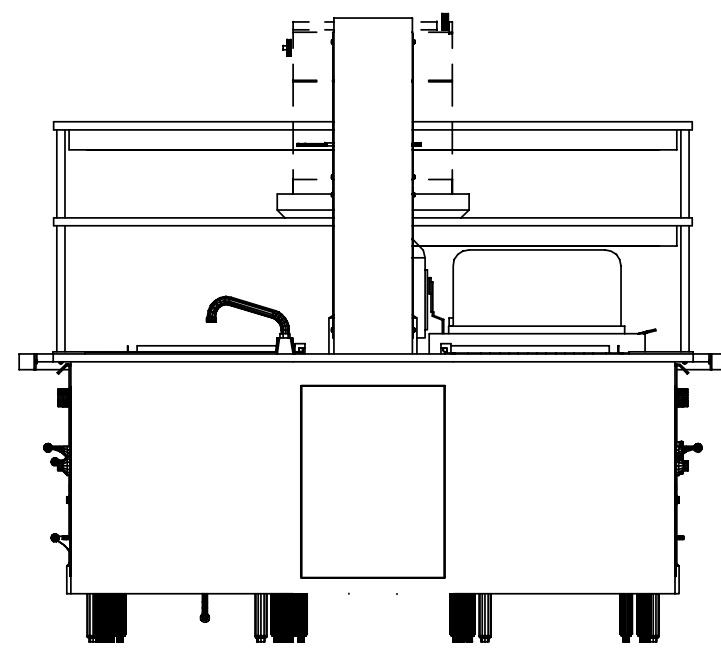
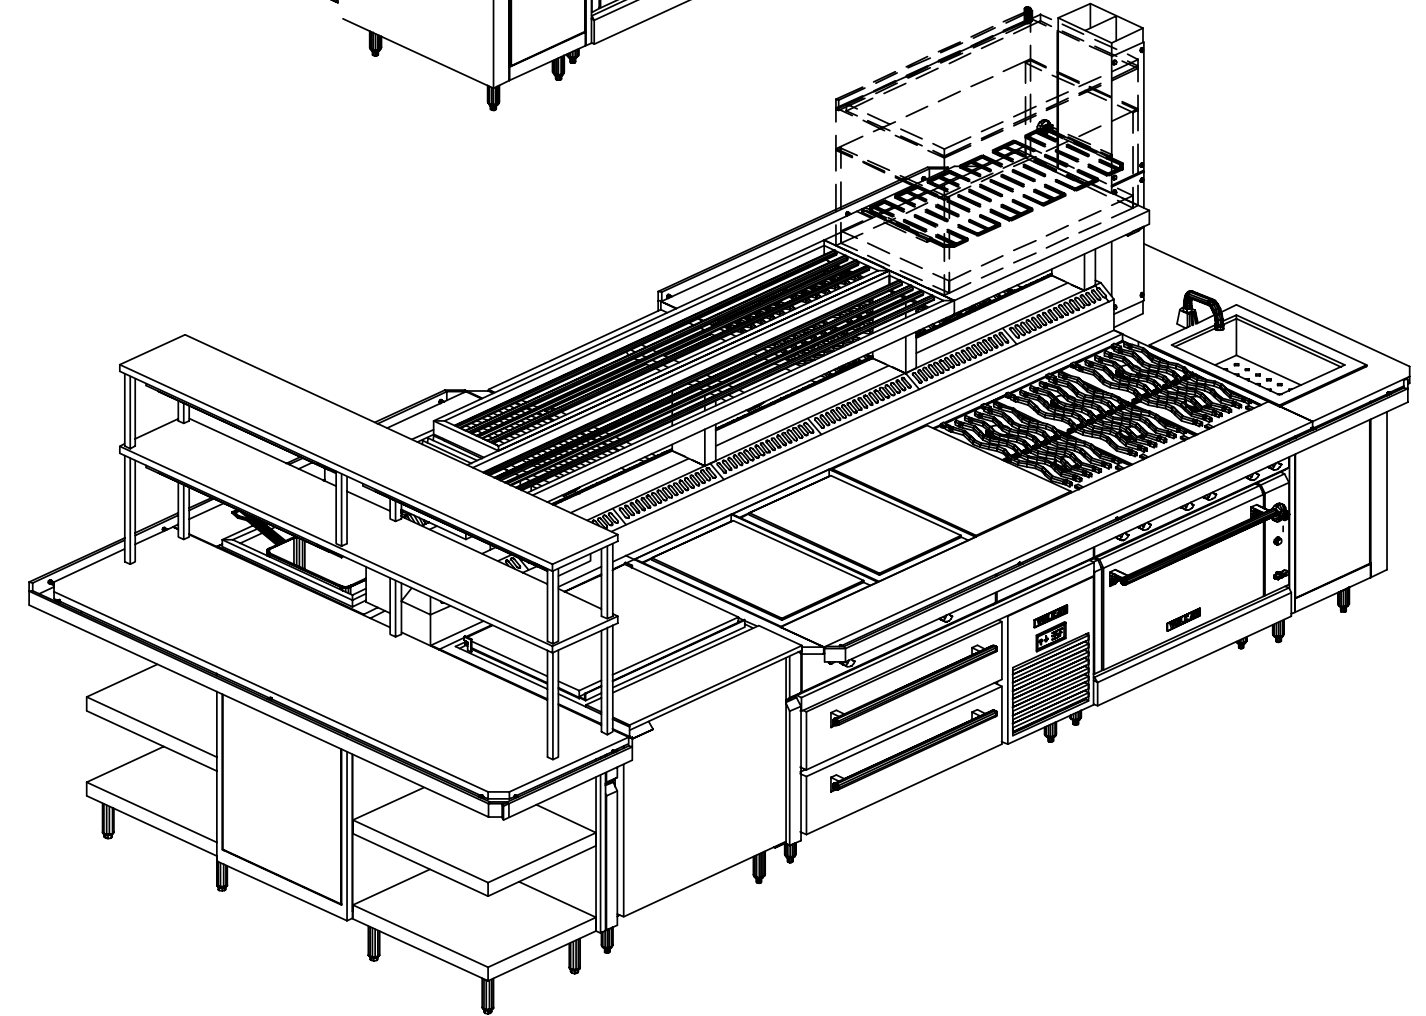
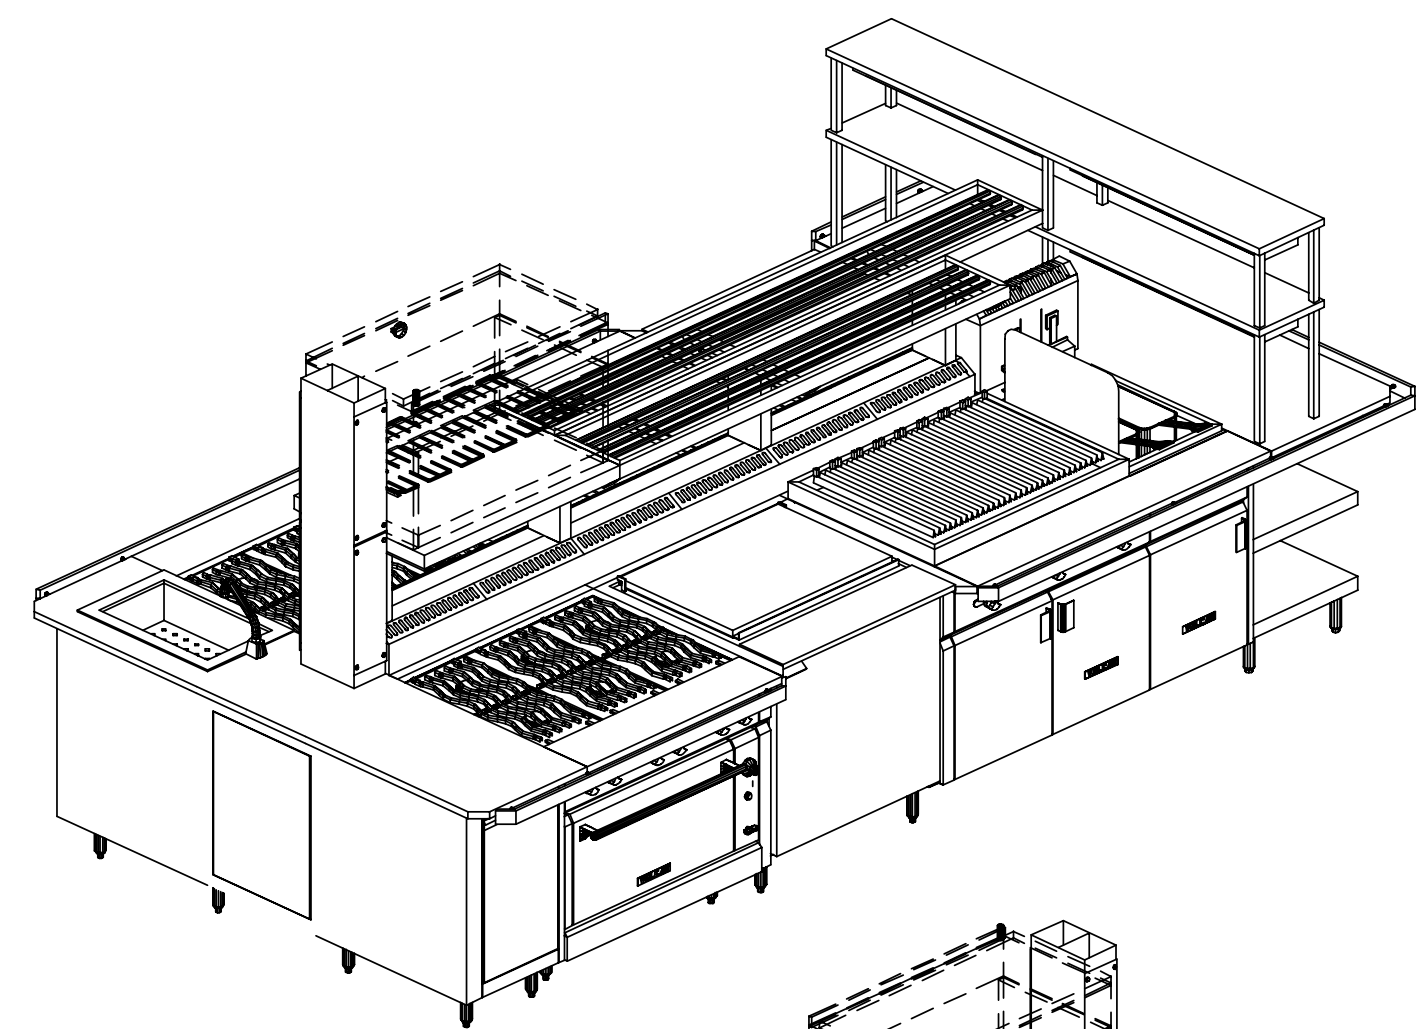
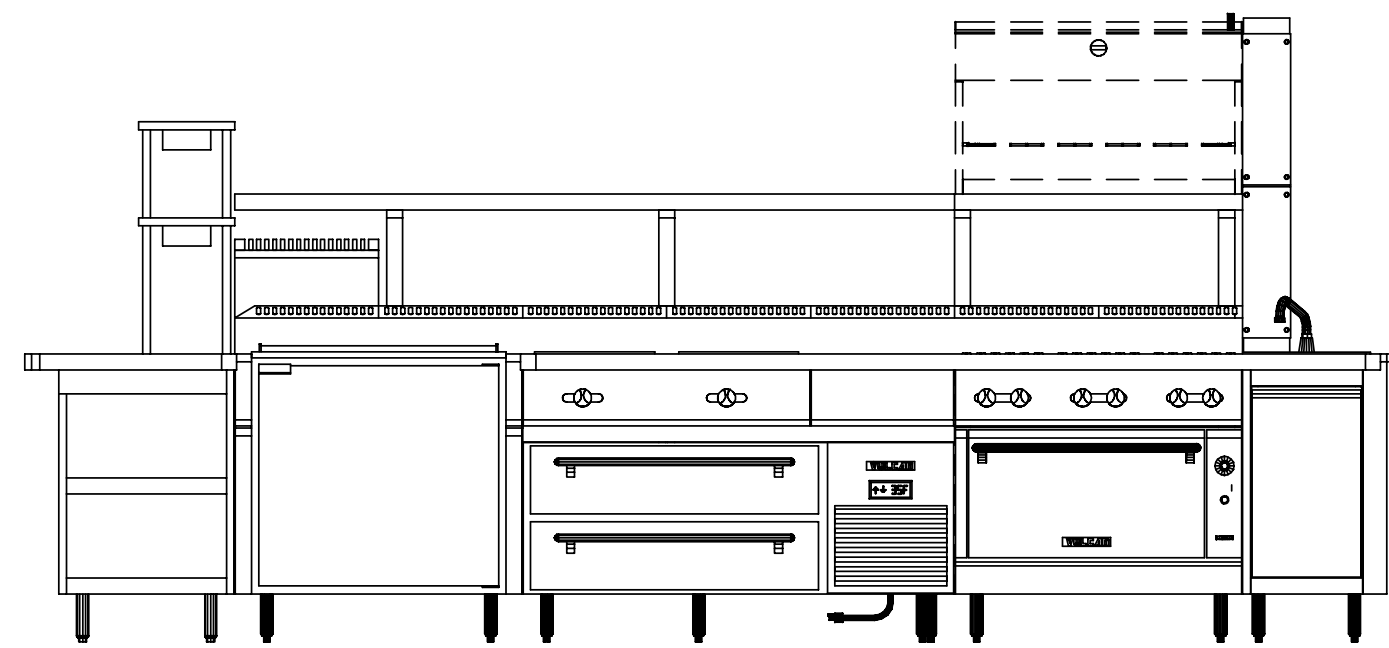
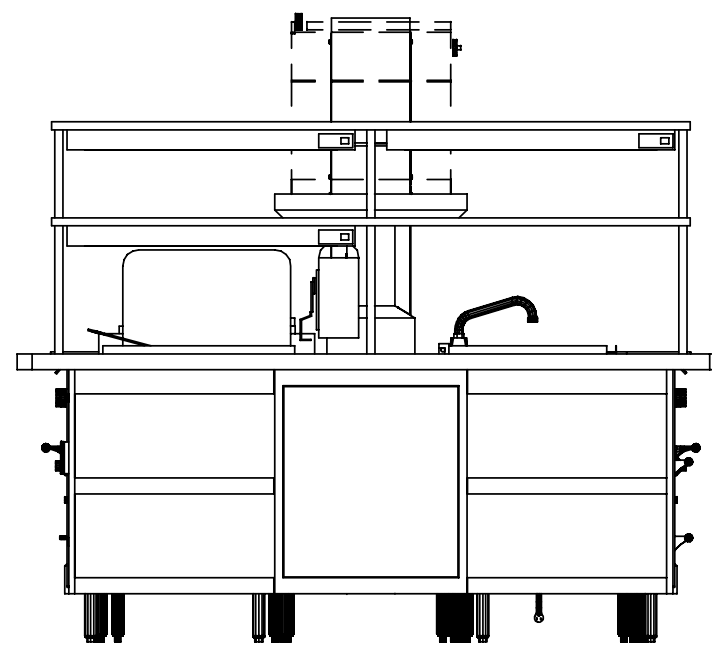


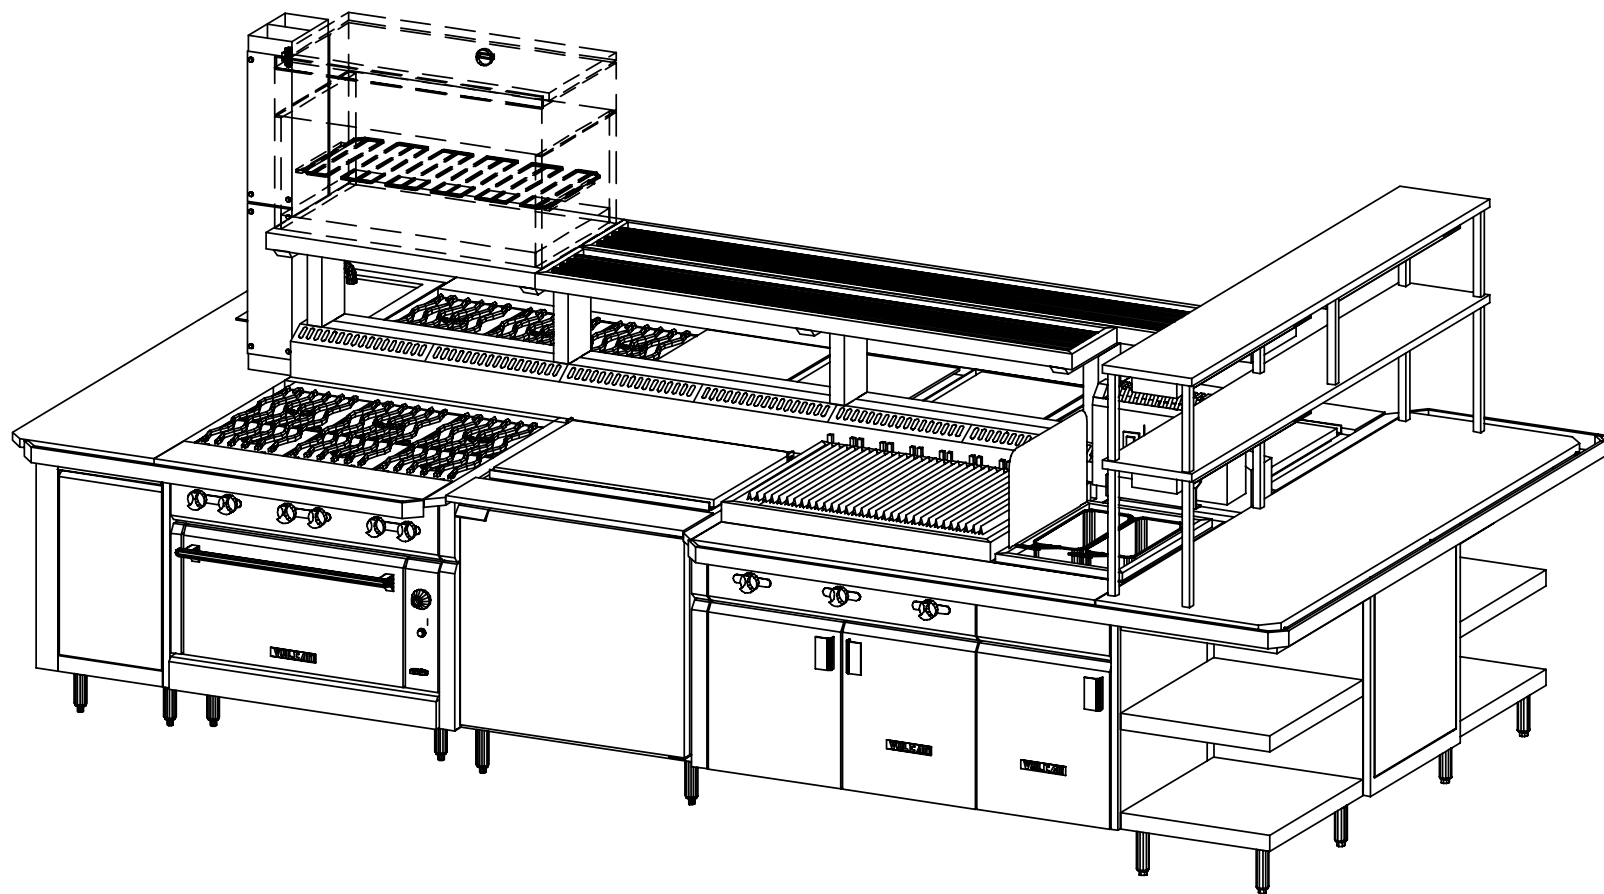

723 MBTU
TOTAL LOAD

IE108.1	1 EA	MOD100	HOT WELL
⚡	208 (1)	6.0A	16 AFF
IW	0.50	26	AFF
IE108.2	1 EA	B-208	FAUCET
CW	0.50	34	AFF
IE108.3	2 EA	V6B36C	RANGE
⚡	242 MBTU	1.25	32 AFF
⚡	120 (1)	4.0A	5-15
IE108.4	1 EA	2PL36	PLANCHA
⚡	35 MBTU	1.25	MANIFOLD
IE108.5	1 EA	REF	REFRIGERATED BASE
⚡	120 (1)	7.7A	5-15
IE108.6	3 EA	GRAH36	HEAT STRIP
⚡	208 (1)	3.8A	16 AFF
IE108.7	1 EA	VFRY18	FRYER
⚡	70 MBTU	1.25	MANIFOLD
⚡	120 (1)	3.0A	5-15
IE108.8	1 EA	VCBB36B	CHAR BROILER
⚡	99 MBTU	1.25	MANIFOLD
IE108.9	2 EA	UST3212	SANDWICH UNIT
⚡	120 (1)	7.5A	5-15
IE108.10	1 EA	RDCM-36	CHEESE MELTER
⚡	35 MBTU	0.75	78 AFF
IE108.11	1 EA	VWT18	SPREADER
⚡	0 MBTU	1.25	MANIFOLD

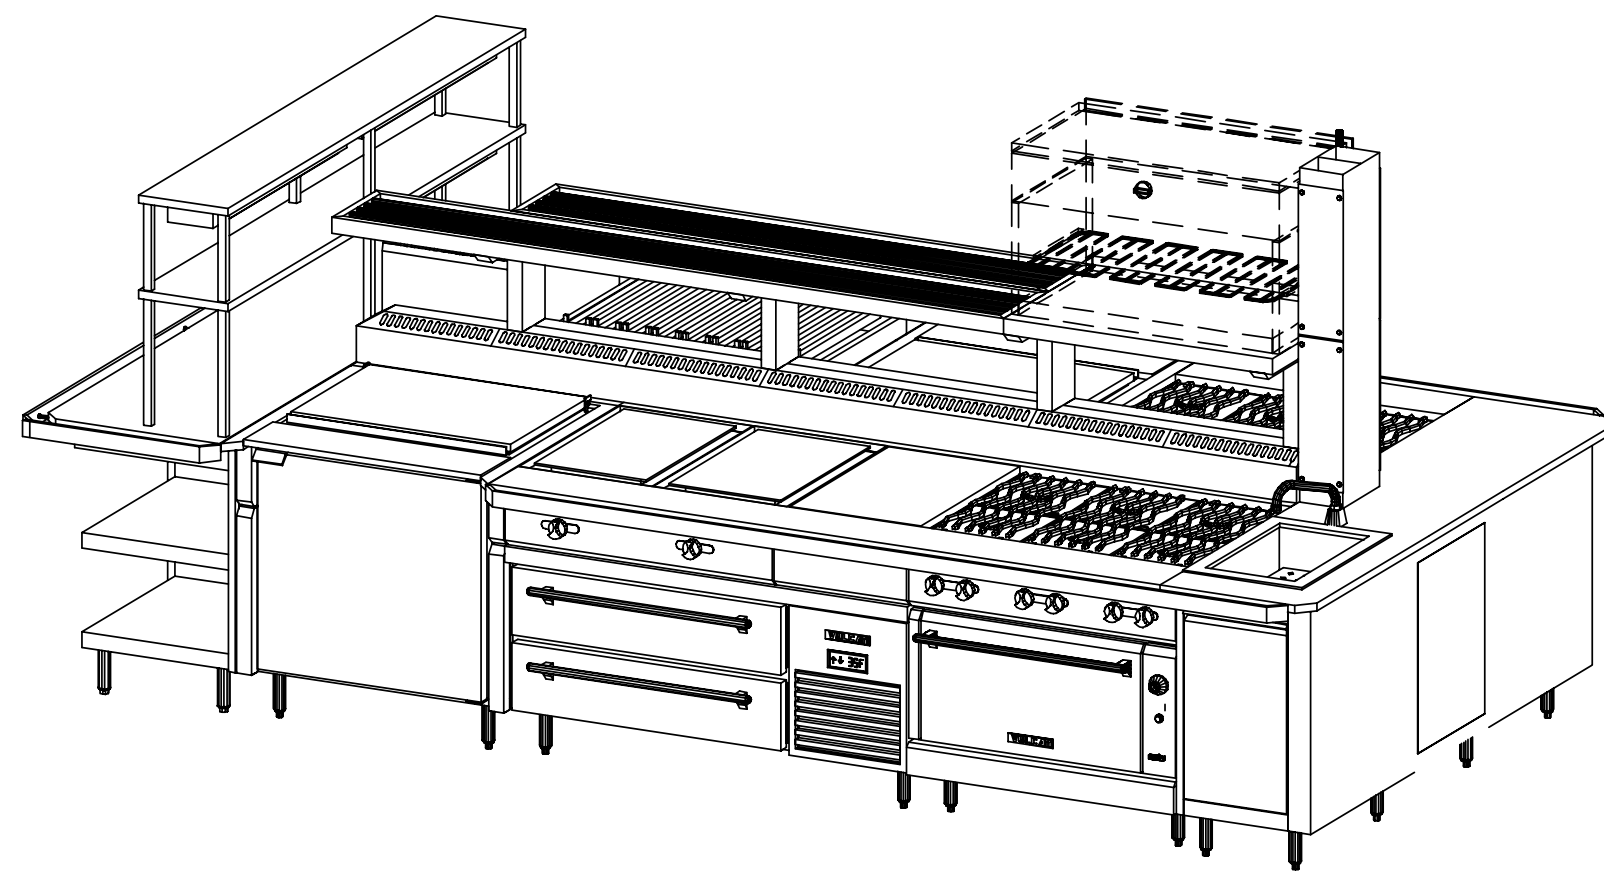

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURER RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

04-22-2021

⚡	CONNECTION POINT
⚡	COLD WATER
⚡	HOT WATER
⚡	HOT + COLD WATER
⚡	DRAIN
⚡	POWER
⚡	SWITCH
⚡	CORD SET
⚡	CONV. OUTLET RECP
⚡	DUPLEX RECP/TABLE
⚡	SINGLE RECP/TABLE
⚡	GAS
⚡	STEAM SUPPLY
⚡	STEAM RETURN
⚡	STEAM TAKE OFF
⚡	EXHAUST VENT
⚡	SUPPLY VENT
⚡	REFRIGERATION

PROJECT CODE
LIFES

LIFESPACE WATERFORD

VULCAN
THE VULCAN HART COMPANY
BALTIMORE, MARYLAND
410-284-0660

SCOPOS Hospitality Group
300 West Chesnut Suite 201
Ephrata, PA 17522

SCALE:
AS NOTED
DATE: 09/22/2021
DRAWN BY: DDB

1
OF 1