

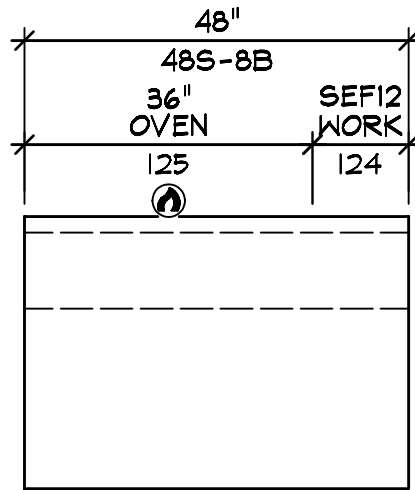
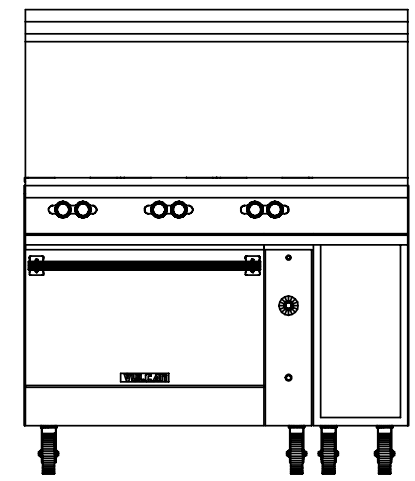
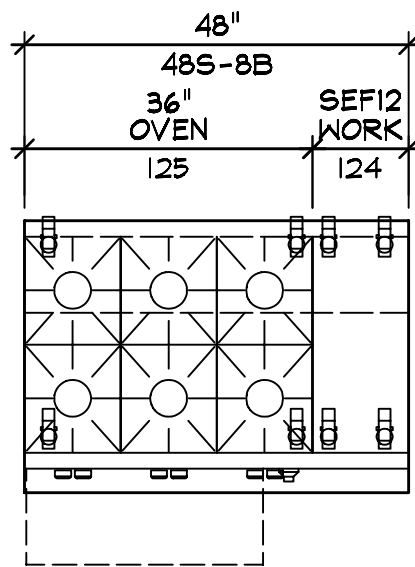


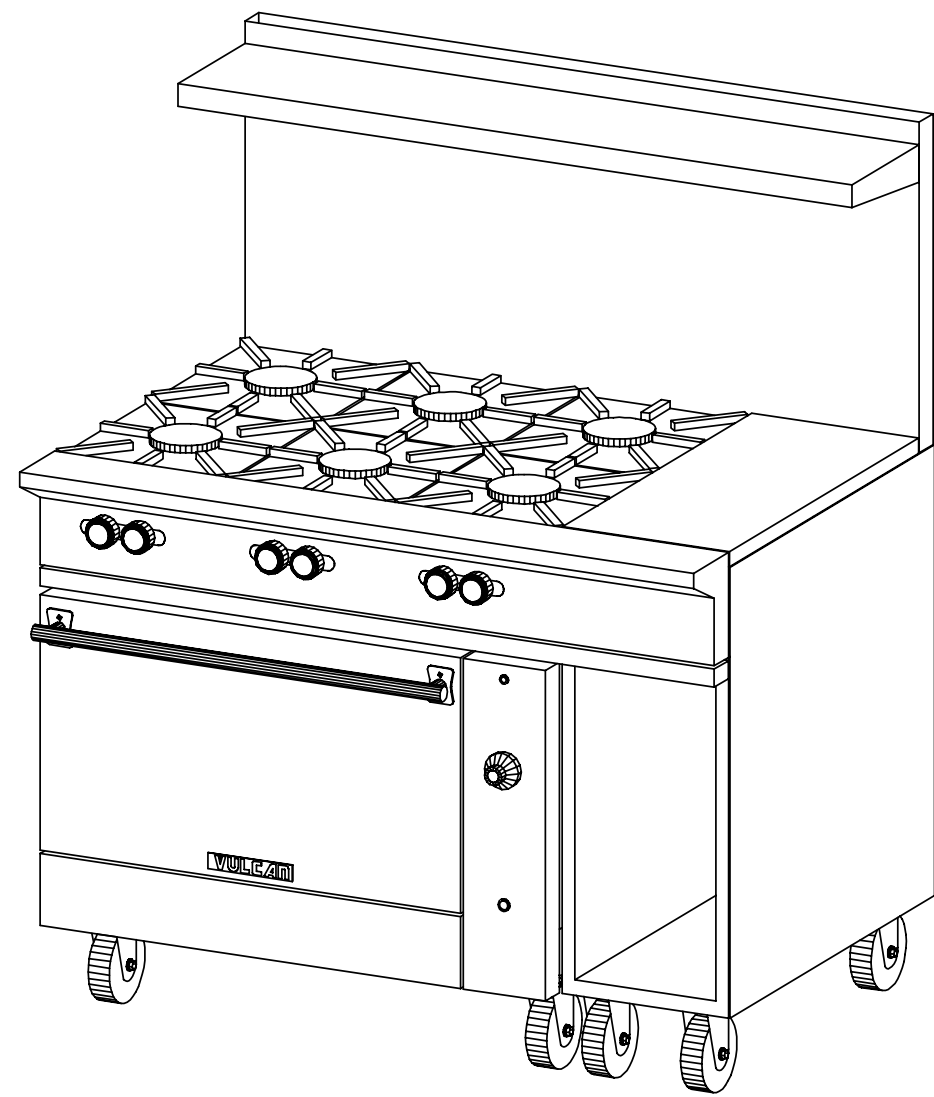

125	1 EA	48S-8B-SEFRANGE
215 MBTU	0.75	32 AFF

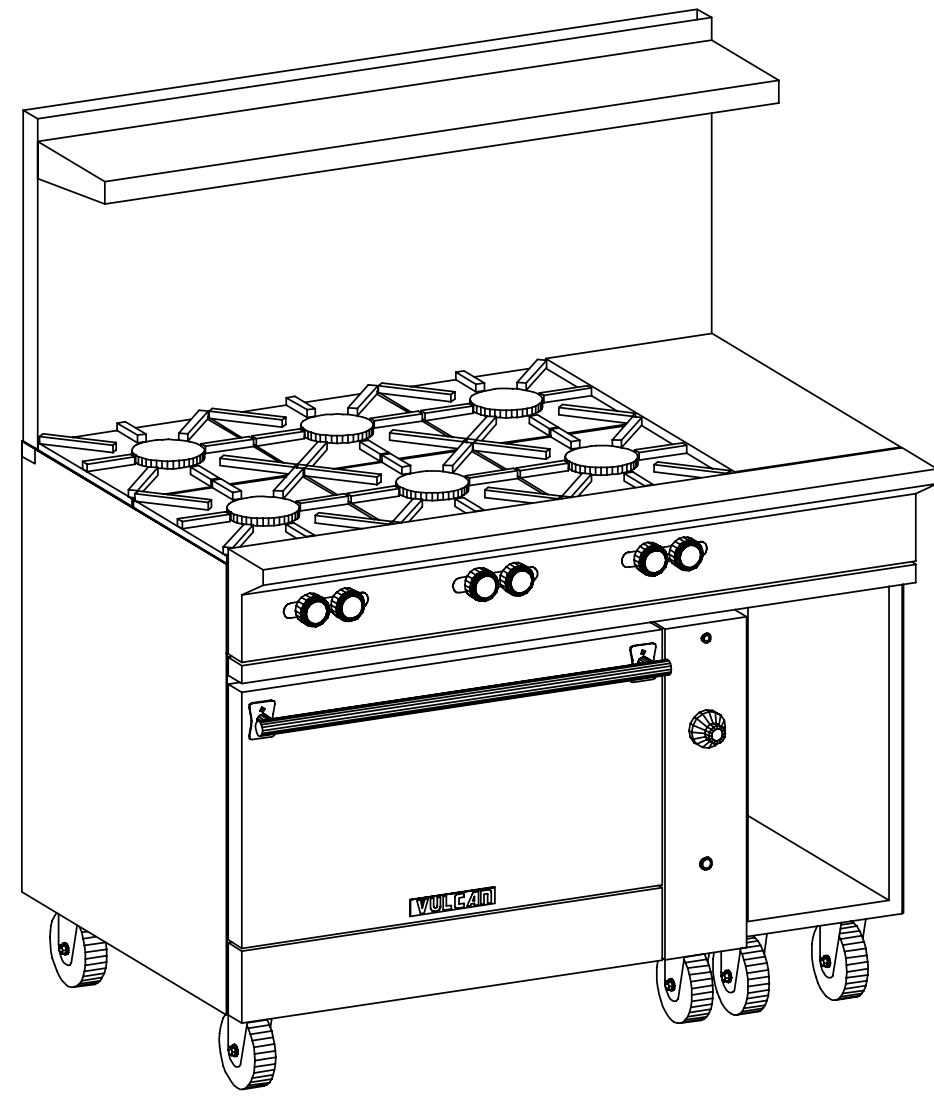

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURER RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

●	CONNECTION POINT
○	COLD WATER
△	HOT WATER
⊕	HOT + COLD WATER
○	DRAIN
⚡	POWER
⚡	SWITCH
⚡	CORD SET
○	CONV. OUTLET RECP
○	DUPLEX RECEPTACLE
○	SINGLE RECEPTACLE
⚡	GAS
⚡	STEAM SUPPLY
⚡	STEAM RETURN
⚡	STEAM TAKE OFF
⚡	EXHAUST VENT
⚡	SUPPLY VENT
⚡	REFRIGERATION

12-10-2021
12-10-2021 : 08:30:15a
12-14-2021 : 06:47:19a

PROJECT CODE
LOCKH

VULCAN
THE VULCAN HART COMPANY
BALTIMORE, MARYLAND
410-284-0660

PBR &	LOCKHART
12/15/2021	DATE

No.	Date	By	Revisions
04	12/15/2021	ddb	48" SEF
05	01/26/2022	REMOVE	ITEM 126

SCALE:	VH-LOCKH
DATE:	AS NOTED
DRAWN BY:	DDB
1	
1	
OF	