
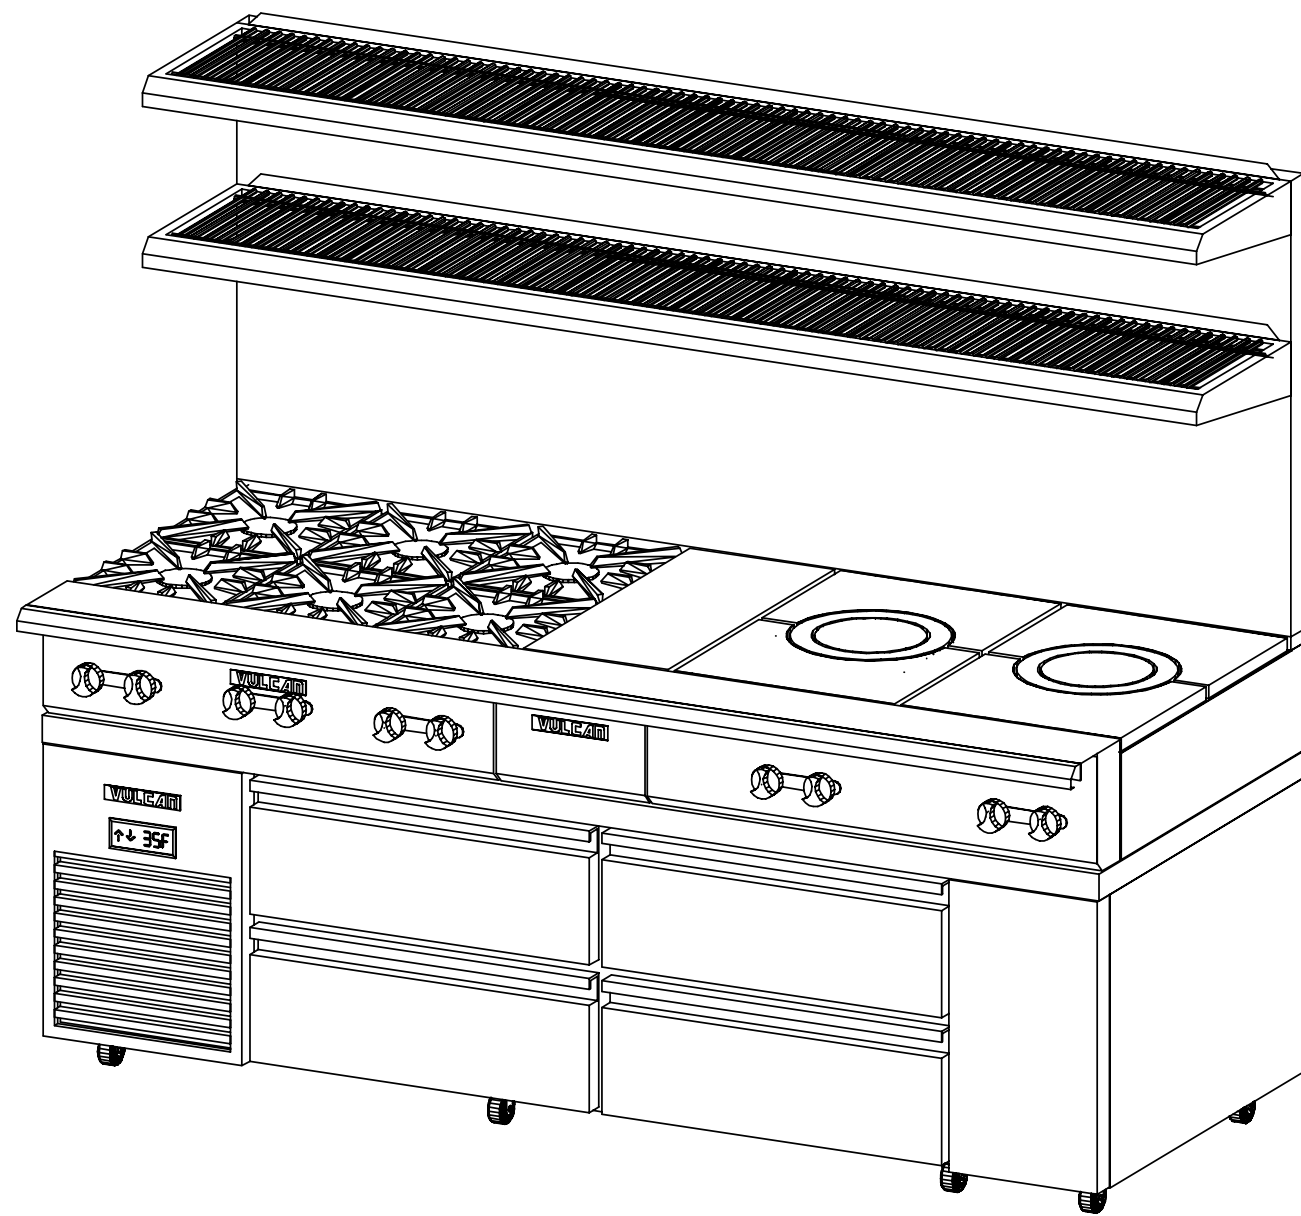


148	1 EA	V2FT36	RANGE
50	MBTU	1.25	MANIFOLD
149	1 EA	VSC72-MOD	REFRIGERATED BASE
120	(1)	6.7A	5-15
150	1 EA	VWT12B	SPREADER
0	MBTU	1.25	RS AFF
152	1 EA	V6B36	RANGE
210	MBTU	1.25	MANIFOLD

GAS CONNECTION #1
LOCATED IN ITEM: 150
PIPE SIZE: 1.25 NPT
OP HEIGHT: 36" AFF
TOTAL GAS LOAD: 250 MBTU
INCLUDES ITEMS: 152 148
NOTE:

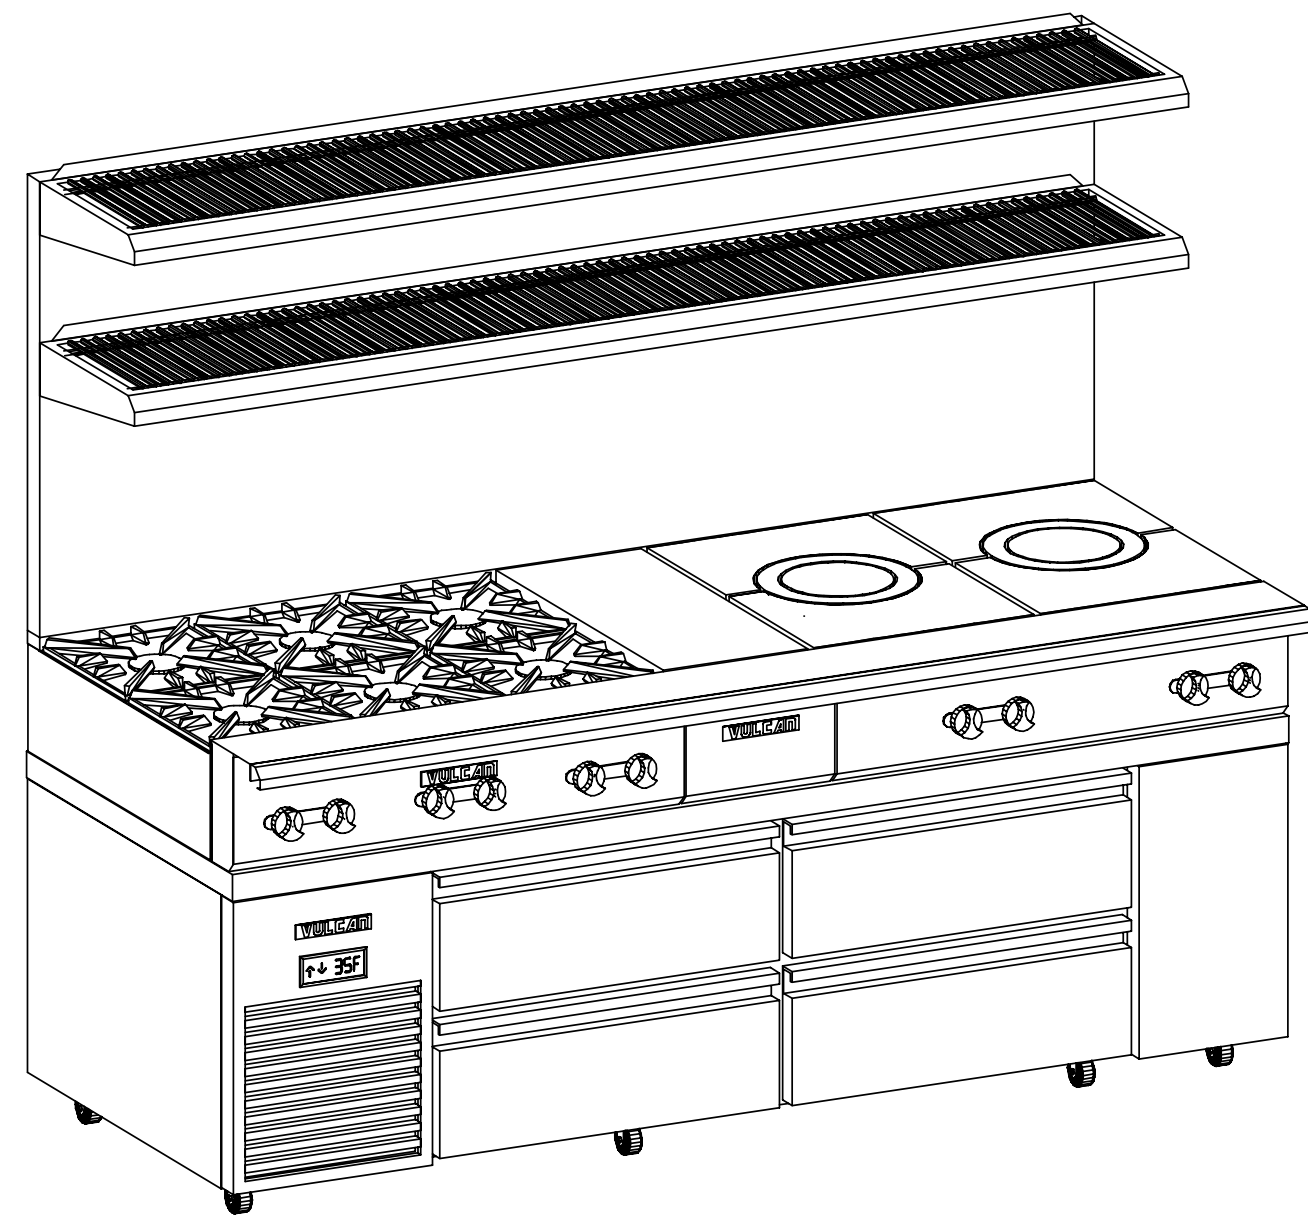

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURERS RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

CONNECTION POINT
COLD WATER
HOT WATER
HOT + COLD WATER
DRAIN
POWER
SWITCH
CORD SET
CONV. OUTLET RECP
DUPLEX RECP/TABLE
SINGLE RECP/TABLE
GAS
STEAM SUPPLY
STEAM RETURN
STEAM TAKE OFF
EXHAUST VENT
SUPPLY VENT
REFRIGERATION

01-20-2022
01-20-2022 : 08:41:59a

PROJECT CODE
MAVB1

VULCAN
THE VULCAN HART COMPANY
BALTIMORE, MARYLAND
410-284-0660

20 MASS AVE
BATTERY 1

No.	Date	By	Revision
02	02/20/2022	ddb	ITEM 149
04	06/07/2022	ddb	

NEXT STEP DESIGN
913 WEST ST.
ANNAPOLIS, MD 21401

SCALE:
AS NOTED
DATE: 01/20/2022
DRAWN BY: DDB
VH-MAVB1