
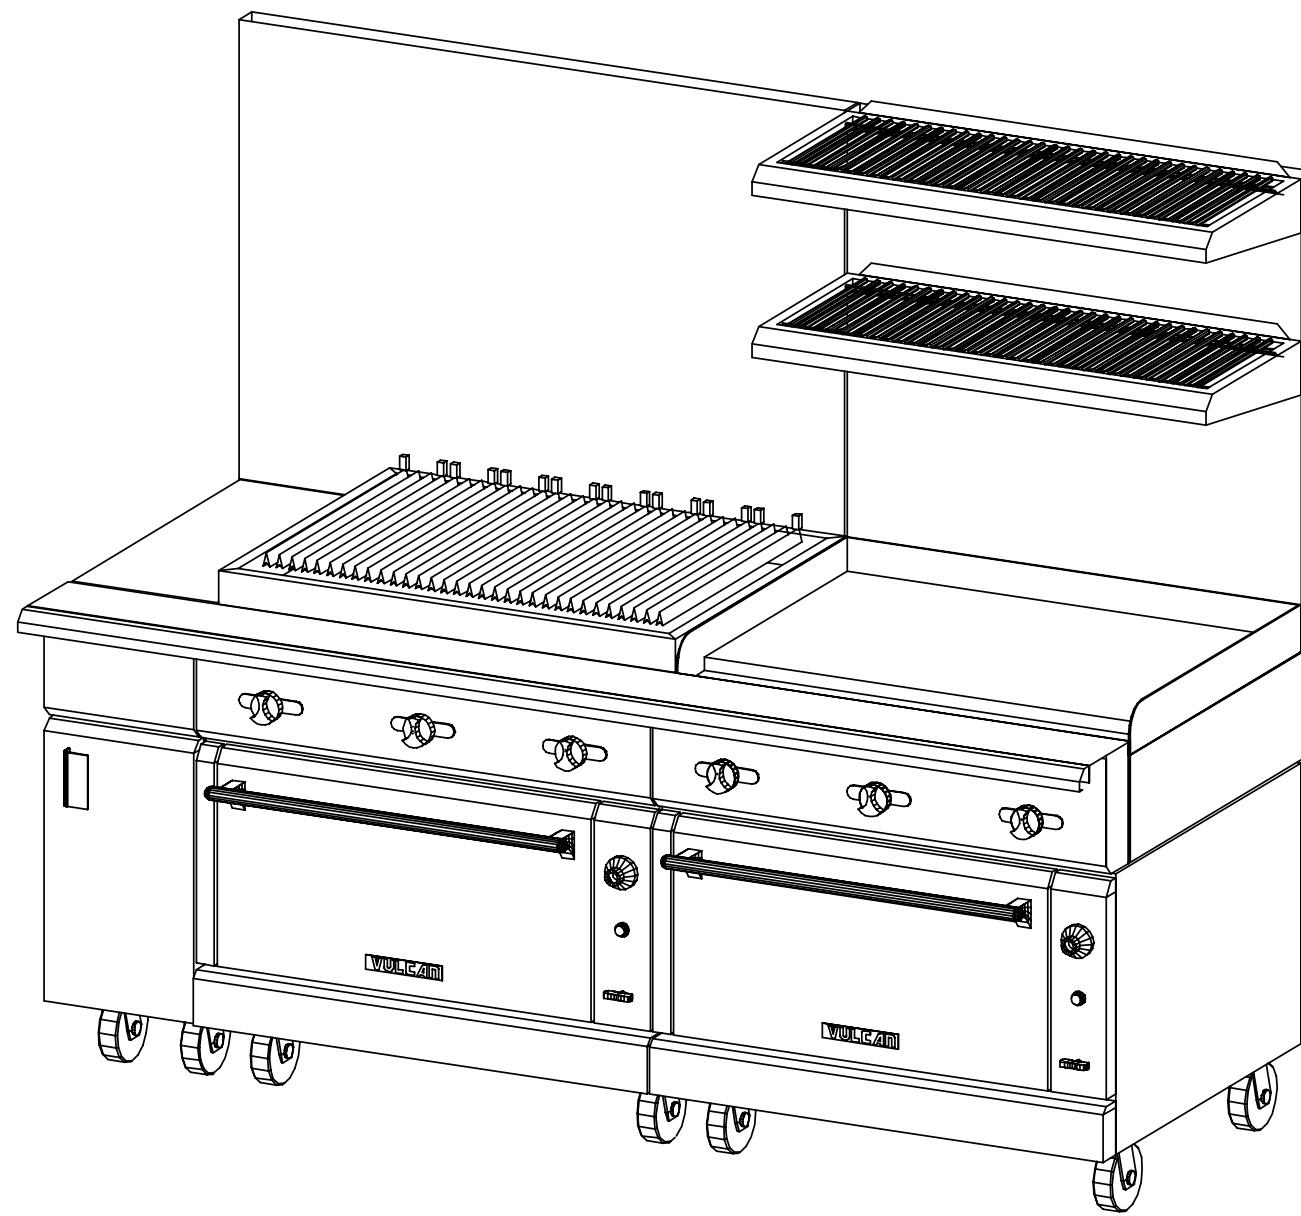


179	1 EA	VGMT36S	RANGE
140 MBTU	1.25	MANIFOLD	
180	1 EA	VCB836S	CHARBROILER
149 MBTU	1.25	MANIFOLD	
183	1 EA	VWT12B	SPREADER
32 AFF			

GAS CONNECTION #+: 1
LOCATED IN ITEM: 183
PIPE SIZE: 1.25 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 289 MBTU
INCLUDES ITEMS: 179 180
NOTE:

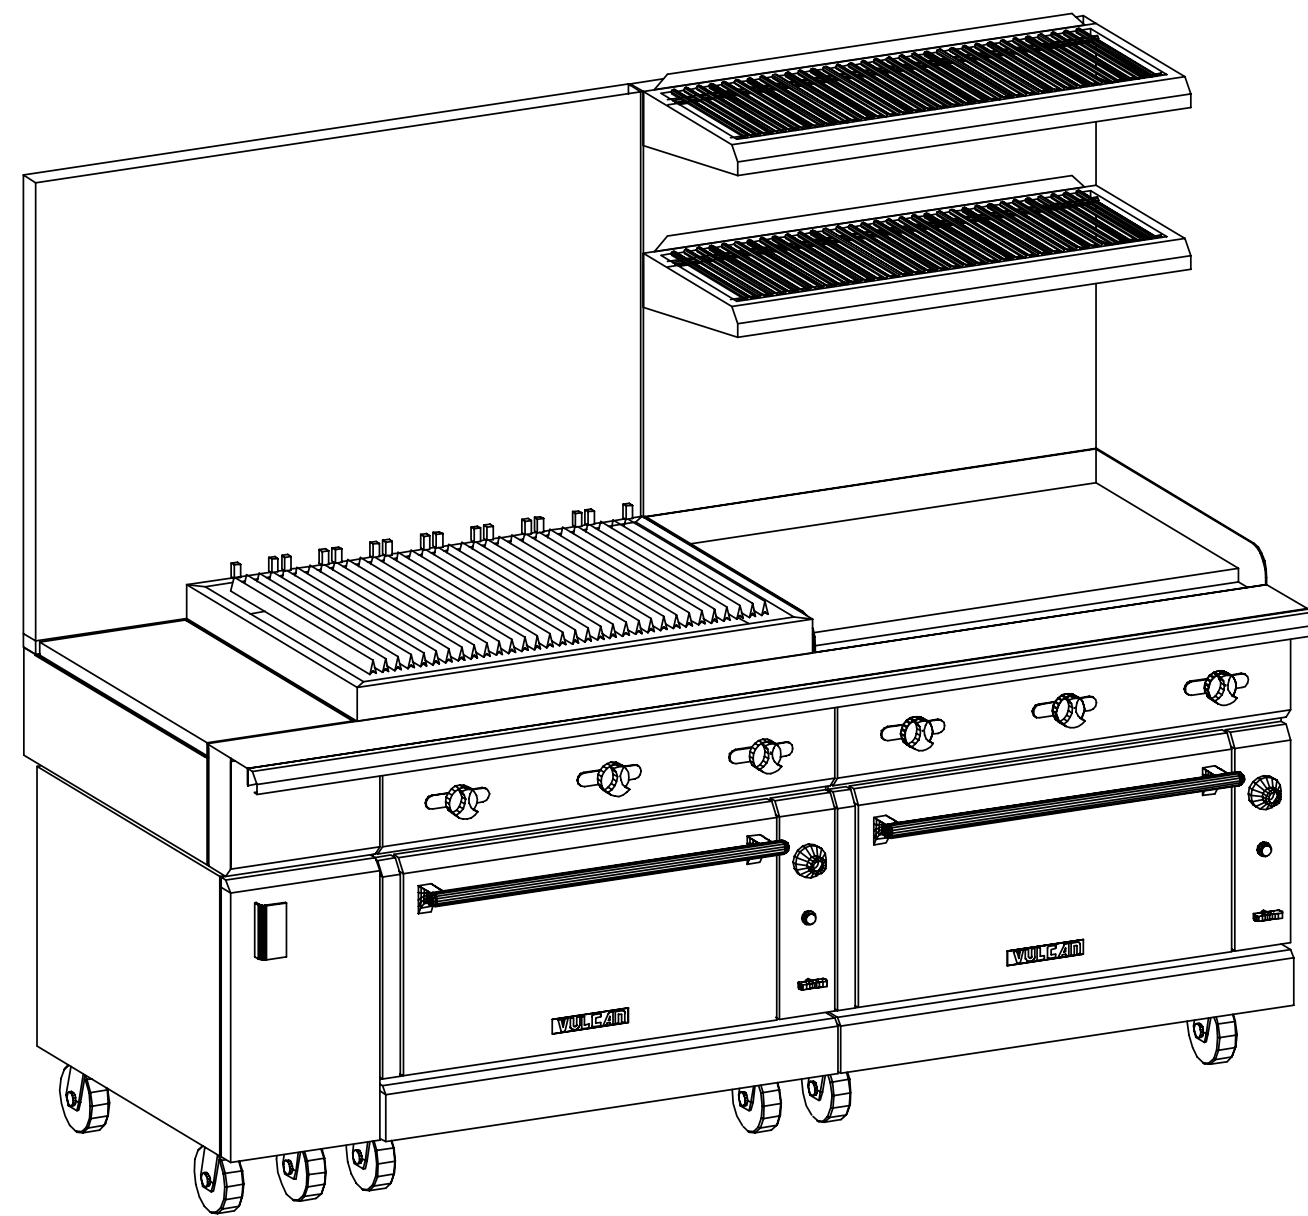

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURER RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

●	CONNECTION POINT
○	COLD WATER
△	HOT WATER
⬆	HOT + COLD WATER
○	DRAIN
⚡	POWER
⚡	SWITCH
●	CORD SET
○	CONV. OUTLET RECP
○	DUPLEX RECP/TACLE
○	SINGLE RECP/TACLE
⊗	GAS
⊗	STEAM SUPPLY
⊗	STEAM RETURN
⊗	STEAM TAKE OFF
⊗	EXHAUST VENT
⊗	SUPPLY VENT
⊗	REFRIGERATION

01-20-2022

PROJECT CODE
MAVB4

VULCAN
THE VULCAN HART COMPANY
BALTIMORE, MARYLAND
410-284-0660

20 MASS AVE
BATTERY 4

REVISIONS		Revision	
No.	Date	By	ddb

NEXT STEP DESIGN
913 WEST ST.
ANNAPOLIS, MD 21401

SCALE:
AS NOTED
DATE: 01/21/2022
DRAWN BY: DDB
VH-MAVB4

1
OF 1