


VH-PNTHR COPYRIGHT (C) 2021






VH-PNTHR COPYRIGHT (C) 2021

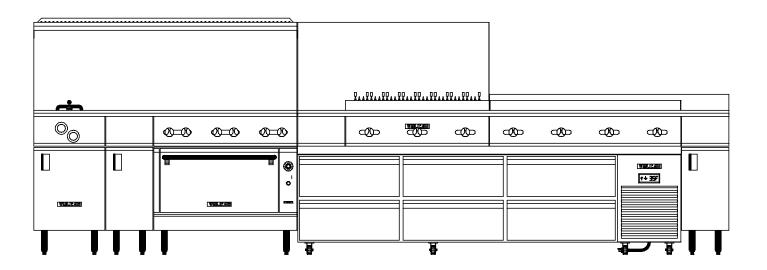


SSE VIEW

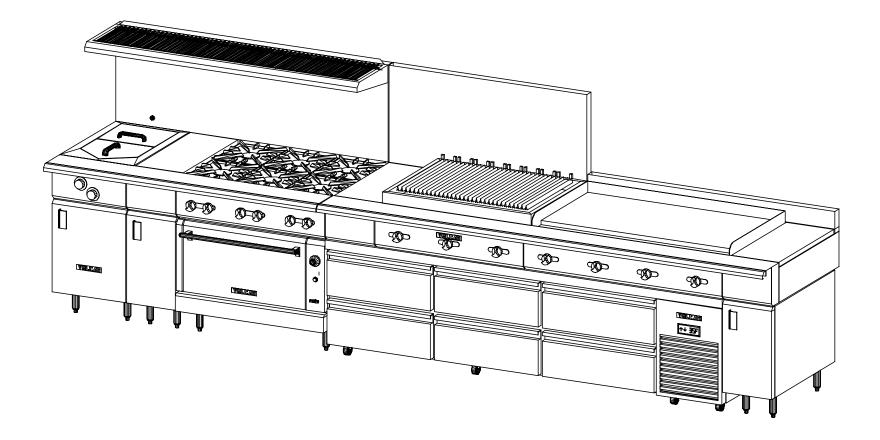

VH-PNTHR COPYRIGHT (C) 2021



ROXANNE HOLT PNTHR SSW VIEW

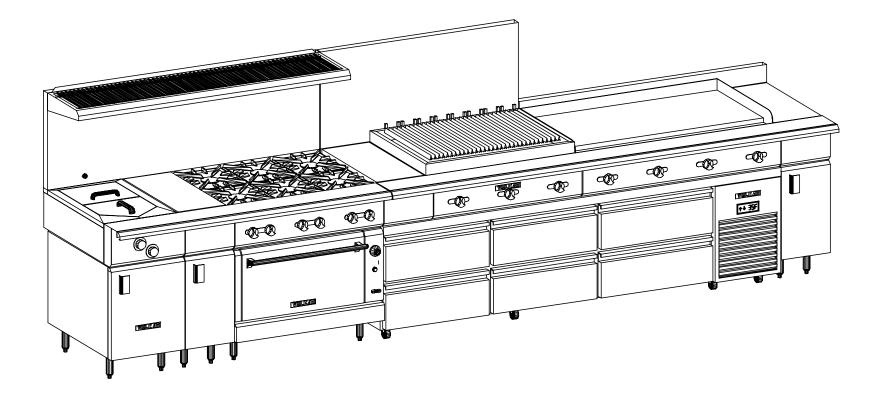

VH-PNTHR COPYRIGHT (C) 2021



VH-PNTHR

GENERAL NOTES - PLEASE READ

VENTILATION:

ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRIESSION:

ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:

ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:

EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (14" W.C.)

BY OTHERS:

VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:

IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURES RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

CONNECTION POINT

C COLD WATER

(H) HOT WATER

HOT + COLD

(D) DRAIN

POWER

\$ SWITCH

CORD SET

© CONV OUTLET RECP

→ DUPLEX RECPTACLE

SINGLE RECPTACLE

M GAS

(SS) STEAM SUPPLY

(CR) STEAM RETURN

(ST) STEAM TAKE OFF

VE EXHAUST VENT

VS SUPPLY VENT

(RF) REFRIGERATION

03-23-2021

03-23-2021: 06:53:29a

Roxanne Holt VULCAN HART COMPANY 3600 North Point Blvd Baltimore, MD 21222 v. 410-282-4322

PROJECT CODE
PNTHR

Email:roxanne.holt@vulcanhart.com

VH-PNTHR

COPYRIGHT (C) 2021



ROXANNE HOLT

CAROLINA PANTHERS

03-23-21