





PLAN VIEW



VH-SHAWK COPYRIGHT (C) 2021




ELEVATION




VH-SHAWK COPYRIGHT (C) 2021



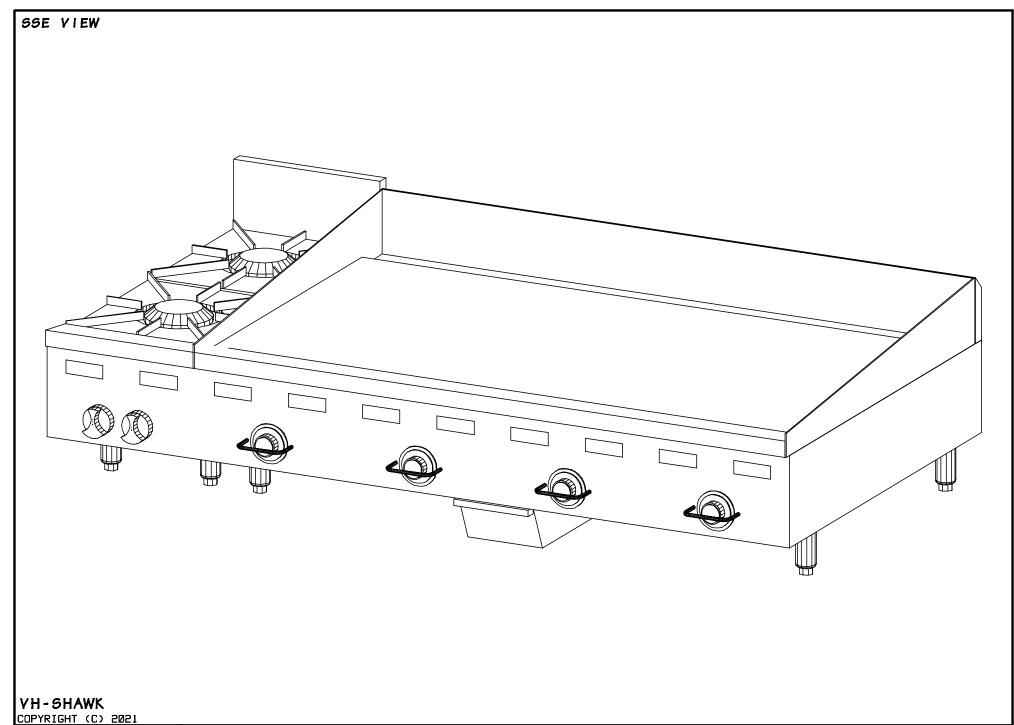

VULCAN

ROXANNE HOLT SHAWK SEATTLE SEAHAWKS VMAC 06-26-21

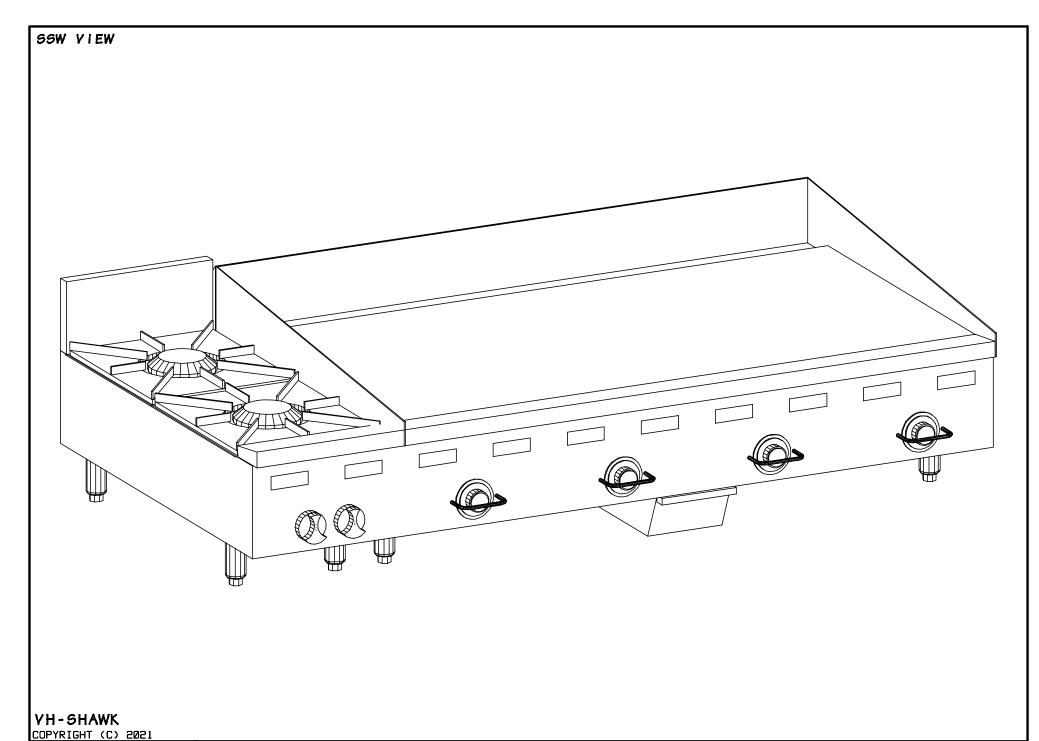



ROXANNE HOLT SHAWK

GENERAL NOTES - PLEASE READ

VENTILATION:

ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRIESSION:

ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:

ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:

EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (14" W.C.)

BY OTHERS:

VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:

IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURES RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

06-26-2021

06-26-2021 : 09:27:40a

D DRAIN
DOWER
SWITCH

d C⇒ CORD SET

DUPLEX RECPTACLE

CONNECTION POINT

(C) COLD WATER

(H) HOT WATER

HOT + COLD

SINGLE RECPTACLE

GAS

(SS) STEAM SUPPLY

CR STEAM RETURN

ST STEAM TAKE OFF

VE EXHAUST VENT

VS SUPPLY VENT

(RF) REFRIGERATION

Roxanne Holt YULCAN HART COMPANY 3600 North Point Blvd Baltimore, MD 21222 v. 410-282-4322

PROJECT CODE SHAWK

Email:roxanne.holt@yulcanhart.com

VH-SHAWK

COPYRIGHT (C) 2021



ROXANNE HOLT SHAWK SEATTLE SEAHAWKS VMAC

06-26-21