
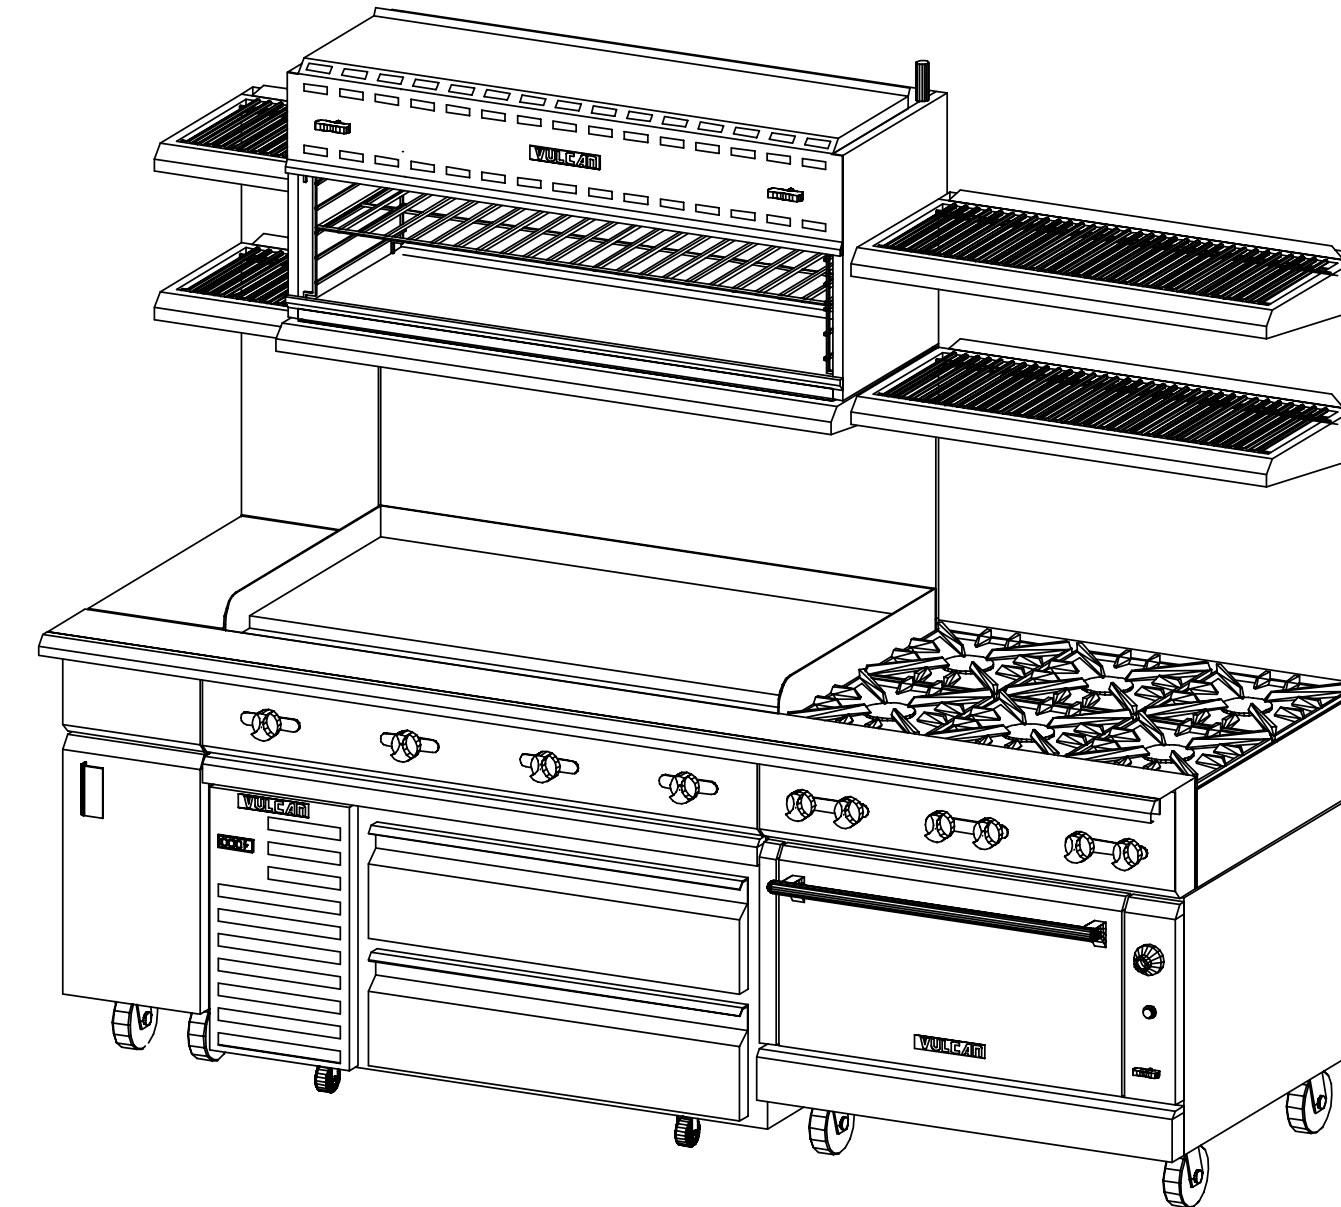


576	1 EA	VWT12B	SPREADER
Ø	MBTU	125.0	32 AFF
577	1 EA	TGRD48	GRIDDLE/REF BASE
120	MBTU	1.25	MANIFOLD INTERPLUMB
120 (1)	6.7A	5-15	
578	1 EA	VICM48	CHEESEMELTER FLUE MOUNTED
40	MBTU	0.75	MANIFOLD INTERPLUMB
579	1 EA	V2FT36S	RANGE
260	MBTU	1.25	MANIFOLD

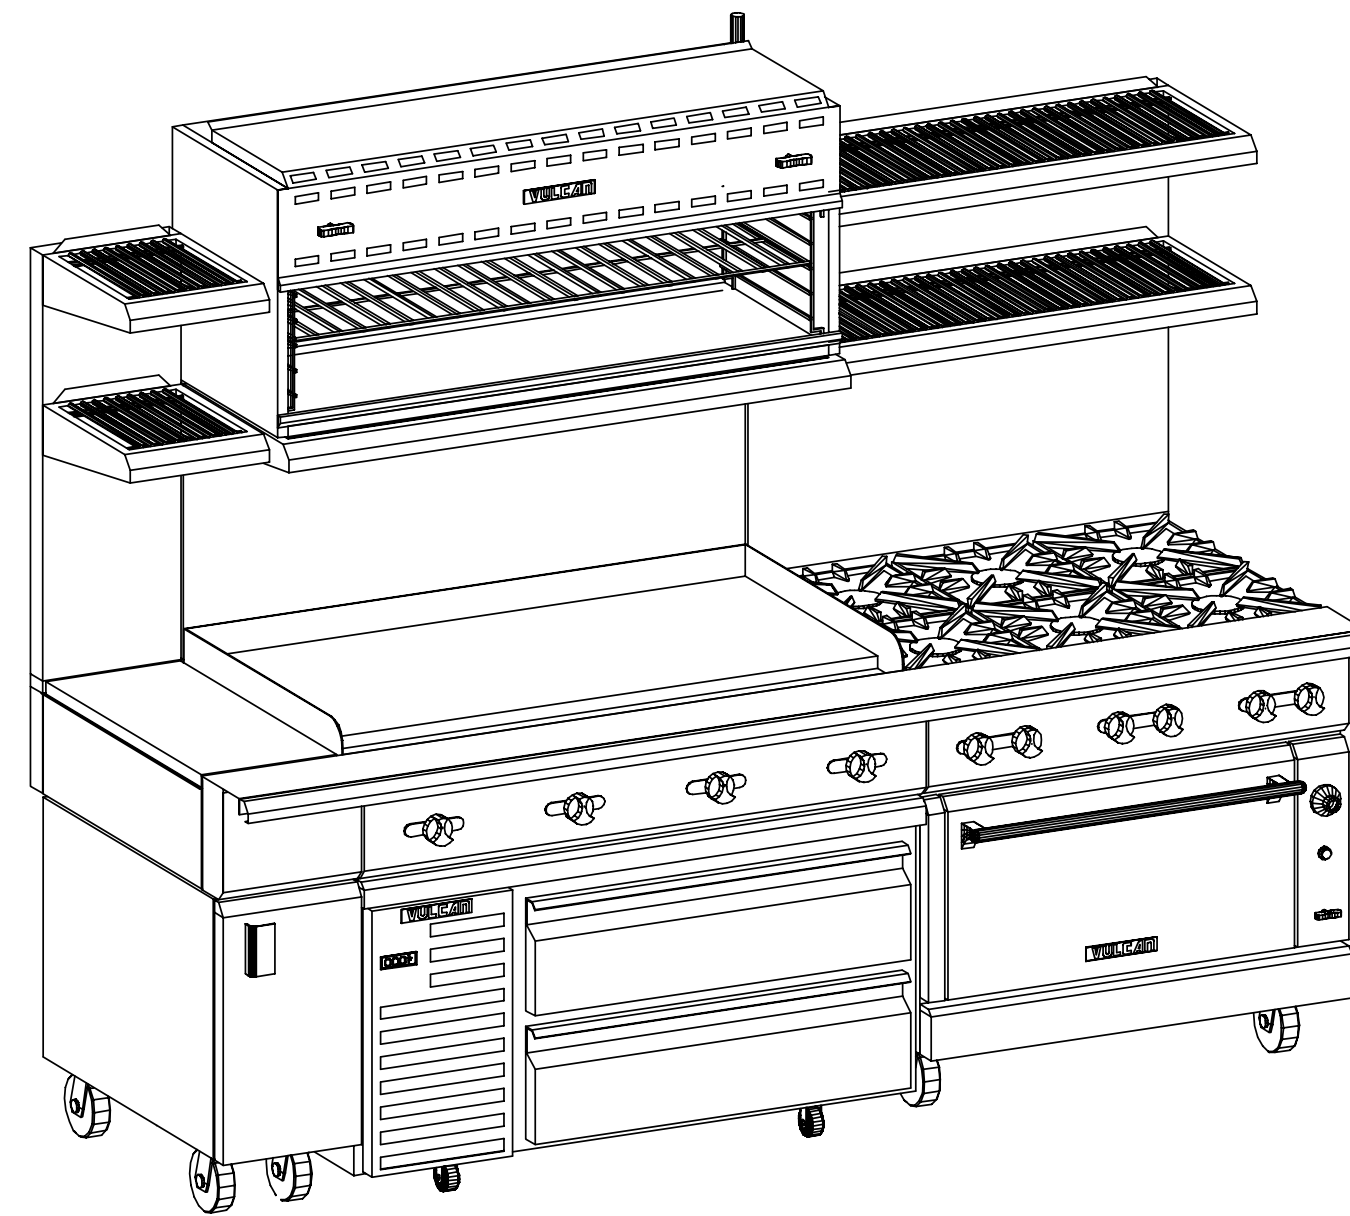

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURER RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

07-11-2019
08-07-2019
08-04-2020 : 11:53:24a

CONNECTION POINT
C COLD WATER
H HOT WATER
HC HOT + COLD WATER
D DRAIN
P POWER
S SWITCH
CS CORD SET
CO CONV OUTLET RECP
CD DUPLEX RECEPTACLE
CS SINGLE RECEPTACLE
G GAS
SS STEAM SUPPLY
CR STEAM RETURN
ST STEAM TAKE OFF
VE EXHAUST VENT
VS SUPPLY VENT
RF REFRIGERATION

PROJECT CODE
THBV3

THOMPSON HOTEL BUCKHEAD
ATLANTA, GA

NEXT STEP DESIGN
913 WEST ST.
ANNAPOLIS, MD 21401

SCALE:
AS NOTED
DATE: 8/7/19
DRAWN BY: DDB
VH-THBV3

3
OF

VULCAN
THE VULCAN HART COMPANY
BALTIMORE, MARYLAND
410-284-0660