







PLAN VIEW

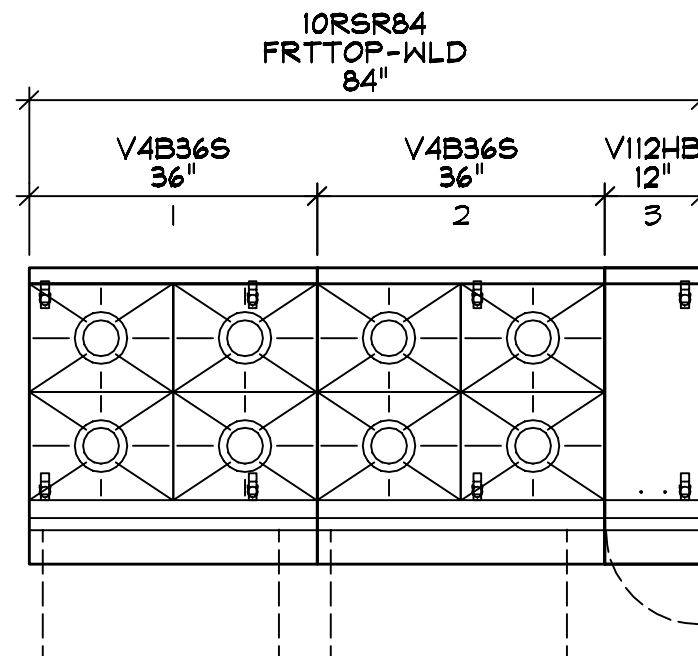


CONNECTIONS

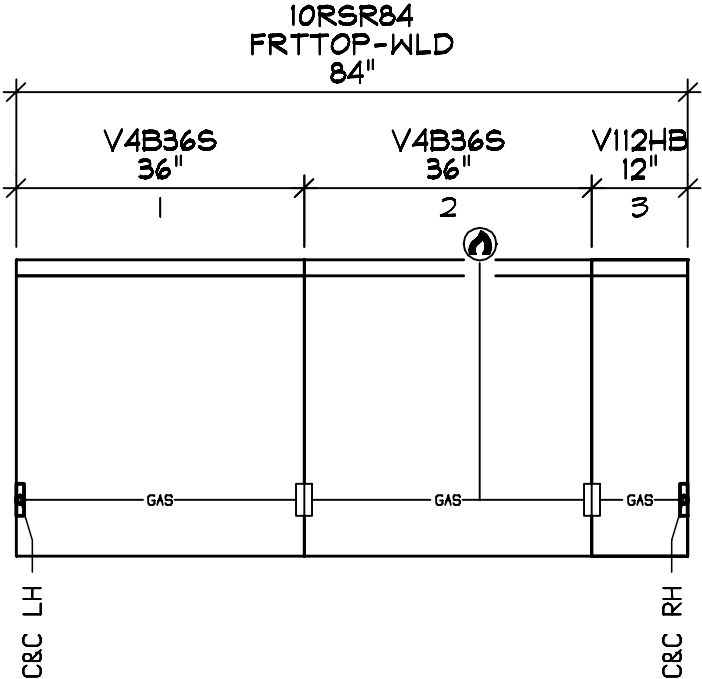

GAS CONNECTION #: 1
LOCATED IN ITEM: 2
PIPE SIZE: 1.25 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 400 MBTU
INCLUDES ITEMS: 3 2 1
NOTE:

1	1 EA	V4B36S	RANGE
190 MBTU	1.25	MANIFOLD	
2	1 EA	V4B36S	RANGE
190 MBTU	1.25	32 AFF	
3	1 EA	V112HB	RANGE
30 MBTU	1.25	MANIFOLD	

ELEVATION

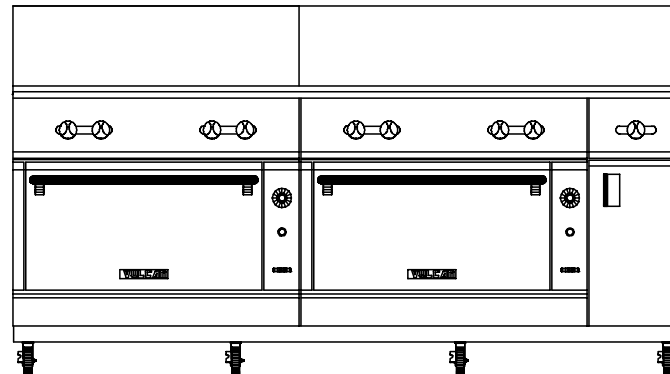


VH-WCOLL
COPYRIGHT (C) 2021

 **VULCAN**

ROXANNE HOLT
WCOLL

WILLIAMS COLLEGE
07-01-21

6SE VIEW

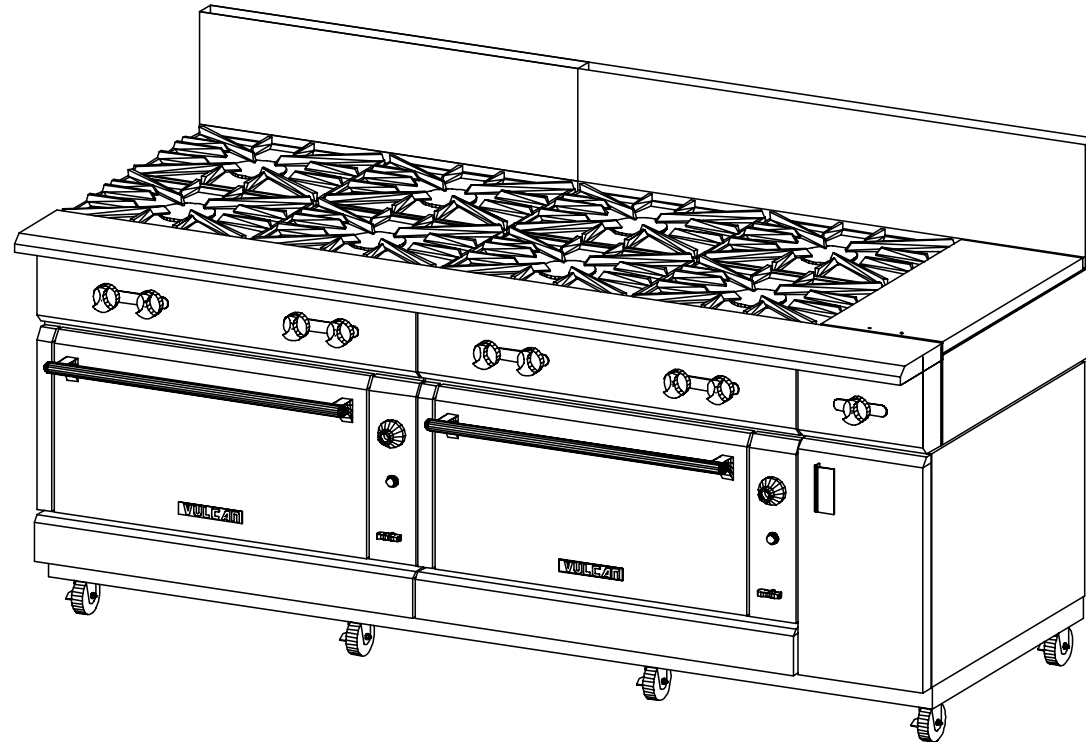


VH-WCOLL
COPYRIGHT (C) 2021

 **VULCAN**

ROXANNE HOLT
WCOLL

WILLIAMS COLLEGE
07-01-21

SSW VIEW

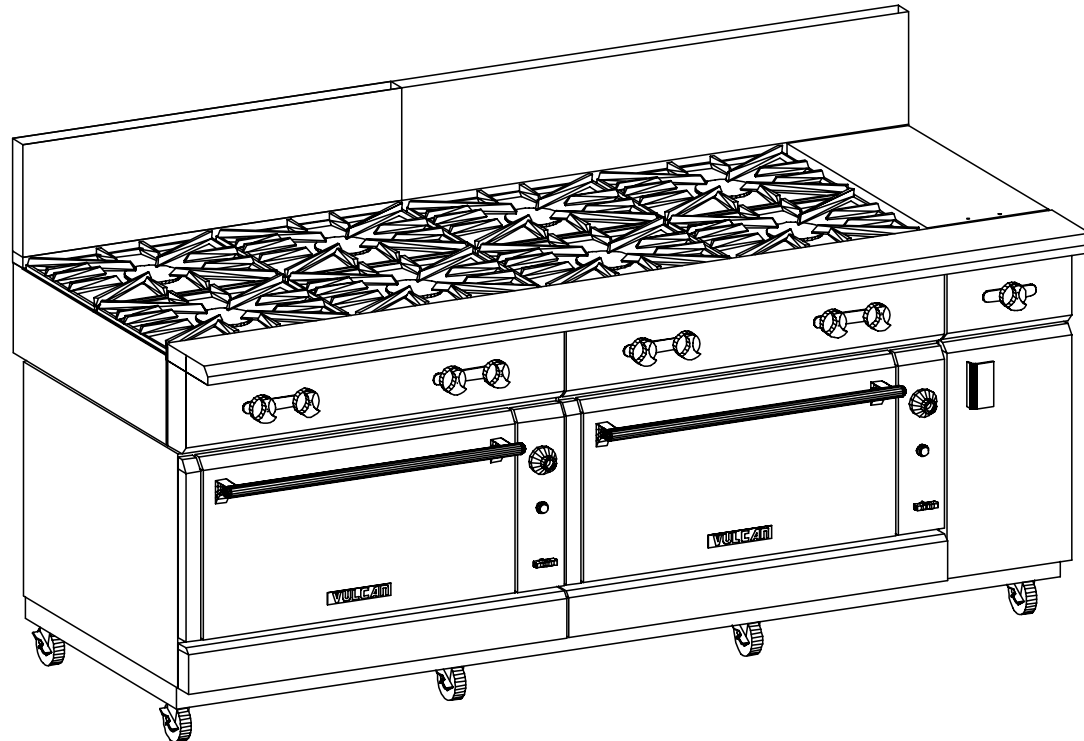

VH-WCOLL
COPYRIGHT (C) 2021

 **VULCAN**

ROXANNE HOLT
WCOLL

WILLIAMS COLLEGE
07-01-21

GENERAL NOTES - PLEASE READ**VENTILATION:**

ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:

ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:

ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:



















EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (14" W.C.)

BY OTHERS:

VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:

IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURER RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

	CONNECTION POINT
	COLD WATER
	HOT WATER
	HOT + COLD WATER
	DRAIN
	POWER
	SWITCH
	CORD SET
	CONV OUTLET RECP
	DUPLEX RECPTACLE
	SINGLE RECPTACLE
	GAS
	STEAM SUPPLY
	STEAM RETURN
	STEAM TAKE OFF
	EXHAUST VENT
	SUPPLY VENT
	REFRIGERATION

07-01-2021

07-01-2021 : 09:29:18a

Roxanne Holt
VULCAN HART COMPANY
3600 North Point Blvd
Baltimore, MD 21222
v. 410-282-4322

Email: roxanne.holt@vulcanhart.com

PROJECT CODE

WCOLL