






PLAN VIEW

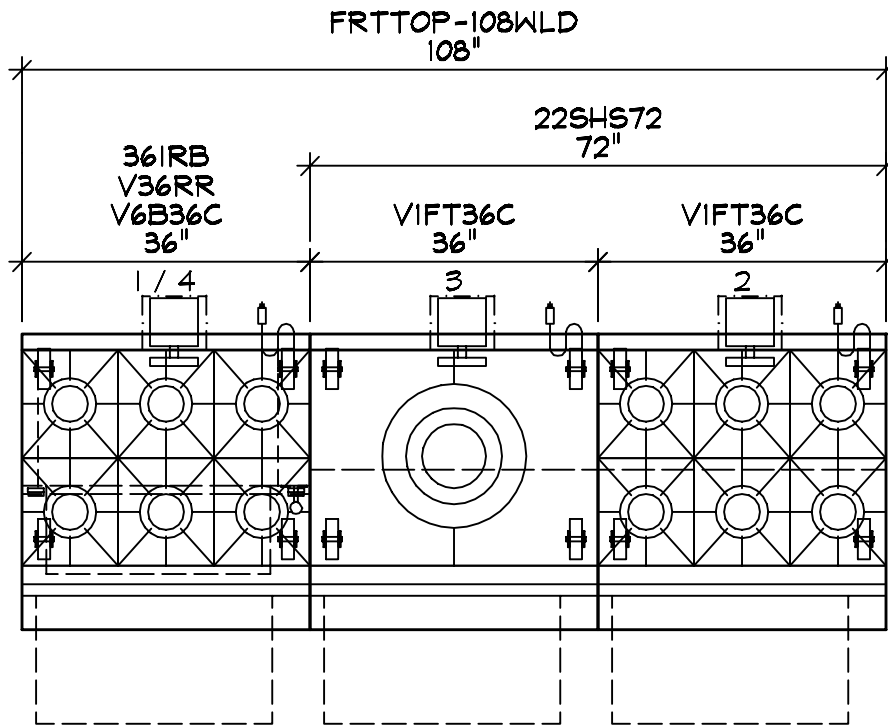

VH-WPALM
COPYRIGHT (C) 2021


VULCAN

JACOB JORDAN
WPALM

WORKSHOP PALM SPRINGS

01-27-21

PLAN VIEW

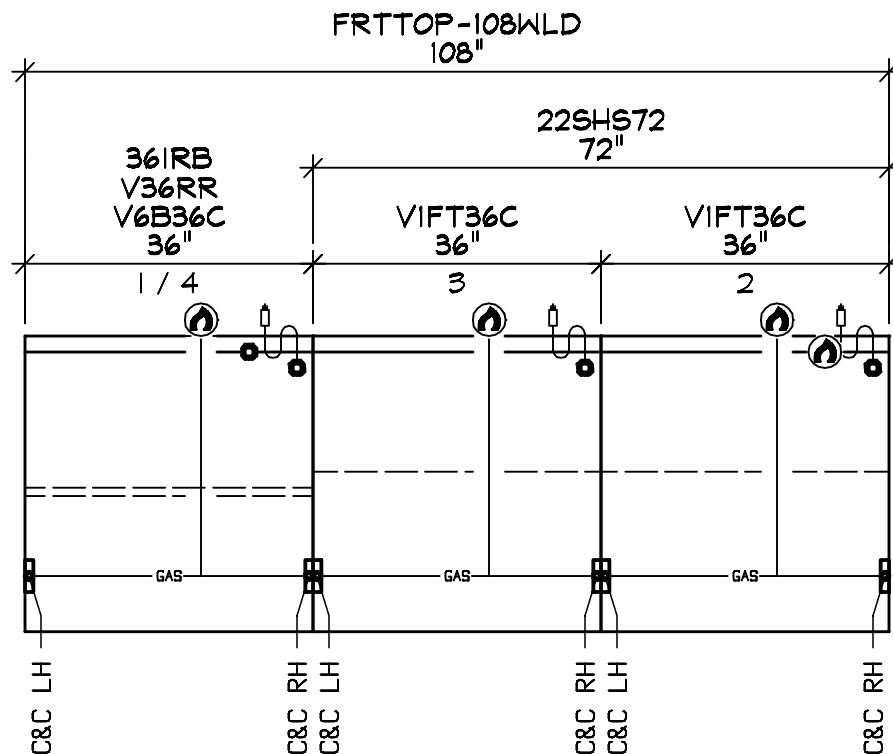

1	1 EA	V6B36C	RANGE
	242 MBTU	1.25	32 AFF
	120 (1)	4.0A	5-15
2	1 EA	V6B36C	RANGE
	242 MBTU	1.25	32 AFF
	120 (1)	4.0A	5-15
3	1 EA	V1FT36C	RANGE
	77 MBTU	1.25	32 AFF
	120 (1)	4.0A	5-15
4	1 EA	36IRB	SALAMANDER
	30 MBTU	0.75	INTERPLUMB

GAS CONNECTION #: 1
 LOCATED IN ITEM: 1
 PIPE SIZE: 1.25 NPT
 CP HEIGHT: 32" AFF
 TOTAL GAS LOAD: 272 MBTU
 INCLUDES ITEMS: 1 4
 NOTE:

GAS CONNECTION #: 2
 LOCATED IN ITEM: 2
 PIPE SIZE: 1.25 NPT
 CP HEIGHT: 32" AFF
 TOTAL GAS LOAD: 242 MBTU
 INCLUDES ITEMS: 2
 NOTE:

GAS CONNECTION #: 3
 LOCATED IN ITEM: 3
 PIPE SIZE: 1.25 NPT
 CP HEIGHT: 32" AFF
 TOTAL GAS LOAD: 77 MBTU
 INCLUDES ITEMS: 3
 NOTE:

VH-WPALM

COPYRIGHT (C) 2021


VULCAN

JACOB JORDAN
 WPALM

WORKSHOP PALM SPRINGS

01-27-21

ELEVATION

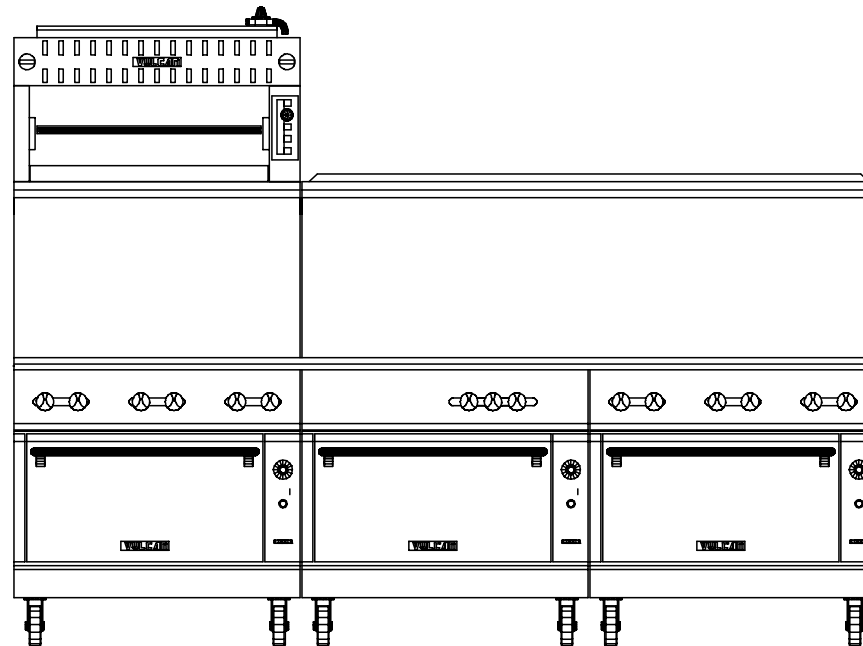


VH-WPALM
COPYRIGHT (C) 2021

 **VULCAN**

JACOB JORDAN
WPALM

WORKSHOP PALM SPRINGS
01-27-21

SSS VIEW

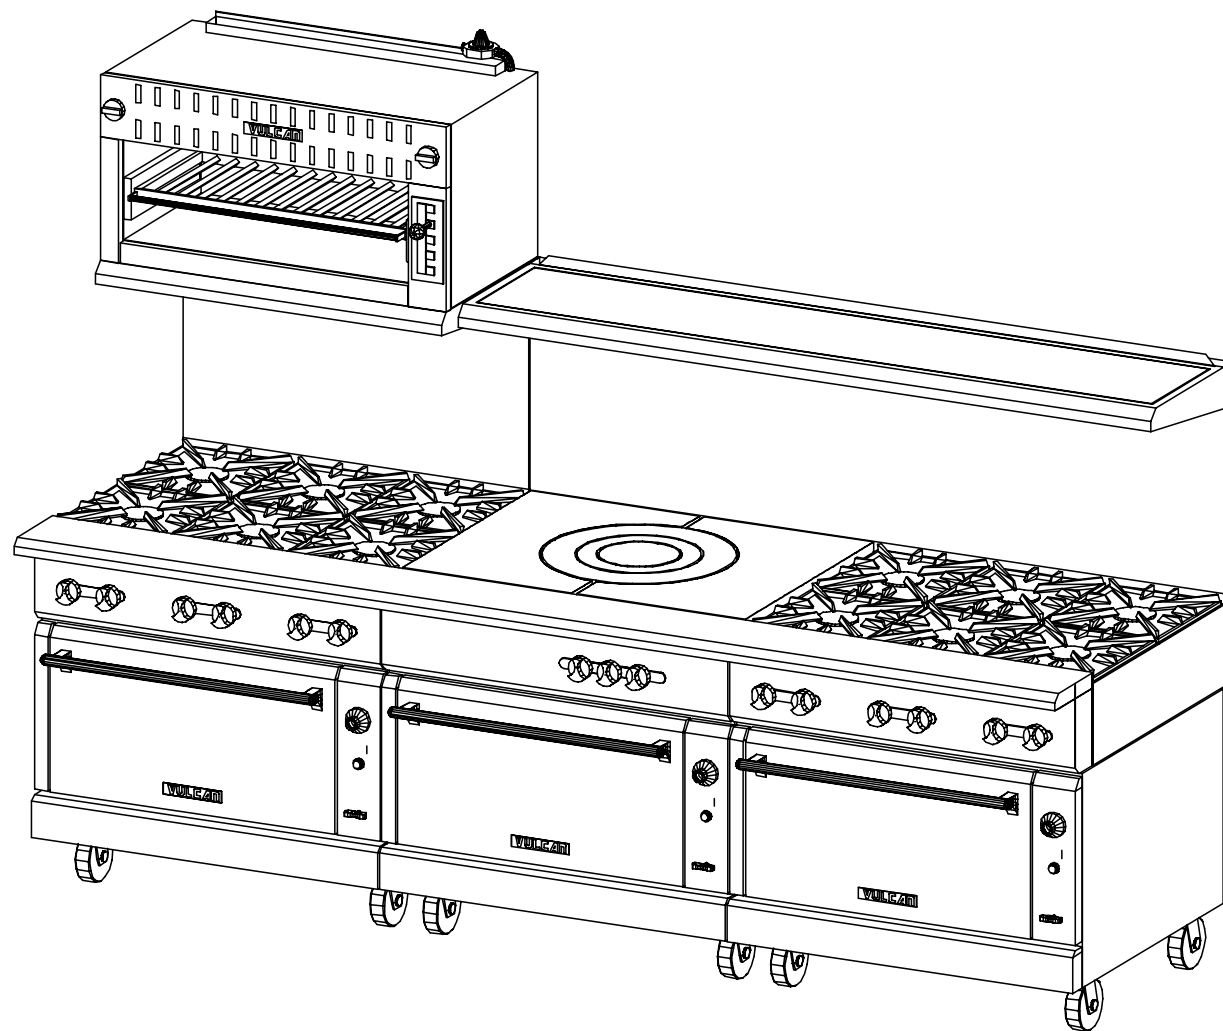

VH-WPALM
COPYRIGHT (C) 2021


VULCAN

JACOB JORDAN
WPALM

WORKSHOP PALM SPRINGS

01-27-21

SSW VIEW

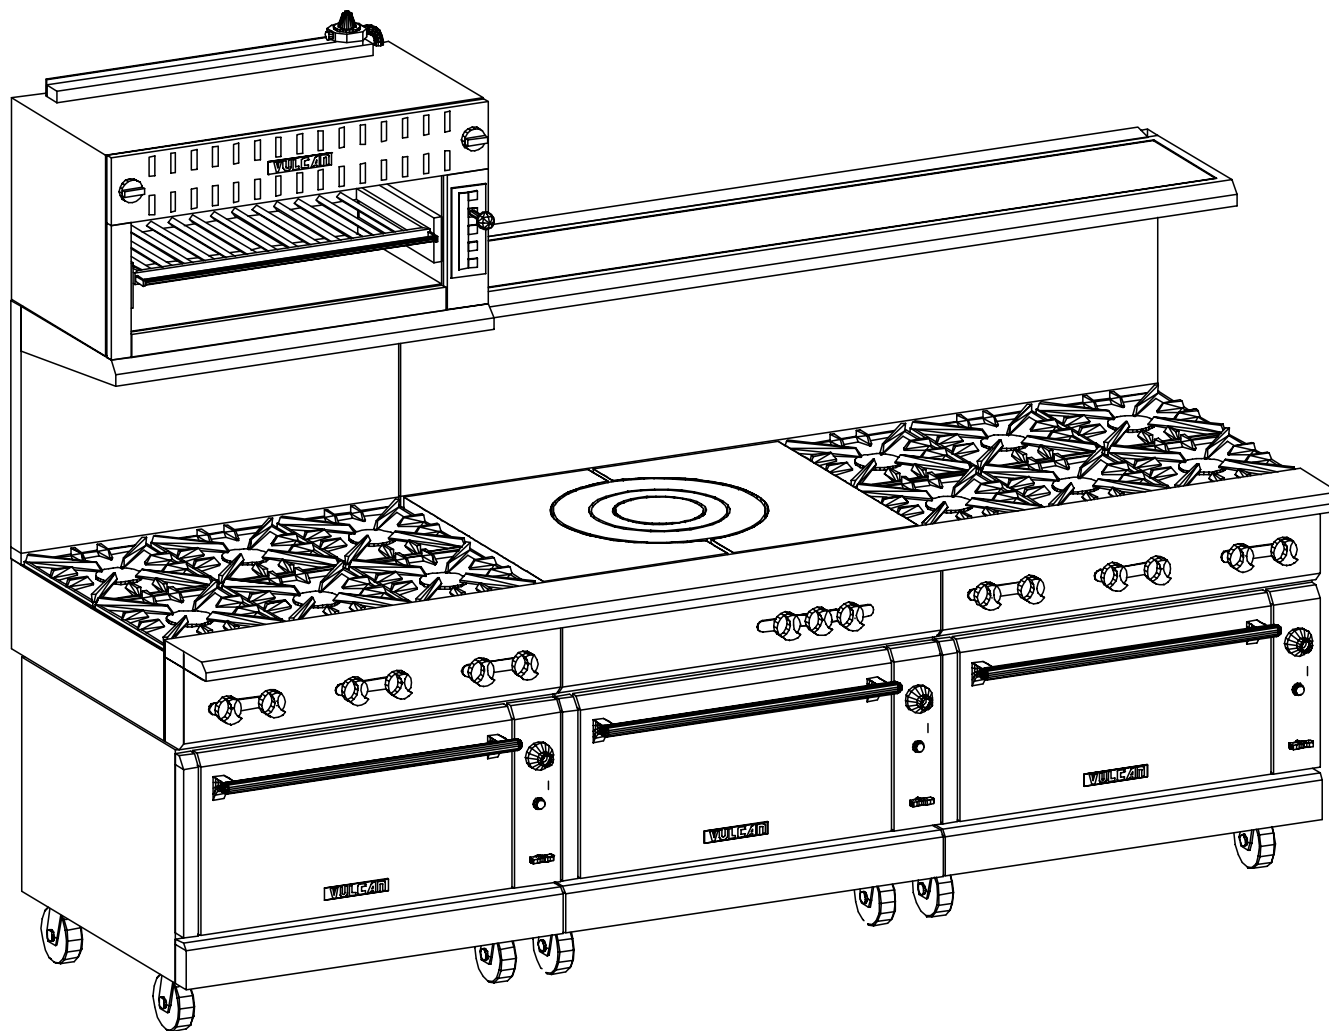

VH-WPALM
COPYRIGHT (C) 2021

 **VULCAN**

JACOB JORDAN
WPALM

WORKSHOP PALM SPRINGS

01-27-21

GENERAL NOTES - PLEASE READ**VENTILATION:**

ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:

ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:

ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:



















EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (14" W.C.)

BY OTHERS:

VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:

IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURER RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

	CONNECTION POINT
	COLD WATER
	HOT WATER
	HOT + COLD WATER
	DRAIN
	POWER
	SWITCH
	CORD SET
	CONV OUTLET RECP
	DUPLEX RECPTACLE
	SINGLE RECPTACLE
	GAS
	STEAM SUPPLY
	STEAM RETURN
	STEAM TAKE OFF
	EXHAUST VENT
	SUPPLY VENT
	REFRIGERATION

01-16-2021

01-16-2021 : 02:27:29p

01-27-2021 : 09:57:43a

Jacob Jordan
KLH MARKETING
2120 East Winston Road
Anaheim, CA 91752
v. 714-999-0100

Email: jacob@klh.com

PROJECT CODE

WPALM